



Oregon

John A. Kitzhaber, MD, Governor

Water Resources Department

North Mall Office Building
725 Summer Street NE, Suite A

Salem, OR 97301-1271

503-986-0900

FAX 503-986-0904

March 1, 2011

RONALD ASPAAS #1445
HANSEN DRILLING CO INC
6711 NE 58TH AVE
VANCOUVER WA 98661

FINAL ORDER


Dear Ron:

The Special Standard request you submitted for owner: Multnomah County, Start Card number 1012280, is hereby approved for the following: You may install this well below land surface in a vault. The vault must be constructed per the design diagram included on your request. All conduit and pipes entering the vault must be sealed to prevent surface water from leaking into it. The vault also must have a drain to daylight with a check valve to prevent backflow. ***In addition, the lid of the vault shall be permanently marked with the words "Water Well" in order to protect the groundwater resource and to assist Department personnel in locating the well in the future.*** All other construction standards must be adhered to.

The Well Construction Standards serve to protect ground water resources. By approving and issuing this special construction standard the Oregon Water Resources Department is not representing that a well constructed in accordance with this condition will maintain structural integrity or that it meets engineering standards. The well constructor/or landowner is responsible for ensuring that a well is constructed in a manner that protects ground water resources as required under Oregon Administrative Rules 690-200 through 690-240.

If you have any questions concerning this letter, I may be contacted at (503) 986-0851, or by e-mail at Kristopher.R.Byrd@ wrd.state.or.us.

Sincerely,

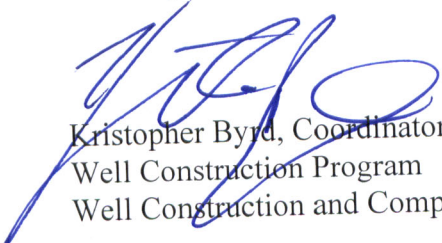

Kristopher Byrd, Coordinator
Well Construction Program
Well Construction and Compliance Section

cc: Bill Ferber, W Region Manager
File

This is a final order in other than contested case. This order is subject to judicial review under ORS 183.484. Any petition for judicial review must be filed within the 60 day time period specified by ORS 183.484(2). Pursuant to ORS 536.075 and OAR 137-004-0080 you may either petition for judicial review or petition the Director for reconsideration of this order. A petition for reconsideration may be granted or denied by the Director, and if no action is taken within 60 days following the date the petition was filed, the petition shall be deemed denied.





Oregon Water Resources Department
 725 Summer Street NE, Suite A
 Salem Oregon 97301-1266
 (503) 986-0900
 www.wrd.state.or.us

Special Standards Request Form

REQUEST FOR WRITTEN APPROVAL TO USE CONSTRUCTION METHODS NOT INCLUDED IN OREGON ADMINISTRATIVE RULES 690-200 THROUGH 690-240

Before the request can be considered, this form must be completed. Requests shall be submitted to the Well Construction Program Coordinator, Water Resources Department, 725 Summer Street NE, Suite A, Salem OR 97301-1266. Requests may also be considered by the appropriate Regional Manager.

Revised 2-21-11
 Date of request: ~~1-27-11~~ Oral approval date (if applicable): _____

Bonded Well Constructor (name, license #, and mailing address): RONALD ASPARS #1445
6711 NE 58th AVE VANCOUVER, WA. 98661

(1) Location of Well: NW 1/4 NW 1/4 Tax lot 2100 Section 5,
 Township 1 So. N, Range 3 E W, MULTNOMAH County
 Address at well site: 18480 S.E. STARK ST GRESHAM
PORTLAND, OR. 97233

(2) Start Card Number(s)(for work to be done): 1012280 ~~10~~ 205134
 EXTRACTION WELL

(3) Name and Address of Land Owner: MULTNOMAH COUNTY, c/o HOWARD S. WRIGHT
425 NW 10th AVE suite 206, PORTLAND OR 97209
OLEG SAIDY PROJECT ENGINEER 503-550-6067

(4) Distance to the nearest septic tank, drainfield, closed sewage line (if water supply well)
OVER 100 FT.

(5) The unusual site conditions which necessitate this request: WELLS LOCATED IN
PARKING AREA FOR NEW COURT HOUSE, VAULTS ARE TO KEEP
FROM VANDALISM & BE HIT BY AUTO'S
WELL TO BE USED FOR HEATING & COOLING BUILDING

(6) The proposed construction methods that the bonded well constructor believes will be adequate for this well: (attach additional pages if needed)
WELLS TO BE FINISHED BELOW GRADE IN VAULTS,
DRAWINGS ATTACHED
SURFACE SEAL WILL BE CEMENT GROUT 0-150 FT.
~~EXISTING TEST WELL ON SITE HAS CEMENT SURFACE SEAL 0-20 FT.~~
 Well Log ATTACHED


- (7) Diagram showing the pertinent features of the proposed well design and construction:
(attach additional pages if needed)


PLEASE NOTE:

- (1) The Well Construction Standards serve to protect ground water resources. By approving and issuing this special construction standard the Oregon Water Resources Department is not representing that a well constructed in accordance with this condition will maintain structural integrity or that it meets engineering standards. The well constructor/or landowner is responsible for ensuring that a well is constructed in a manner that protects ground water resources as required under Oregon Administrative Rules 690-200 through 690-240.
- (2) If it should be determined at some future date that the well, due to its construction, is allowing ground water contamination, waste or loss of artesian pressure, the undersigned shall return to the site and rectify the problem.
- (3) If oral approval was granted, a written request must be submitted to the Department either within three (3) working days of the date of oral approval or prior to the completion of the associated well work. Failure to submit a written request as described above may void prior oral approval.


I have read and understand the above information. I further attest that the information provided is accurate to the best of my knowledge.

Bonded Constructor Signature: _____



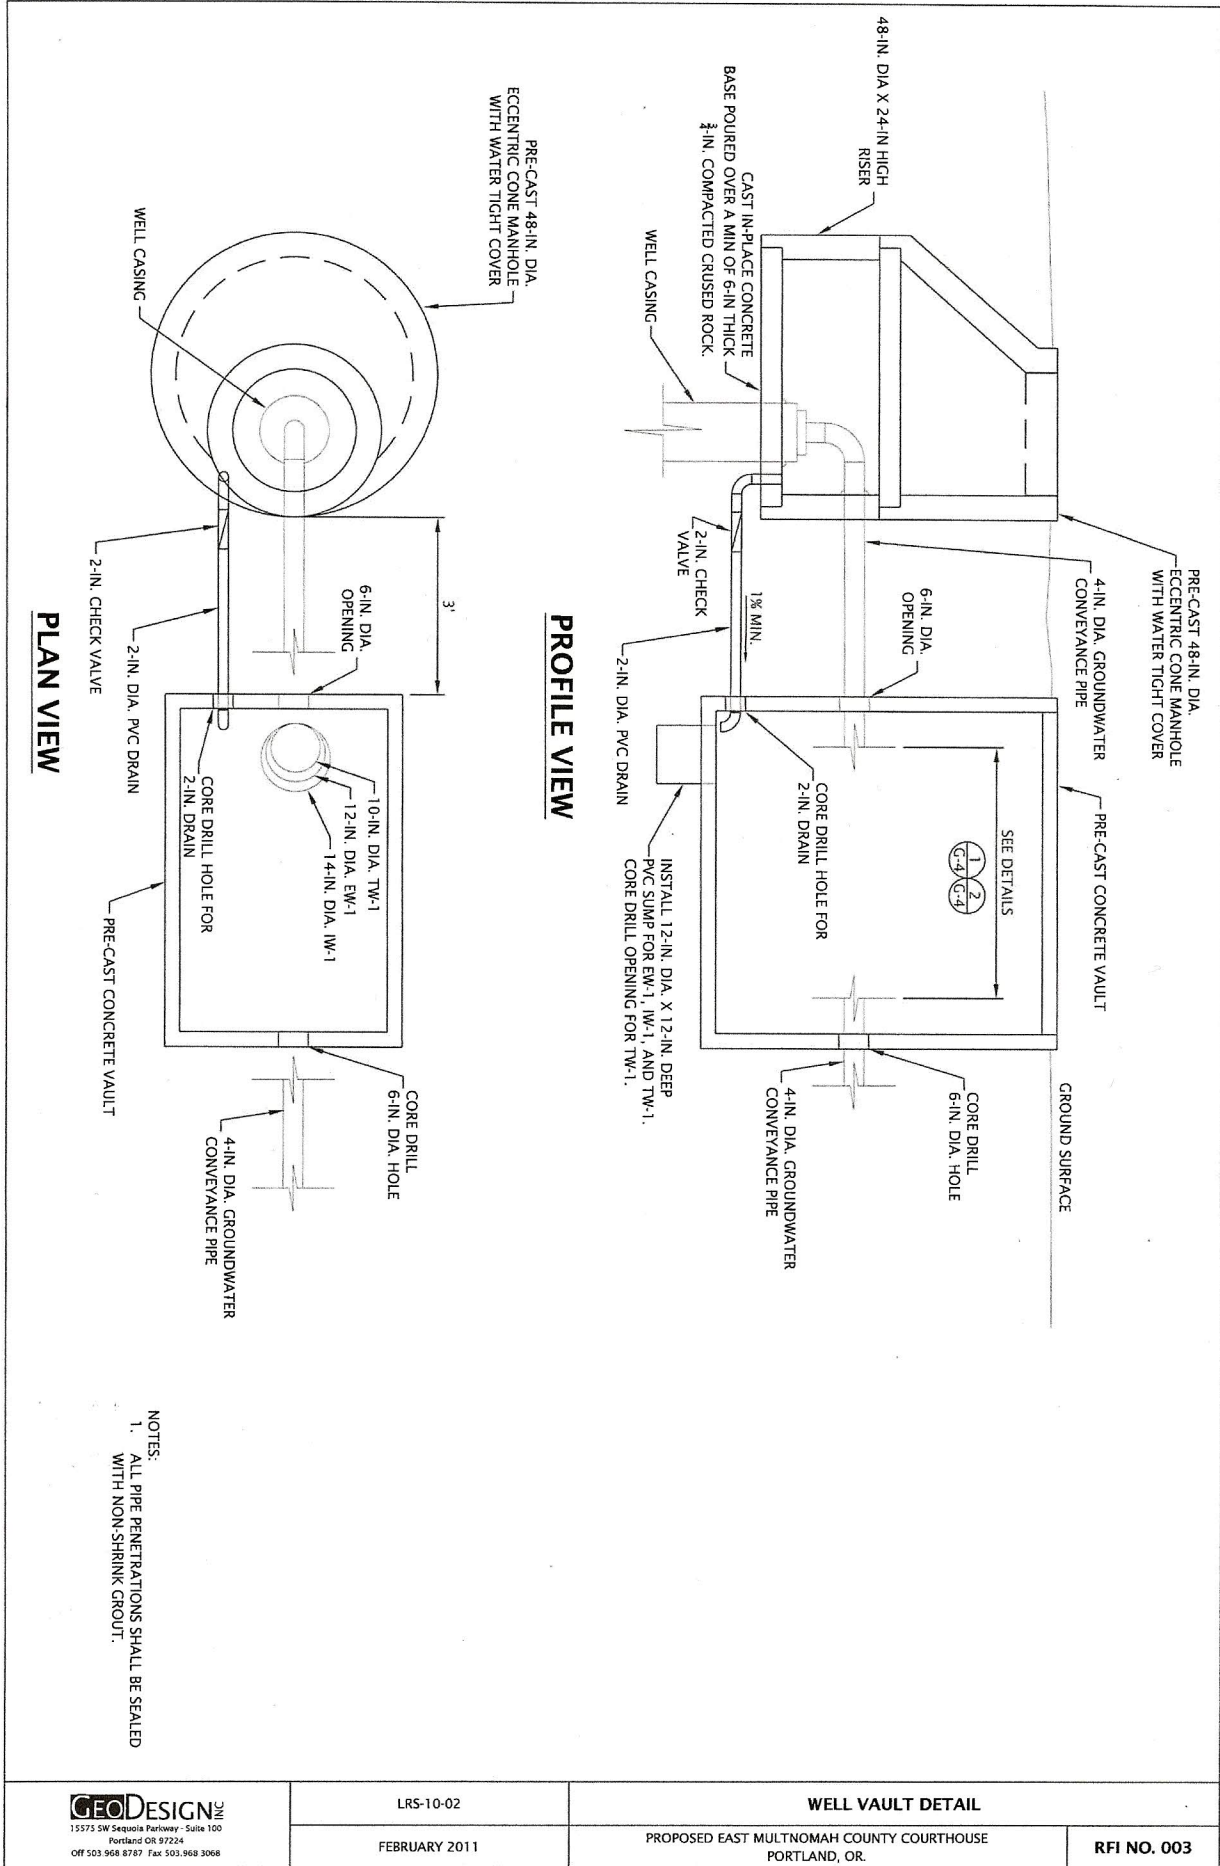

NOTES:
 1. ALL PIPE PENETRATIONS SHALL BE SEALED WITH NON-SHRINK GROUT.

 15575 SW Sequoia Parkway - Suite 100 Portland OR 97224 Off 503.968.8787 Fax 503.968.3068	LRS-10-02	WELL VAULT DETAIL	
	FEBRUARY 2011	PROPOSED EAST MULTNOMAH COUNTY COURTHOUSE PORTLAND, OR.	RFI NO. 003