

June 5, 1995

WATER
RESOURCES
DEPARTMENT

e✓
Bert Jones
Jones Well Drilling
29400 Santiam Hwy
Lebanon, OR 97355

Dear Bert:

The Water Resources Department has received your request for special standards on the Tracy Mount well located in Township 10S, Range 2W, Section 10 of Linn County.

You are proposing to extend the annular seal in this well by placing 10 inch casing to 90 feet below land surface. The space between the 10 inch casing and the 12 inch borehole will then be grouted via tremie method to land surface. In order to insure that the tremie extends the full distance of the annular space, you will be using small diameter pipe.

The above repair will effectively extend the seal to 90 feet below land surface.

Your request is approved. I have enclosed a more current version of our special standard form. This form lists my address as the proper contact. Please feel free to make copies of this form as needed. If you have any questions concerning this letter, please contact me by phone at (503) 396-3121 x254, by fax at (503) 396-6233 or by letter at 290 N Central Street, Coquille, OR 97423.

Sincerely,



Rob Carter
Well Construction Specialist

cc: Gene McGinnis, Watermaster
Richard Edwards, Well Inspector

c:\wp51\ss95\mount



RECEIVED

MAY 19 1995

STATE OF OREGON
WATER RESOURCES DEPARTMENT

WATER RESOURCES DEP
SALEM, OREGON

REQUEST FOR WRITTEN APPROVAL TO USE CONSTRUCTION METHODS NOT
INCLUDED IN THE RULES AND REGULATIONS PRESCRIBING GENERAL STANDARDS
FOR THE CONSTRUCTION AND MAINTENANCE OF WELLS IN OREGON

Before approval can be considered the following questions must answered.

Requests shall be submitted to the Watermaster Division, 3850 Portland
Road, NE, Salem, OR 97310.

Date: 5-17-95

Well Constructor: Jones Drilling Co., Inc.
29400 Santiam Hwy - Lebanon, OR

(1) Location of well: SW 1/4 NW 1/4 of Section 10,
Township 10S, Range 2W, LINN County.

Address at well site or nearest known address: 37225 Jefferson
Scio Or. Scio 97375

(2) Name and address of Landowner: Tracy Mount
37225 Jefferson Scio Rd.
Scio, OR 97374


(3) The distance to the nearest well and septic drainfield: 100'

(4) The unusual conditions existing at the well site: existing well
take water from upper aquifer

(5) The proposed construction methods that the well constructor
or landowner constructing the well believes will be adequate for
his particular well: Seal out all water above 90' by
casing with 10" casing & flushed grouting from 90'
to ground surface between 10" & 12" casing.

W-AS
remark: repair

(6) A diagram showing the pertinent features of the proposed well design and construction (attach additional sheet if necessary):

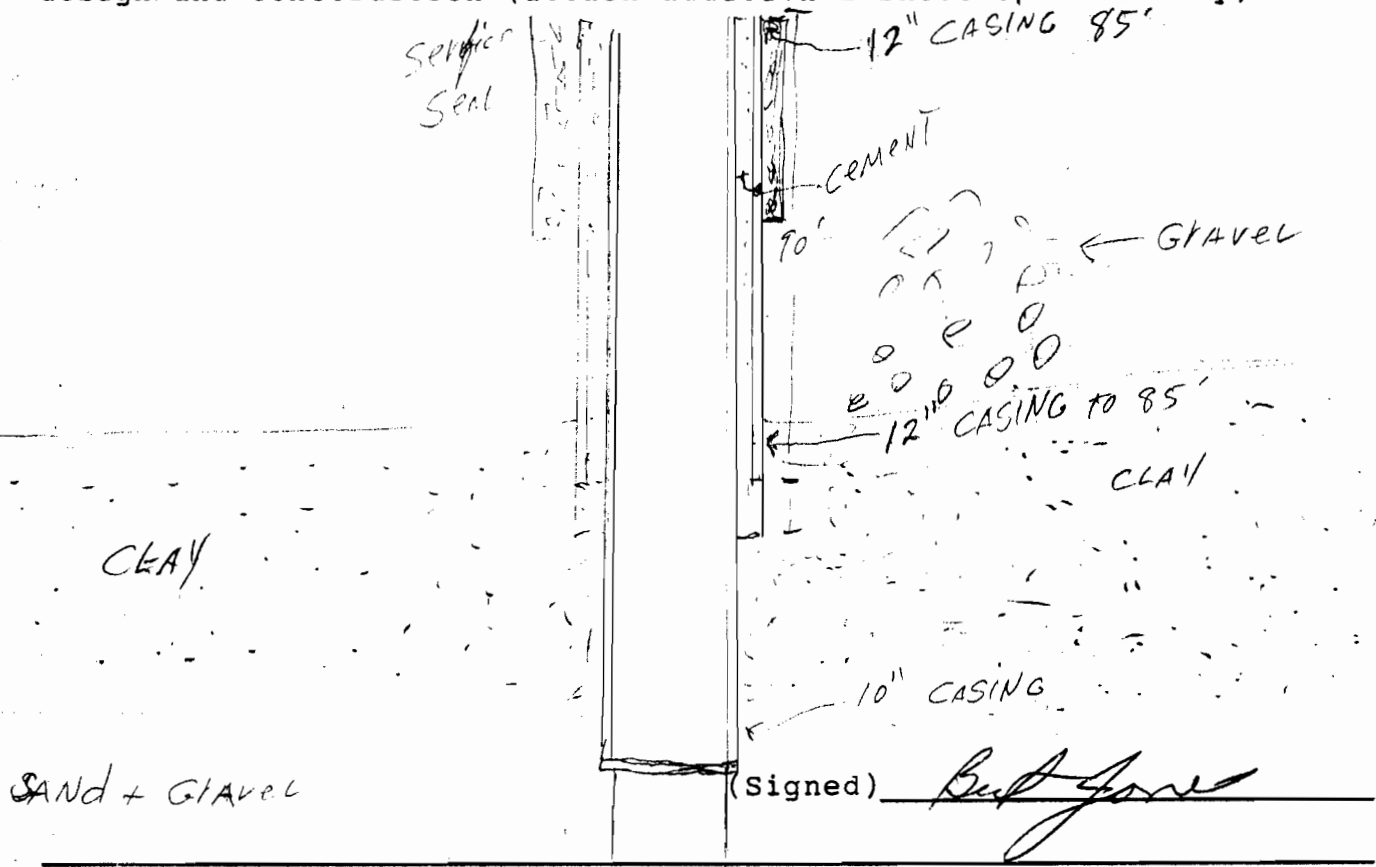

For Water Resources Department Use Only

Date: 6-5-95

Approved by: *[Signature]*

Denied by: _____

Remarks: _____

NOTE:

- (1) If approval, all other phases of construction must be in compliance with State Well Construction Standards.
- (2) If it should be determined at some future date that the well, due to its construction, is offering an avenue for pollution of the ground water body, it will be necessary for you to return to the site to correct any well deficiencies.