



# Oregon

Tina Kotek, Governor

Oregon Water Resources Dept  
725 Summer St NE, Ste A Salem, OR 97301  
Ph (503) 986-0900, Fax (503) 986-0904  
[www.oregon.gov/owrd](http://www.oregon.gov/owrd)

July 17, 2023

DWAYNE PERSON WWC/MWC#1934  
CASCADE WELL DRILLING LLC  
PO BOX 1404  
GOLDENDALE, WA 98620

## FINAL ORDER

Dear Mr. Person:

The Special Standards Request Form you submitted for owner: Hood River Cherry Co., for Start Card number: 1060828, is hereby approved for the following: You may construct this water supply well, placing bentonite between the 16- and 12-inch casing, as described on your Special Standards Request Form dated July 17, 2023. All other well construction standards must be adhered to. A copy of your Special Standards Request Form is enclosed.

Approval of this Special Standards Request was granted on July 14, 2023 due to you reporting the caving conditions from 315 to 460 feet and being unable to keep the borehole open to place seal.

Verbal approval of this Special Standards Request was provided on July 14, 2023.

The Well Construction Standards serve to protect ground water resources. By approving and issuing this special construction standard the Oregon Water Resources Department is not representing that a well or geotechnical boring constructed in accordance with this condition will maintain structural integrity or that it meets engineering standards. The well constructor/or landowner is responsible for ensuring that a well or geotechnical boring is constructed in a manner that protects ground water resources as required under Oregon Administrative Rules 690-200 through 690-240.

If you have any questions concerning this letter, I may be contacted at (503) 302-8618, or by e-mail at [Tommy.K.Laird@water.oregon.gov](mailto:Tommy.K.Laird@water.oregon.gov).

Sincerely,

Tommy Laird  
Well Construction Program Coordinator  
Well Construction Section

enclosure

cc: Shaun Finn, Well Inspector, Northcentral Region

**This is a FINAL ORDER other than contested case. This final order is subject to judicial review under ORS 183.484. Any petition for judicial review of the final order must be filed within the time specified by ORS 183.484(2). Pursuant to ORS 536.075 and OAR 137-004-0080 you may either petition for judicial review or petition the Director for reconsideration of this order. A petition for reconsideration may be granted or denied by the Director, and if no action is taken within 60 days following the date the petition was filed, the petition shall be deemed denied.**



**Oregon Water Resources Department**  
 725 Summer Street NE, Suite A  
 Salem, OR 97301-1266  
 (503) 986-0900  
 (503) 986-0902 Fax  
[wdl\\_wcc@water.oregon.gov](http://wdl.wcc@water.oregon.gov)

# Special Standards Request Form

## REQUEST FOR WRITTEN APPROVAL TO USE CONSTRUCTION METHODS NOT INCLUDED IN OREGON ADMINISTRATIVE RULES 690-200 THROUGH 690-240

Before the request can be considered, this form must be completed. Requests shall be submitted to the Well Construction Program Coordinator, Water Resources Department, 725 Summer Street NE, Suite A, Salem, OR 97301-1266. Requests may also be considered by the Well Construction Section Manager or Well Construction Compliance Coordinator.

Date of request: 7-17-23 Oral approval date (if applicable): 7-14-23

Bonded Well Constructor (name, license #, and mailing address): Dwayne Person  
1934, PO Box 1404, Goldendale Wa. 98620

(1) Location of Well: NW  $\frac{1}{4}$  SE  $\frac{1}{4}$  Tax Lot: 1300 Section: 17  
 Township: 1 N Range: 10 E County: Hood River  
 Latitude: 45.48068286 Longitude: -121.57224065

(2) Special Standards Number (OWRD Assigned): \_\_\_\_\_

(3) Start Card Number(s) (for work to be done): 1060828

(4) Well Label Identification Number (if assigned): L 150040

(5) Associated Well Report Numbers (if applicable): \_\_\_\_\_

(6) Name and Address of Landowner: Hood River Cherry Co.  
Brad Fowler 1321 Alameda Rd Hood River, Or. 97031

(7) Address of Project/Well Site: Evans Creek Rd

(8) Type of Work (New, Deepening, Alteration, Abandonment): New

(9) Distance to Nearest Septic Tank, Drain Field, Closed Sewage Line, and Closed Storm Drainage System (if water supply well): NA


- (10) The Unusual Site Conditions Which Necessitate this Request: Unable to  
Terminate casing in unfractured rock, Caving  
badly 315' - 460
- (11) The Proposed Construction Methods the Bonded Well Constructor Believes will be Adequate for this Well (attach additional pages if needed): Bottom of casing  
sealed with 16 sacks of cement, Split Seal and  
bentonite seal between 16" and 12"
- (12) Attach a Site Map Showing the Relationship of the Well(s) to Any Existing Septic Tank, Drainfield, Closed Sewage Line, and Closed Storm Drainage System if the Request is to Place a Water Supply Well Within the Minimum Setbacks Detailed in OAR 690-210-0030.
- (13) If the Request is to Abandon a Monitoring Well In-Place, Then the Most Current Water Quality Analytical Data Must be Provided.
- (14) Monitoring Well Special Standard Requests Must Provide Oregon Department of Environmental Quality Site or Facility Identification Number and No Further Action (NFA) Decision (if applicable).
- (15) Diagram showing the pertinent features of the proposed well design and construction (attach additional pages if need):

See attached Diagram


PLEASE NOTE:

- (1) The Well Construction Standards serve to protect ground water resources. By approving and issuing special construction standards, the Oregon Water Resources Department is not representing that a well constructed in accordance with this condition will maintain structural integrity or that it meets engineering standards. The well constructor or landowner is responsible for ensuring that a well is constructed in a manner that protects groundwater resources as required under Oregon Administrative Rules 690-200 through 690-240.
- (2) If it should be determined at some future date that the well, due to its construction, is allowing groundwater contamination, waste or loss of artesian pressure, the undersigned shall return to the site and rectify the problem.
- (3) If oral approval was granted, a written request must be submitted to the Department either within three (3) working days of the date of oral approval or prior to completion of the associated well work. Failure to submit a written request as described above may void prior oral approval.

I have read and understand the above information. I further attest that the information provided is accurate to the best of my knowledge.

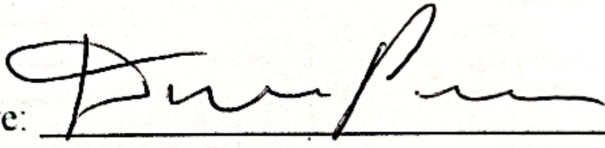Bonded Constructor Signature:  \_\_\_\_\_

Pictures Based on the details from being onsite and rough well log

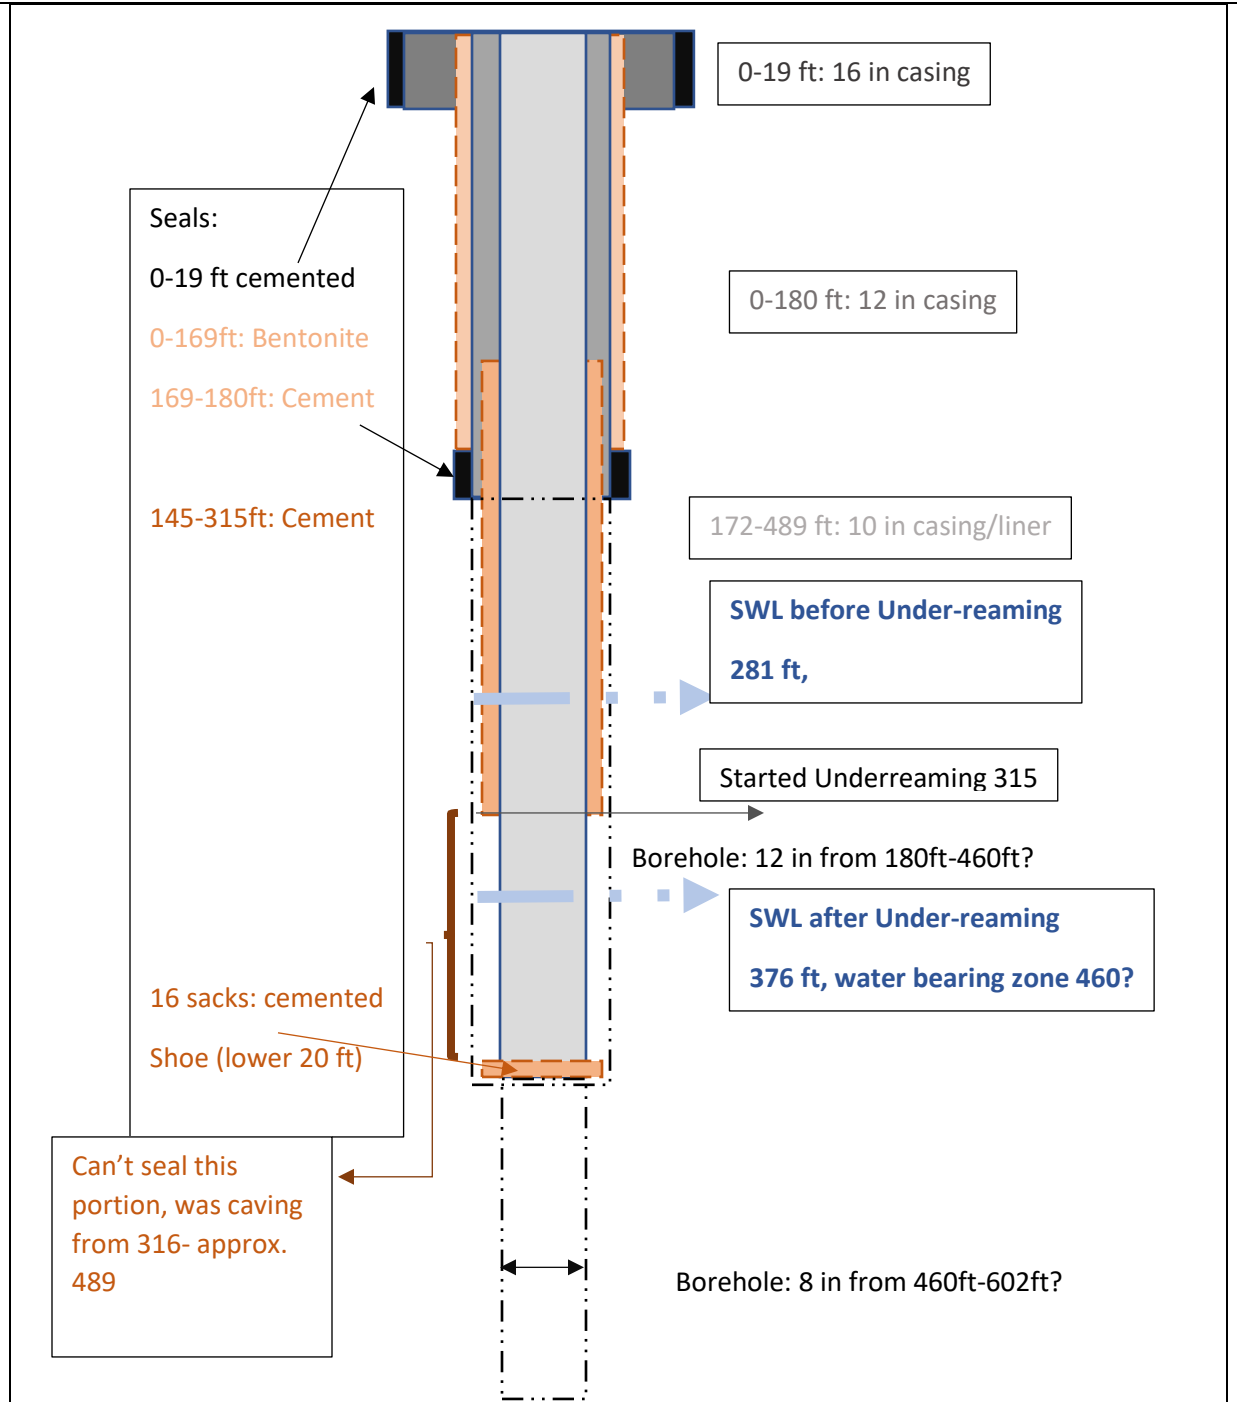

Unconsolidated units for entire depth down to 602 ft