

November 11, 1996

Oregon

WATER
RESOURCES
DEPARTMENT

ev

Steve Schneider
Schneider Equipment, Inc.
21881 River Road NE
St. Paul, OR 97137

Dear Steve:

Please find enclosed a copy of the following approved special standard request:

1. B.L.M. c/o Powell Butte View Estates Water Dist. (start card number 95165)

If you have any questions concerning this letter, please contact me by phone at (503) 378-8455 x283, by fax at (503) 378-8130 or by letter at 158 12th Street NE, Salem, OR 97310.

Sincerely,



Rob Carter
Well Construction Specialist

cc: Larry Carey, Well Inspector

c:\wplss96\schneid.5



Commerce Building
158 12th Street NE
Salem, OR 97310-0210
(503) 378-3739
FAX (503) 378-8130

Oregon Water Resources Department

REQUEST FOR WRITTEN APPROVAL TO USE CONSTRUCTION METHODS NOT INCLUDED IN OREGON ADMINISTRATIVE RULES 690-200 THROUGH 690-240

Before request can be considered, the following must be answered. Requests shall be submitted to the Well Construction Specialist, Water Resources Department. Requests may also be considered by the appropriate Regional Manager.

Date of request: 11/7/96 (telcon/onsite w/ Larry Carry)

Bonded Well Constructor (name, license and mailing address): Steve Schneider

WWC 644 21881 River Rd NE, St. Paul, OR 97137

(1) Location of Well: SE 1/4 SW 1/4 of Section 17, Township 16S, Range 14E, County.

Address at well site: BLM land - not assigned

(2) Start Card Number(s): 95165

(3) Name and Address of Land Owner: BLM % Powell Butte New Estates WL, P.O. Box 53, Powell Butte, OR 97153


(4) The distance to the nearest well, septic tank or drainfield (if water supply well): greater than 100'

(5) The unusual conditions which necessitate this request: Attempted to get tremie pipe below 20' in annulus but was not successful. Hole (not casing) has deviations from reaming. Would like to seal to 97' by freefall grout below tremie - No water in hole,

(6) The proposed construction methods that the well constructor believes will be adequate for this well (attach additional pages if needed) See (5) above. Encountered rock @ 2' and continues to 97'. Can call grout 'backfill' below 18' but would like to call it 'seal'. Grout will not dilute because no water is in hole.

w-OT remark - seal placement method

(7) Diagram showing the pertinent features of the proposed well design and construction (attach additional pages if needed):

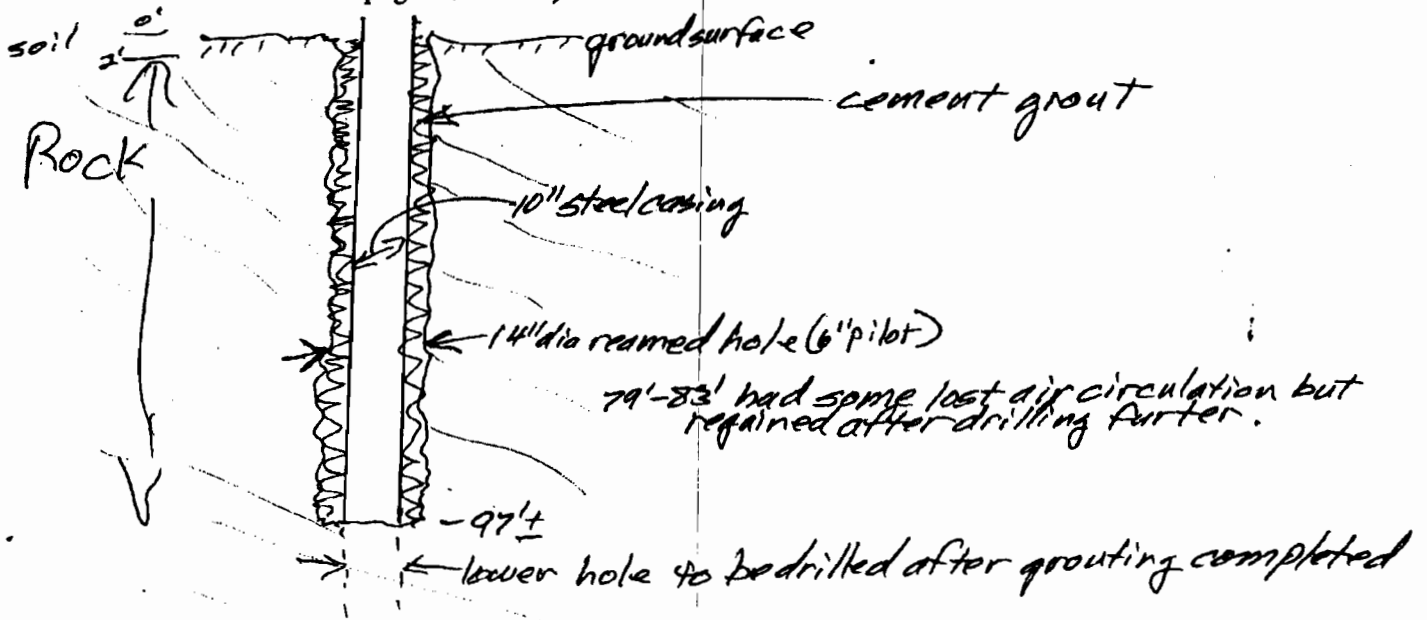

PLEASE NOTE:

- (1) If approved, all other phases of well construction must comply with the appropriate standards described in OAR 690-200 through 690-240.
- (2) If it should be determined at some future date that the well, due to its construction, is allowing groundwater contamination, waste or loss of artesian pressure, the undersigned shall return to the site and rectify the problem.
- (3) If verbal approval was granted, a written request must be submitted to the Department either within three (3) working days of the date of verbal approval or prior to the completion of the associated well work. Failure to submit a written request as described above may void prior approval.

I have read and understand the above information. I further attest that the information provided is accurate to the best of my knowledge.

Bonded Constructor Signature: Stephen Schneider

For Water Resources Department Use Only

Date: 11-11-96

Approved by: [Signature] Denied by: _____

Remarks: _____