



# Oregon

Theodore R. Kulongoski, Governor

*e/2-11-04*  
**Water Resources Department**  
North Mall Office Building  
725 Summer Street NE, Suite A  
Salem, OR 97301-1271  
503-986-0900  
FAX 503-986-0904

February 10, 2004

GROSSEN'S WELL DRILLING  
IVAN A GROSSEN # 783  
19927 MILL CREEK RD  
SCOTT MILLS OR 97375

## FINAL ORDER


Dear Mr. Grossen:

The special standard request you submitted for owner: Jay Nelson, start card number 101598 is denied for the following: using pea gravel for a seal. See Oregon Administrative Rule (OAR) 690-210-0130 and OAR 690-210-0140. Your special standard request form is enclosed.

As a note, what was proposed in the special standard request would not meet the water right permit conditions for this well.

If you have any questions concerning this letter, please contact me at (503) 986-0851, or by e-mail at [tracy.l.eichenlaub@wrд.state.or.us](mailto:tracy.l.eichenlaub@wrд.state.or.us).


Sincerely,

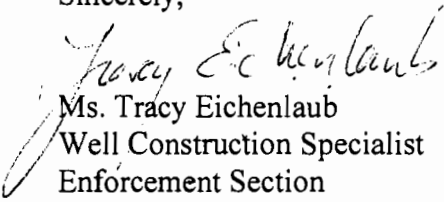  
Ms. Tracy Eichenlaub  
Well Construction Specialist  
Enforcement Section

enclosure

cc: Kris Byrd, NW Region Well Inspector

This is a final order in other than a contested case. This order is subject to judicial review under ORS 183.484. Any petition for judicial review of the order must be filed within the 60 day time period specified by ORS 183.484(2). Pursuant to ORS 536.075 and OAR 137.004-0080 and OAR 690-01-0005 you may either petition for judicial review or petition the Director for reconsideration of this order.

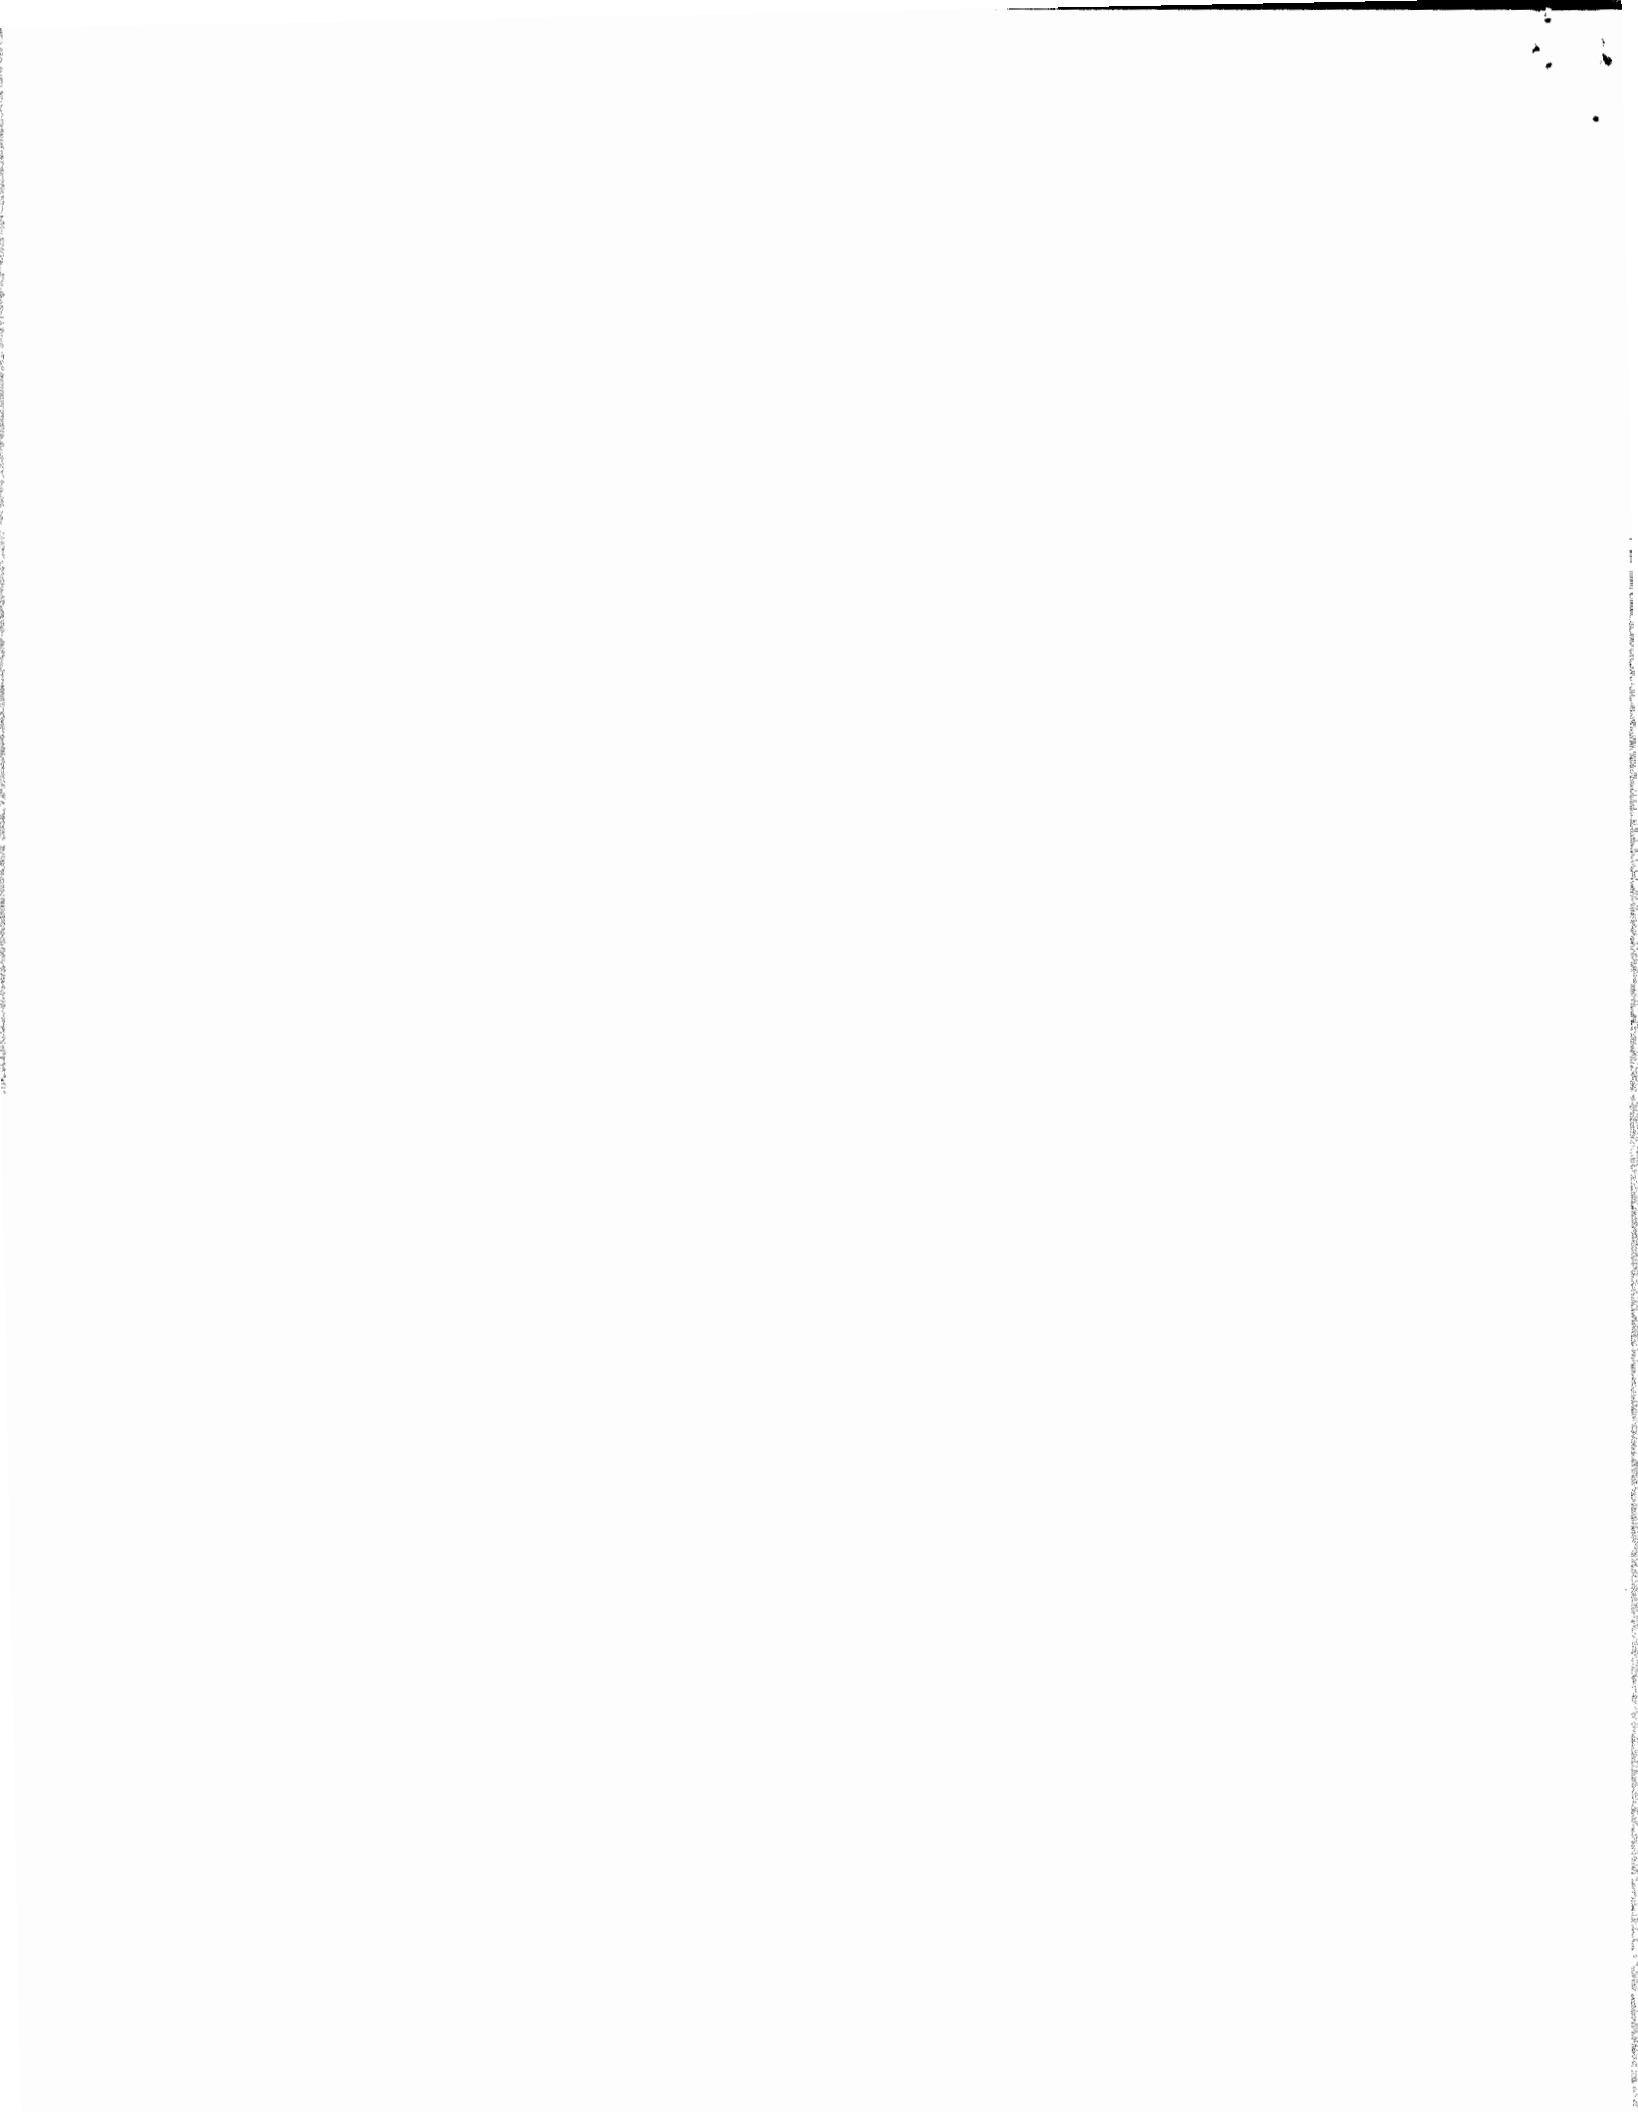

# Oregon Water Resources Department

## REQUEST FOR WRITTEN APPROVAL TO USE CONSTRUCTION METHODS NOT INCLUDED IN OREGON ADMINISTRATIVE RULES 690-200 THROUGH 690-240

Before the request can be considered, this form must be completed. Requests shall be submitted to the Well Construction Specialist, Water Resources Department, 158 12<sup>th</sup> Street NE, Salem OR 97301. Requests may also be considered by the appropriate Regional Manager.

Date of request: 2/6/04 Oral approval date (if applicable): \_\_\_\_\_

Bonded Well Constructor (name, license #, and mailing address): Ivan Grossen,

# 783 19927 Mill Ck. Rd Scotts Mills, OR. 97375

(1) Location of Well: NE 1/4 SE 1/4 of Section 32,  
Township 45 N/S, Range 1W E/W, Marion County  
Address at well site: 17280 Boones Ferry Rd. N.E  
Woodburn OR 97071

(2) Start Card Number(s)(for work to be done): 101598

(3) Name and Address of Land Owner: Jay Nelson, 17280 Boones  
Ferry Rd. N.E. Woodburn, OR 97071

(4) Distance to the nearest septic tank, drainfield, closed sewage line (if water supply well)  
150'

(5) The unusual site conditions which necessitate this request: Large layers  
of Sand & Gravel formations shall be backfilled  
with pea Gravel to prevent loss of Grout into the formation.


(6) The proposed construction methods that the bonded well constructor believes will be adequate for this well: (attach additional pages if needed)  
I propose to pressure Grout well from 0'-97', 147' to 154',  
and 205'-246', and in water bearing zones backfill with  
pea Gravel from 97' to 147', 154' to 205' and 246'-235'

Note: This well must meet Criteria for ~~Water Rights~~

FEB 06 2004  
WATER RESOURCES DEPT.  
SALEM, OREGON

W-Sm

- (7) Diagram showing the pertinent features of the proposed well design and construction:  
(attach additional pages if needed)

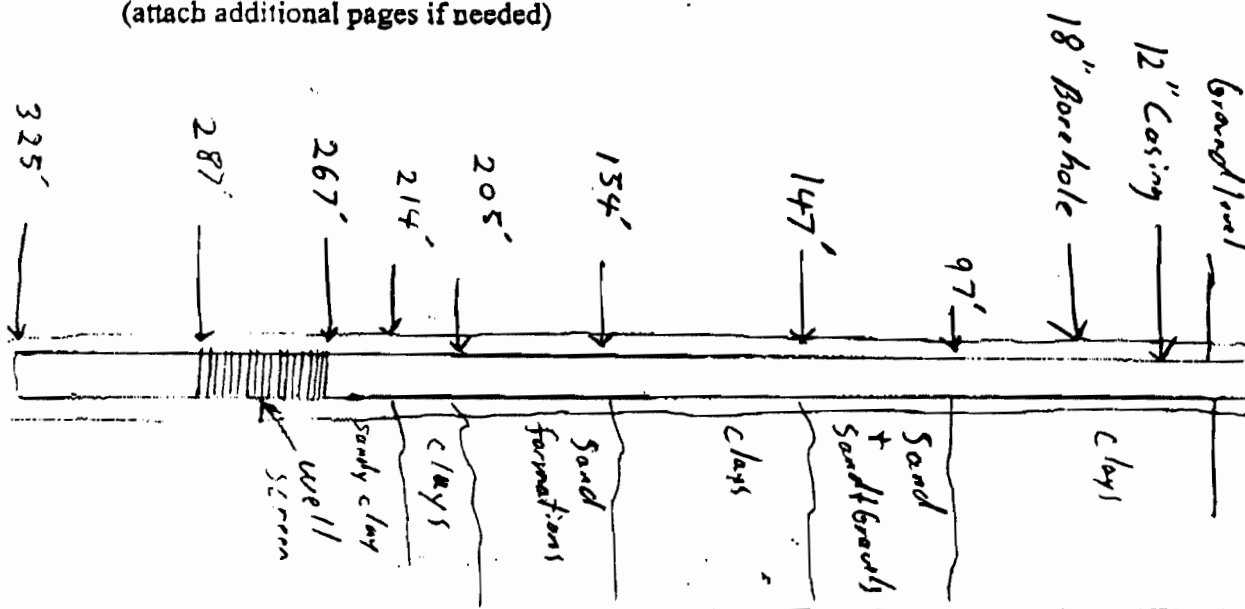

- (1) The Well Construction Standards serve to protect ground water resources. By approving and issuing this special construction standard the Oregon Water Resources Department is not representing that a well constructed in accordance with this condition will maintain structural integrity or that it meets engineering standards. The well constructor/or landowner is responsible for ensuring that a well is constructed in a manner that protects ground water resources as required under Oregon Administrative Rules 690-200 through 690-240.
- (2) If it should be determined at some future date that the well, due to its construction, is allowing ground water contamination, waste or loss of artesian pressure, the undersigned shall return to the site and rectify the problem.
- (3) If oral approval was granted, a written request must be submitted to the Department either within three (3) working days of the date of approval or prior to the completion of the associated well work. Failure to submit a written request as described above may void prior oral approval.

I have read and understand the above information. I further attest that the information provided is accurate to the best of my knowledge.

Bonded Constructor Signature: Juan P. Lujan