

RECEIVED

APR 12 1999

State of Oregon
Water Resources Department

WATER RESOURCES DEPT.
SALEM, OREGON

REQUEST FOR WRITTEN APPROVAL TO USE CONSTRUCTION METHODS NOT INCLUDED IN OREGON ADMINISTRATIVE RULES 690-200 THROUGH 690-240

Before request can be considered, the following must be answered.

Requests shall be submitted to the Well Construction Specialist, Water Resources Department, 158 12th Street NE, Salem, OR 97310. Requests may also be considered by the appropriate Regional Manager.

Date of request: 3-12-99

Bonded Well Constructor (or permitted land owner): John Hoff - Bonded Well Const. David Bird is permitted land owner

(1) Location of Well: SW 1/4 NE 1/4 of Section 15
Township 8S, Range 46E, BAKER County.

Address at well site: 45863 CORN Rd
TAX Lot 7900

(2) Name and Address of Land Owner: DAVID BIRD
RT 1 Box 265 HALF WAY OR. 97834

(3) The distance to the nearest well, septic tank or drainfield:
100 +

* (4) The unusual conditions existing at the site: Boulders

Sticky Clay have seized the outer temporary 12" casing, We were unable to pull it out!


(5) The proposed construction methods that the well constructor believes will be adequate for this well (attach additional pages if needed).

Leave 12" at 117' Seal with grout from 135 up & out of top 12" casing. This will leave an 11' Seal

in clay open annular space 117'-128' & an 18' Seal below the 12" shoe. 1050 pounds of bentonite followed 12" shoe down. Sealing outside 12" casing. The top 22' was side drilled and pumped full of grout

W-CA

(6) Start Card #: (7) Diagram showing the pertinent features of the proposed well design and construction:

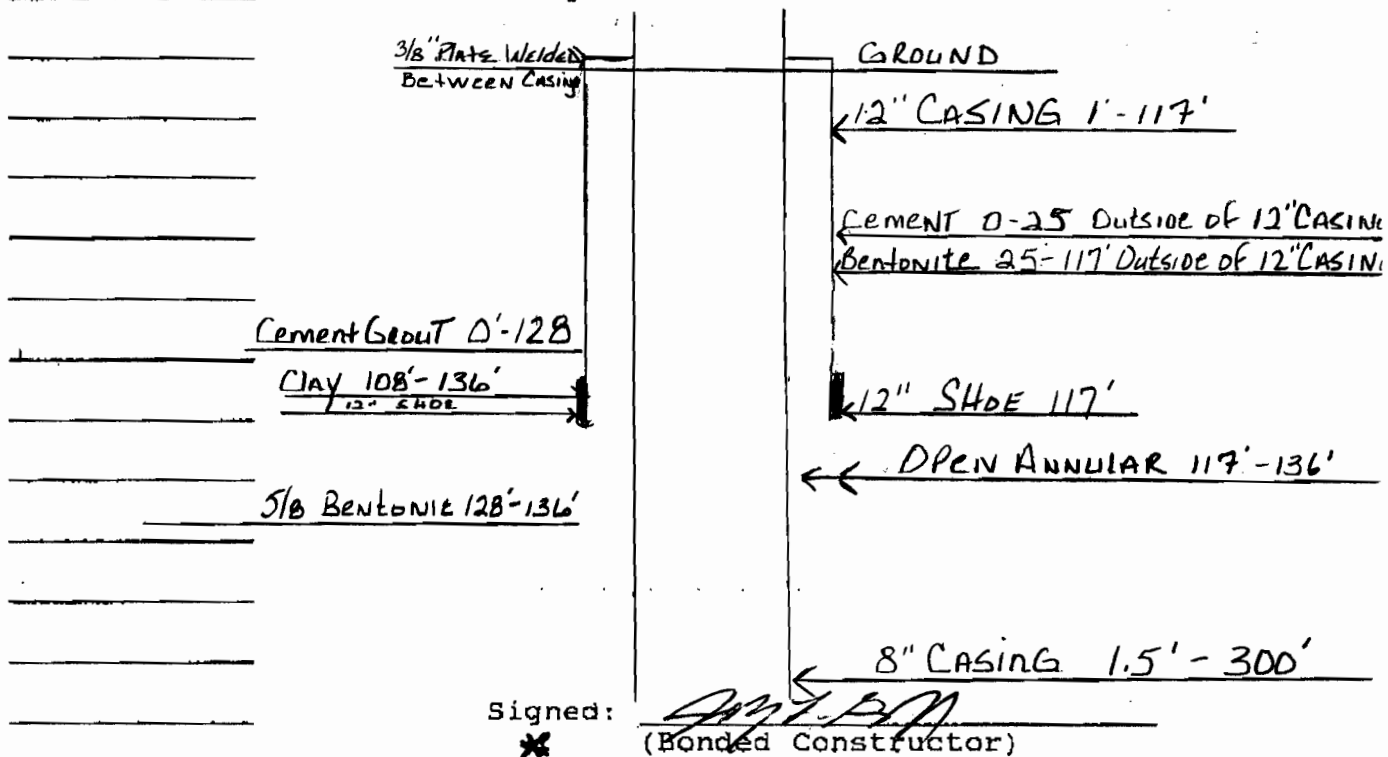

PLEASE NOTE:

- (1) If approved, all other phases of well construction must comply with the appropriate standards described in OAR 690-200 through 690-240.
- (2) If it should be determined at some future date that the well, due to its construction, is allowing groundwater contamination, waste or loss of artesian pressure, the above signed shall return to the site and rectify the problem.

For Water Resources Department Use Only

Date: 4.20.99

Approved by: [Signature]

Denied by: _____

Remarks: SC # 66425

revised 9/1/93