


OFFICE: (503) 253-3984
RESIDENCE: (503) 622-4219

PAUL M. SANDERS

MAIL ADDRESS
6936 N. E. HALSEY STREET
PORTLAND, OREGON 97213

MINIKAHDA HYDROPOWER PROJECT

Clackamas County, Oregon

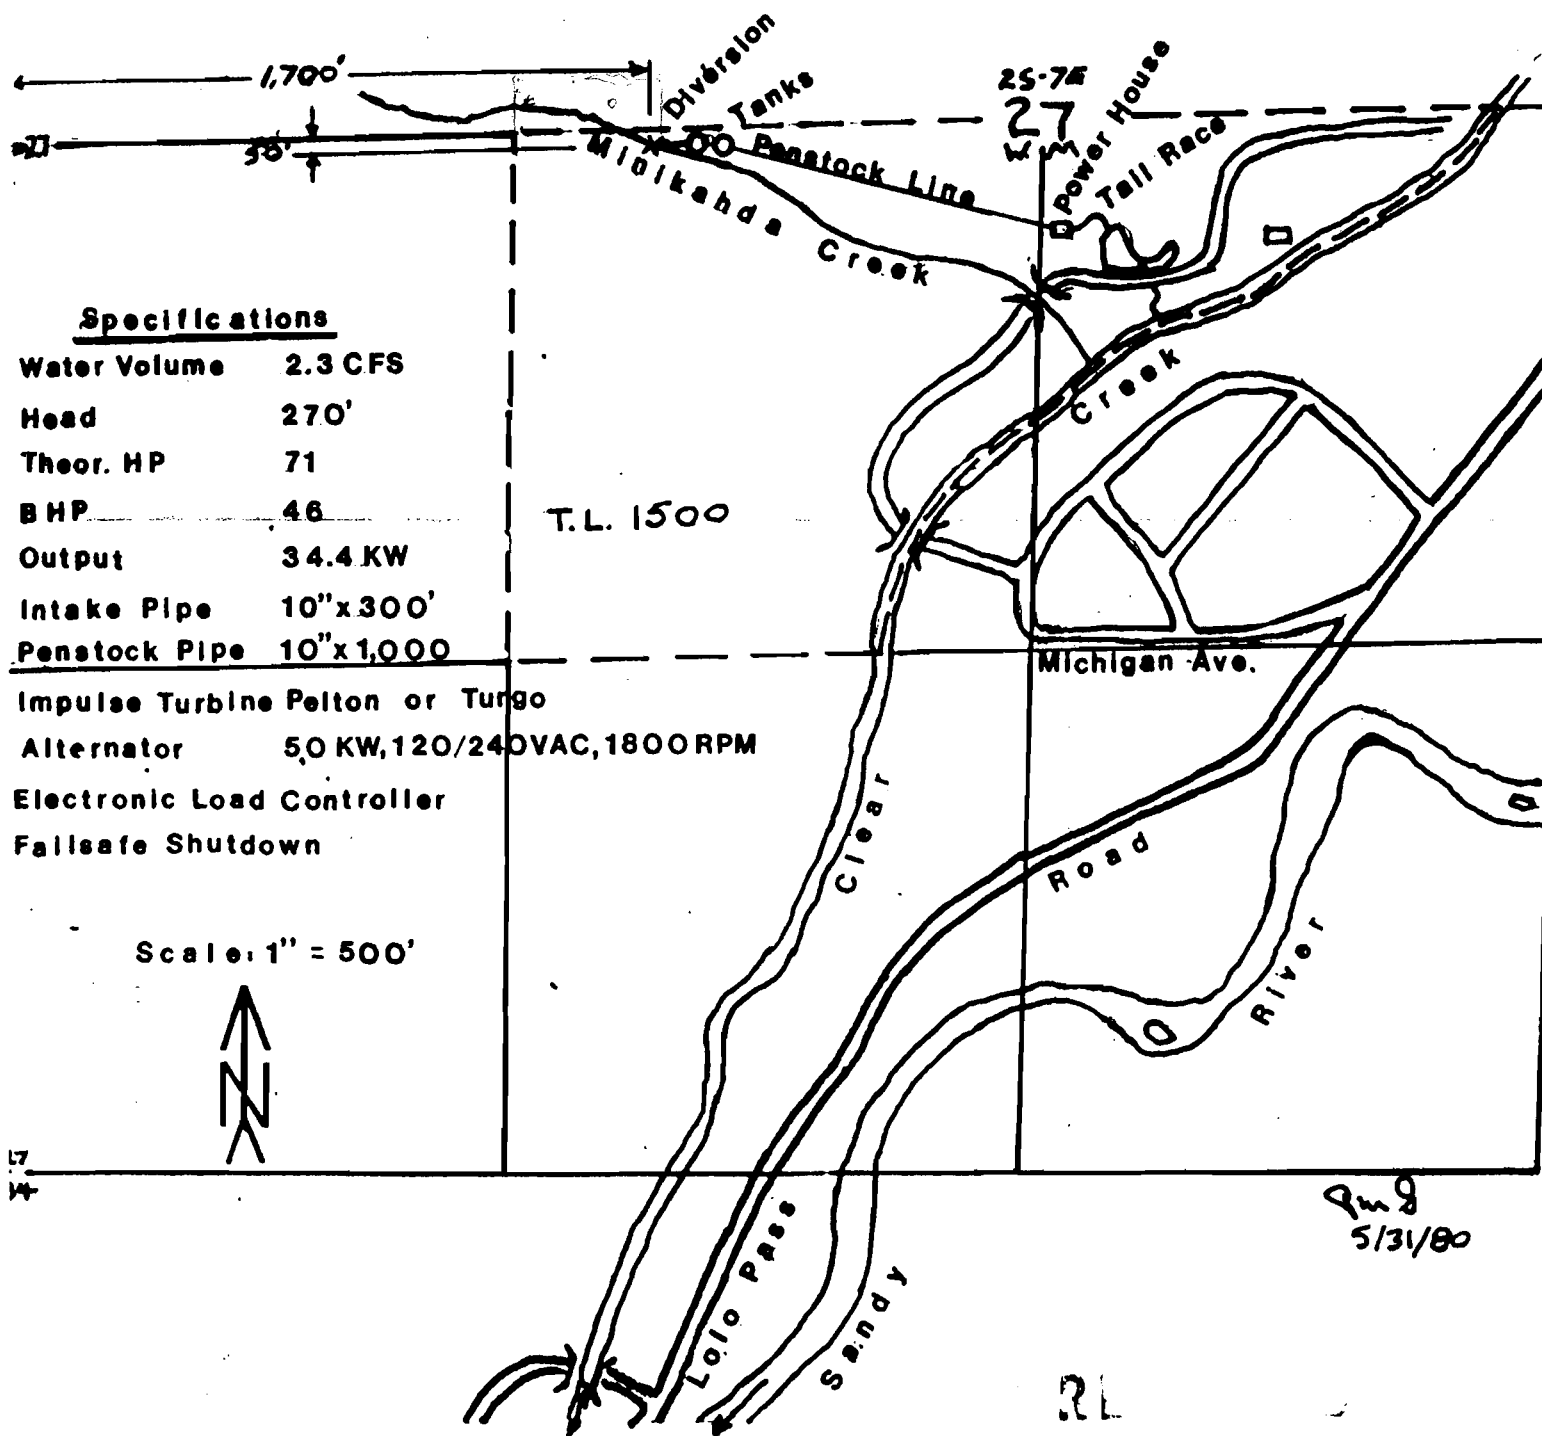

Specifications

Water Volume 2.3 CFS

Head 270'

Theor. HP 71

BHP 46

Output 34.4 KW

Intake Pipe 10"x300'

Penstock Pipe 10"x1,000

Impulse Turbine Pelton or Turgo

Alternator 50 KW, 120/240 VAC, 1800 RPM

Electronic Load Controller

Failsafe Shutdown

JUN 5 1980

WATER RESOURCES DEPT.