
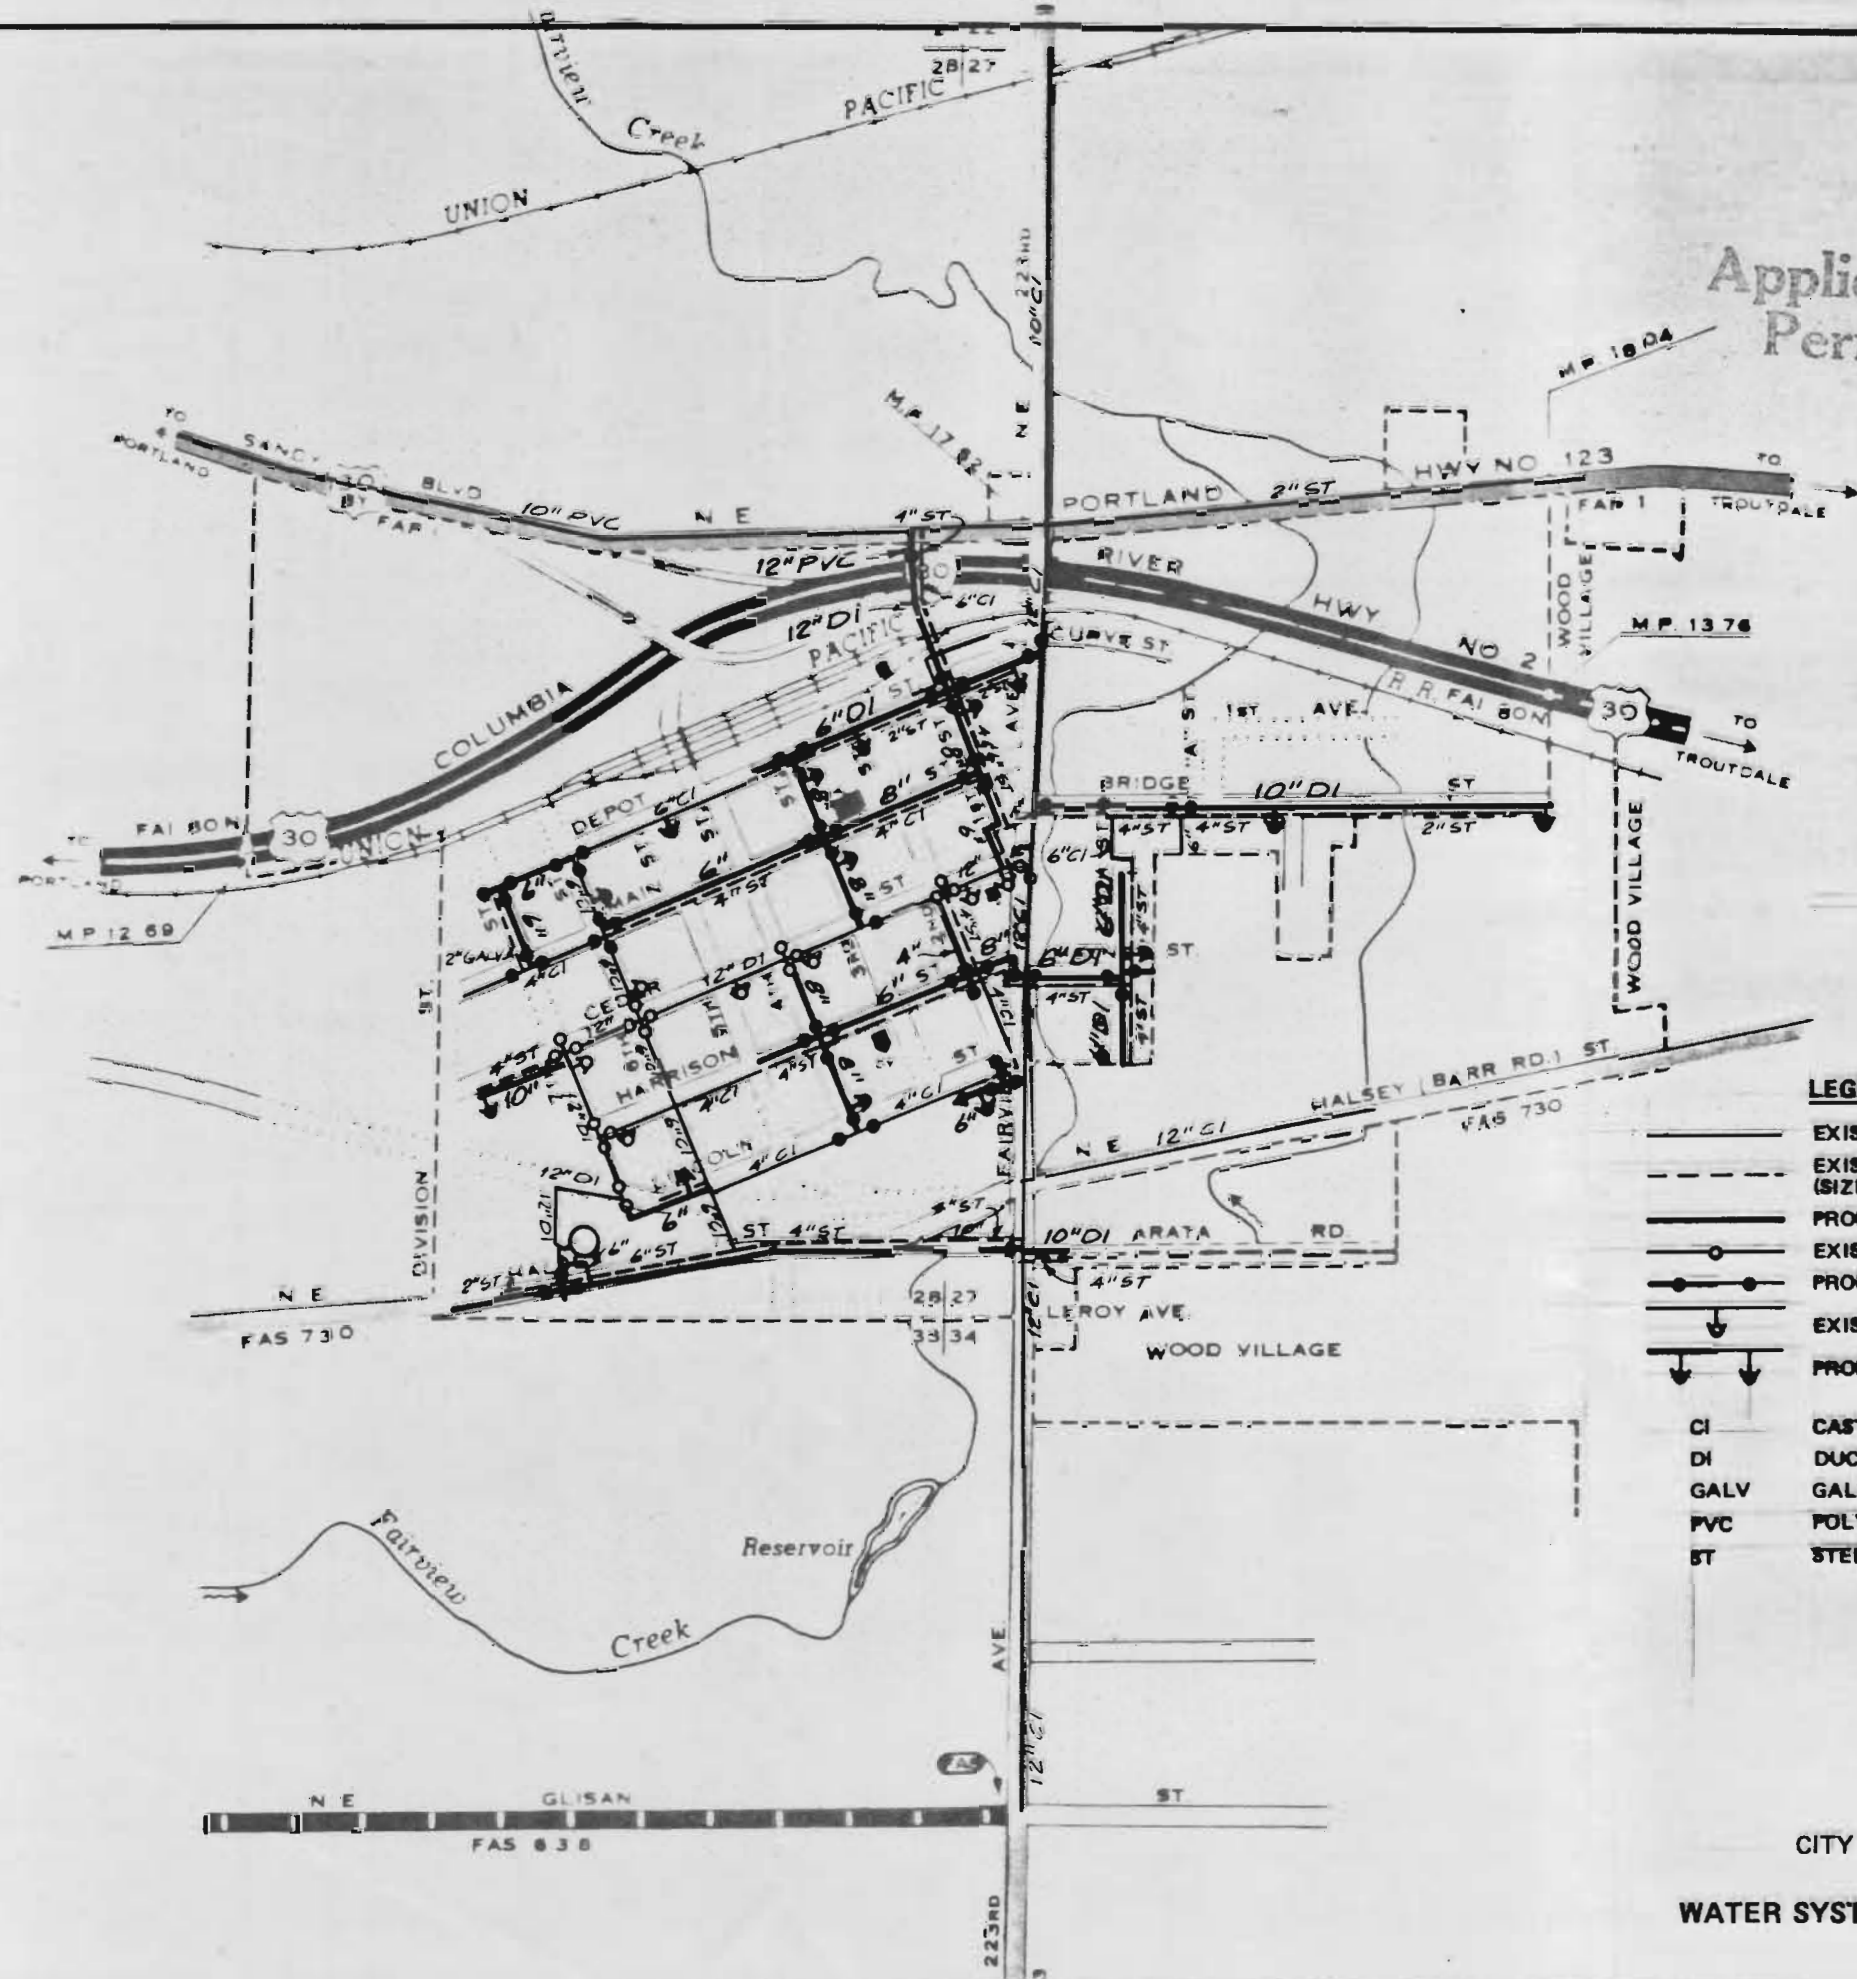



Application No. G-7563
 Permit No. G 7029



LEGEND

- EXISTING WATERLINE (SIZE INDICATED)
- EXISTING WATERLINE TO BE REPLACED (SIZE INDICATED)
- PROPOSED WATERLINE (SIZE INDICATED)
- EXISTING VALVE
- PROPOSED VALVE
- EXISTING FIRE HYDRANT
- PROPOSED FIRE HYDRANT
- CI** CAST IRON
- DI** DUCTILE IRON
- GALV** GALVANIZED
- PVC** POLY VINYL CHLORIDE
- ST** STEEL

RECEIVED

OCT 27 1976

WATER RESOURCES DEPT
SALEM, OREGON

CITY OF FAIRVIEW

WATER SYSTEM IMPROVEMENTS

