


0-7271

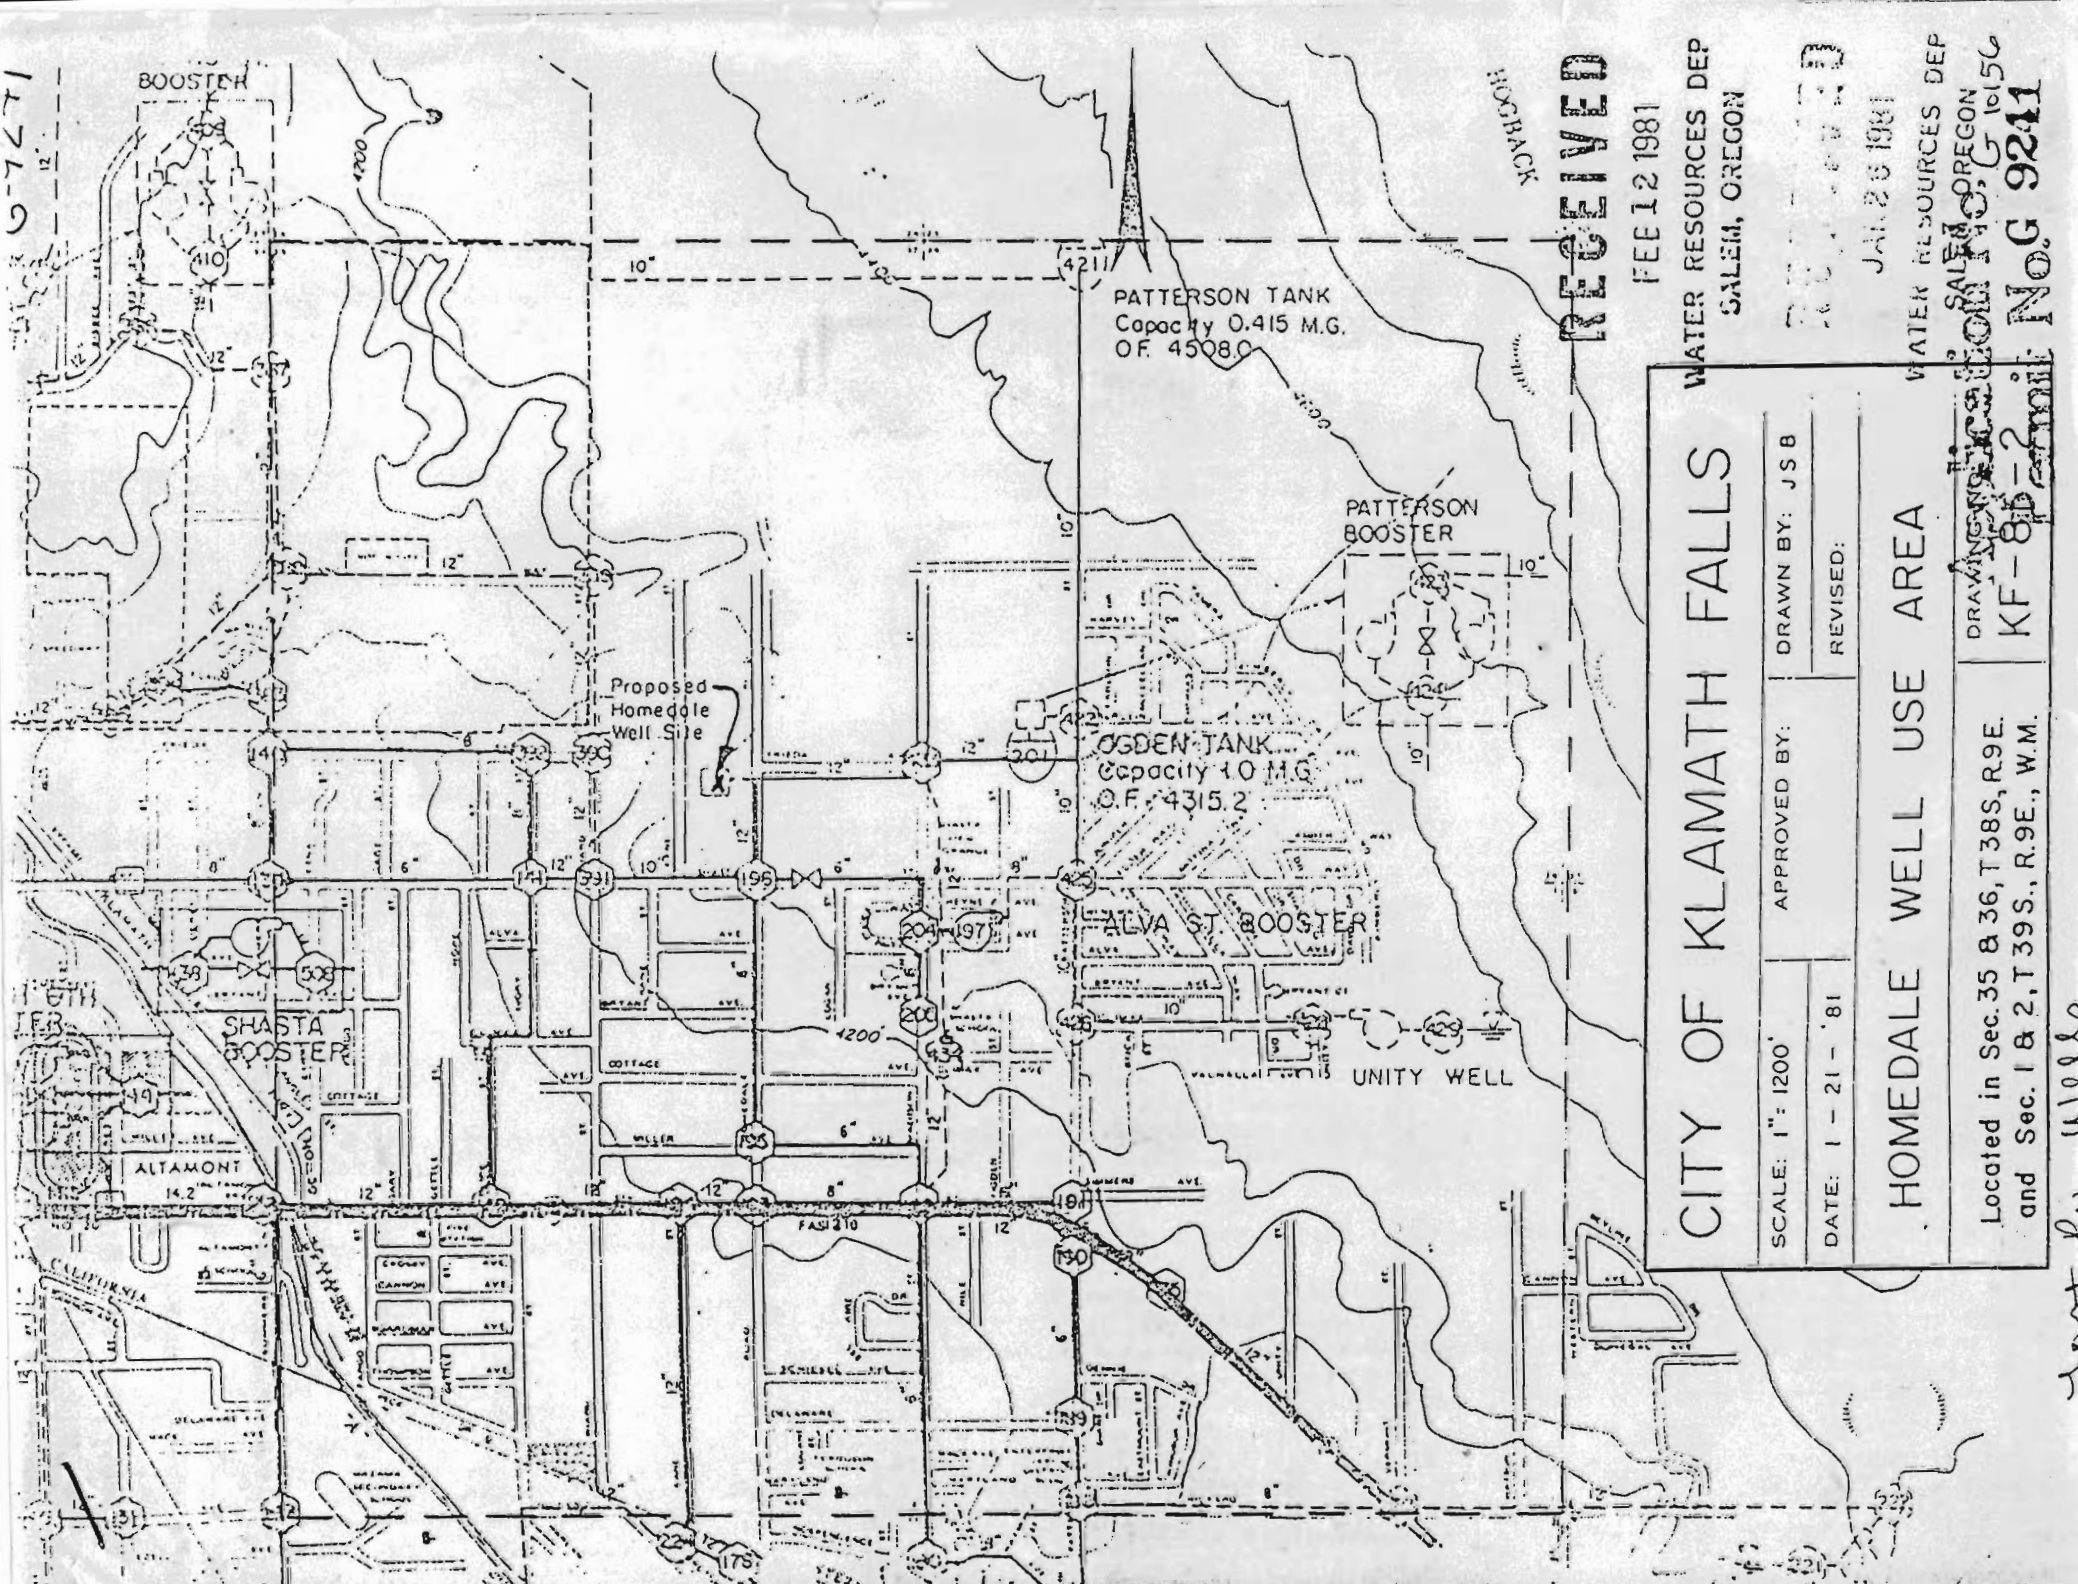

RECEIVED

FEB 12 1981

WATER RESOURCES DEP  
SALEM, OREGON

RECEIVED

JAN 26 1981

WATER RESOURCES DEP  
SALEM, OREGON

DRAWING NO. 10156  
KF-8-Admin: No. 9241

# CITY OF KLAMATH FALLS

## HOMEDALE WELL USE AREA

SCALE: 1" = 1200'	APPROVED BY:	DRAWN BY: J.S.B.
DATE: 1-21-'81		REVISED:

Located in Sec. 35 & 36, T.38S., R.9E.  
and Sec. 1 & 2, T.39S., R.9E., W.M.

PATTERSON TANK  
Capacity 0.415 M.G.  
O.F. 4508.0

PATTERSON BOOSTER

OGDEN TANK  
Capacity 1.0 M.G.  
O.F. 4315.2

ALVA ST. BOOSTER

UNITY WELL

Proposed  
Homedale  
Well Site

SHASTA BOOSTER

BOOSTER

ALTAMONT

CALIFORNIA

KLAMATH FALLS