

Application No. 53657
 Permit No. 40336


R I V E R

FLOW

T.4 N. R.25 E.

C O L U M B I A

NORMAL POOL ELEV. = 265' MSL

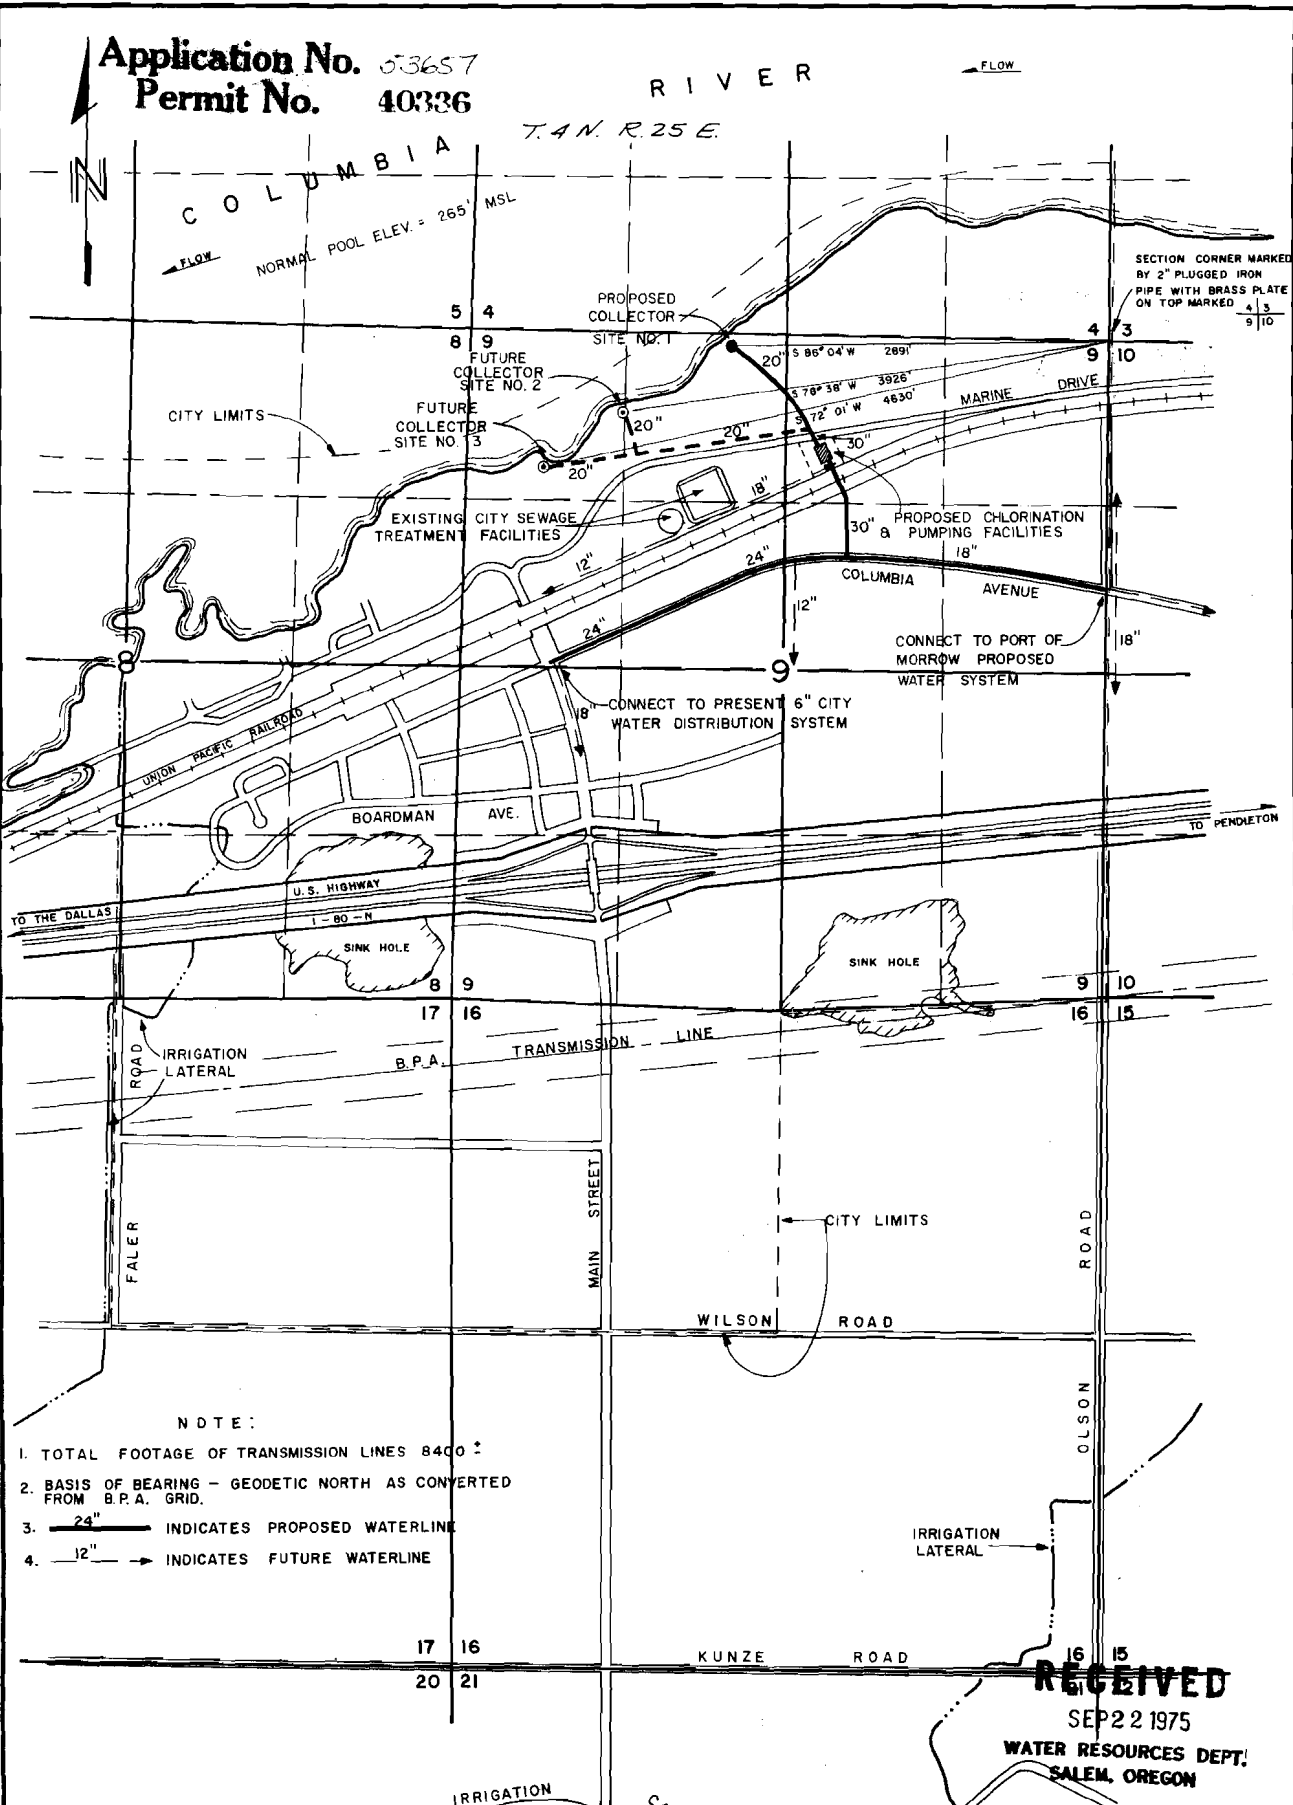

SECTION CORNER MARKED BY 2\" PLUGGED IRON PIPE WITH BRASS PLATE ON TOP MARKED 4/5 9/10

NOTE:

1. TOTAL FOOTAGE OF TRANSMISSION LINES 8400'
2. BASIS OF BEARING - GEODETIC NORTH AS CONVERTED FROM B.P.A. GRID.
3. 24" ——— INDICATES PROPOSED WATERLINE
4. 12" ——— INDICATES FUTURE WATERLINE

RECEIVED
 SEP 22 1975
 WATER RESOURCES DEPT.
 SALEM, OREGON

BOARDMAN REGIONAL WATER SUPPLY SYSTEM
WATER COLLECTOR SITES 1, 2 & 3
WALLULIS & ASSOCIATES
 ENGINEERING & PLANNING

PENDLETON	BOARDMAN	HERMISTON
SCALE: 1" = 1000'	DATE: 8/22/75	
DRN. BY: JWM	SHT. NO: EXHIBIT A	

