

T-12523

Regular

RA

T-12523

Name City of Junction City
 Attn: Gary Kaping
 Address PO Box 250
Junction City, OR 97448

DESCRIPTION OF WATER RIGHT(S)

Name of Stream A WellTrib. of Willamette R.Use MunicipalCounty Lane wn 2

Quantity of water (CFS)

No. of Acres

Name of ditch

App# G-4605 Per # G-4329 Cert # 41697 PR Date 1968

App# Per # Cert # PR Date

App# Per # Cert # PR Date

App# Per # Cert # PR Date

App# Per # Cert # PR Date

FEES PAID
 Date 11-14-16 Amount 2450.00 Receipt # 121857

Change in POU. APOA
 Date Filed Nov. 14, 2016

Initial notice date 11/29/16

DPD issued date

PD issued date 12-4-17PD notice date 12-12-17

Date of FO Vol Page

FEES REFUNDED
 Date Amount Receipt #

C-Date

COBU due date

COBU Received date

Certificate issued 11/21/2025 98763

Assignments:

Irrigation District

Agent Steven Bruce - Skookum Water Associates Inc.
1626 Victorian Way, Eugene, OR 97401

CWRE
 CC list City of Junction City Planning & Building Dept.
PO Box 250, Junction City, OR 97448

☐ - Oversized map - Location

COBU MAP #

2050 (File Cabinet A-5)

**STATE OF OREGON
WATER RESOURCES DEPARTMENT**

RECEIPT # **122038**

725 Summer St. N.E. Ste. A
SALEM, OR 97301-4172
(503) 986-0900 / (503) 986-0904 (fax)

INVOICE # _____

RECEIVED FROM: City of Junction
BY: City

APPLICATION	
PERMIT	
TRANSFER	T-12523

CASH: ☐ CHECK: # 81987 OTHER: (IDENTIFY) ☐

TOTAL REC'D \$ 1,200.00

1083 TREASURY 4170 WRD MISC CASH ACCT

0407 COPIES	<u>47124</u>	<u>R-1115317</u>	\$
<u>6408</u> OTHER:	(IDENTIFY) <u>Reimbursement</u>		\$ <u>1,200.00</u>
		<u>Authority</u>	

0243 I/S Lease _____ 0244 Muni Water Mgmt. Plan _____ 0245 Cons. Water _____

4270 WRD OPERATING ACCT

MISCELLANEOUS

0407 COPY & TAPE FEES	\$
0410 RESEARCH FEES	\$
0408 MISC REVENUE: (IDENTIFY) _____	\$
TC162 DEPOSIT LIAB. (IDENTIFY) _____	\$
0240 EXTENSION OF TIME	\$

WATER RIGHTS:

0201 SURFACE WATER	EXAM FEE \$	0202 \$
0203 GROUND WATER	EXAM FEE \$	0204 \$
0205 TRANSFER	EXAM FEE \$	

WELL CONSTRUCTION

0218 WELL DRILL CONSTRUCTOR	EXAM FEE \$	0219 \$
LANDOWNER'S PERMIT		0220 \$

OTHER (IDENTIFY) _____

0536 TREASURY 0437 WELL CONST. START FEE

0211 WELL CONST START FEE	\$	CARD #
0210 MONITORING WELLS	\$	CARD # <u>6</u>
OTHER (IDENTIFY) _____		

0607 TREASURY 0467 HYDRO ACTIVITY LIC NUMBER

0233 POWER LICENSE FEE (FW/WRD)	\$
0231 HYDRO LICENSE FEE (FW/WRD)	\$
HYDRO APPLICATION	\$

TREASURY OTHER / RDX

FUND _____ TITLE _____
OBJ. CODE _____ VENDOR # _____
DESCRIPTION _____ \$ _____

RECEIPT: **122038**

DATED: 12-5-10 BY: Felicia B

**STATE OF OREGON
WATER RESOURCES DEPARTMENT**

RECEIPT # **121857**

725 Summer St. N.E. Ste. A
SALEM, OR 97301-4172
(503) 986-0900 / (503) 986-0904 (fax)

INVOICE # _____

RECEIVED FROM: City of Junction
BY: city

APPLICATION	T-12523
PERMIT	
TRANSFER	

CASH: ☐ CHECK: # 81911 OTHER: (IDENTIFY) ☐

TOTAL REC'D \$ **2575.00**

1083 TREASURY 4170 WRD MISC CASH ACCT

0407 COPIES 47124 R-1115317 \$
0408 OTHER: (IDENTIFY) Reimbursement \$ **125.00**
Authority

0243 I/S Lease _____ 0244 Muni Water Mgmt. Plan _____ 0245 Cons. Water _____

4270 WRD OPERATING ACCT

MISCELLANEOUS

0407 COPY & TAPE FEES \$
0410 RESEARCH FEES \$
0408 MISC REVENUE: (IDENTIFY) \$
TC162 DEPOSIT LIAB. (IDENTIFY) \$
0240 EXTENSION OF TIME \$

WATER RIGHTS:

	EXAM FEE		RECORD FEE
0201 SURFACE WATER	\$	0202	\$
0203 GROUND WATER	\$	0204	\$
0205 TRANSFER	\$ 2450.00		

WELL CONSTRUCTION

	EXAM FEE		LICENSE FEE
0218 WELL DRILL CONSTRUCTOR	\$	0219	\$
LANDOWNER'S PERMIT		0220	\$

OTHER (IDENTIFY) _____

0536 TREASURY 0437 WELL CONST. START FEE

0211 WELL CONST START FEE	\$	CARD #	
0210 MONITORING WELLS	\$	CARD #	

OTHER (IDENTIFY) _____

0607 TREASURY 0467 HYDRO ACTIVITY LIC NUMBER

0233 POWER LICENSE FEE (FW/WRD)		\$
0231 HYDRO LICENSE FEE (FW/WRD)		\$
HYDRO APPLICATION		\$

TREASURY OTHER / RDX

FUND _____ TITLE _____

OBJ. CODE _____ VENDOR # _____

DESCRIPTION _____ \$ _____

RECEIPT: **121857**

DATED: 11/14/16

BY: Felicia D

Mailing List for Final Transfer Certificate(s)

Transfer Application: T-12523

Certificate: 98763 (C-41697)

Certificate/Transfer Holder: (include copy of map)

CITY OF JUNCTION CITY

ATTN: GARY KAPING

PO BOX 250

JUNCTION CITY, OR 97448

Is the Transfer Holder(s) of record currently identified as a landowner of any tax lots involved as confirmed by the County records? YES

Copies of Final Transfer Certificate(s) to be sent to:

1. Watermaster District #: 2 (auto email)
2. File
3. Vault

Other persons to receive copies: (include map):

Record Marking(s):

1. Original Application# G-4605
2. Old Certificate# 41697

Copies Mailed	
by:	 (STAFF)
on:	<u>11/21/2015</u> (DATE)



Oregon

Tina Kotek, Governor

Water Resources Department
North Mall Office Building
725 Summer Street NE, Suite A
Salem, OR 97301
Phone: 503-986-0900
Fax: 503-986-0904
www.Oregon.gov/OWRD

Date Mailed: NOV 21 2025

NOTICE OF CERTIFICATE ISSUANCE

Attached is a certificate that confirms the water rights established under the terms of a transfer order issued by this Department.

This certificate is an order in order than a contested case. This order is subject to judicial review under ORS 183.482. Any petition for judicial review must be filed within the 60-day time period specified by ORS 183.482. Pursuant to ORS 183.482, ORS 536.075 and OAR 137-003-0675, you may petition for judicial review and petition the Director for reconsideration of this order. A petition for reconsideration may be granted or denied by the Director, and if no action is taken within 60 days following the date the petition was filed, the petition shall be deemed denied.

This statement of judicial review rights is required under ORS 536.075 it does not alter or add to existing review rights or create review rights that are not otherwise provided by law.

The water must be controlled and not wasted. To change the location of the point of diversion, the character of use, or the location of use requires the advance approval of the Water Resources Director.

If you have any questions please contact Jonnine Skaug at 503-979-3943.

STATE OF OREGON

COUNTY OF LANE

CERTIFICATE OF WATER RIGHT

THIS CERTIFICATE ISSUED TO

CITY OF JUNCTION CITY
 ATTN: GARY KAPING
 PO BOX 250
 JUNCTION CITY OR 97448

confirms the right to the use of water perfected under the terms of Permit G-4329. The amount of water used to which this right is entitled is limited to the amount used beneficially, and shall not exceed the amount specified, or its equivalent in the case of rotation, measured at the well(s). The specific limits and conditions of the use are listed below.

SOURCE OF WATER: A WELL, A TRIBUTARY OF WILLAMETTE RIVER BASIN

PURPOSE OR USE: MUNICIPAL

MAXIMUM RATE: 1.11 CUBIC FEET PER SECOND

DATE OF PRIORITY: SEPTEMBER 20, 1968

The wells are located as follows:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	ORIGINAL WELL - 915 FEET NORTH AND 595 FEET EAST FROM SW CORNER, NESW, SECTION 32
15 S	4 W	WM	32	SE NW	ADDITIONAL WELL - 3140 FEET NORTH AND 2930 FEET WEST FROM SE CORNER, SECTION 32

A description of the place of use is as follows:

Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	29	NW SE
15 S	4 W	WM	31	NE NE
15 S	4 W	WM	31	NW NE
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE NW
15 S	4 W	WM	31	NW NW
15 S	4 W	WM	31	SW NW
15 S	4 W	WM	31	SE NW

NOTICE OF RIGHT TO PETITION FOR RECONSIDERATION OR JUDICIAL REVIEW

This is an order in other than a contested case. This order is subject to judicial review under ORS 183.482. Any petition for judicial review must be filed within the 60-day time period specified by ORS 183.482. Pursuant to ORS 183.482, ORS 536.075 and OAR 137-003-0675, you may petition for judicial review and petition the Director for reconsideration of this order. A petition for reconsideration may be granted or denied by the Director, and if no action is taken within 60 days following the date the petition was filed, the petition shall be deemed denied.

Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	31	NE SW
15 S	4 W	WM	31	NW SW
15 S	4 W	WM	31	SW SW
15 S	4 W	WM	31	SE SW
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
15 S	5 W	WM	36	NE NE
15 S	5 W	WM	36	NW NE
15 S	5 W	WM	36	SW NE
15 S	5 W	WM	36	SE NE
15 S	5 W	WM	36	NE SE
15 S	5 W	WM	36	NW SE
15 S	5 W	WM	36	SW SE
15 S	5 W	WM	36	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	SW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW
16 S	4 W	WM	5	SE NW
16 S	4 W	WM	5	NE SW
16 S	4 W	WM	5	NW SW
16 S	4 W	WM	5	SW SW
16 S	4 W	WM	5	SE SW
16 S	4 W	WM	5	NW SE
16 S	4 W	WM	6	NE NE
16 S	4 W	WM	6	NW NE
16 S	4 W	WM	6	SE NE
16 S	4 W	WM	8	NE NW
16 S	4 W	WM	8	NW NW
16 S	4 W	WM	8	SE NW
16 S	4 W	WM	8	NE SW
16 S	4 W	WM	8	SE SW
16 S	4 W	WM	17	SW NE
16 S	4 W	WM	17	NE NW
16 S	4 W	WM	17	SE NW

Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	17	NE SW
16 S	4 W	WM	17	SE SW
16 S	4 W	WM	17	NW SE
16 S	4 W	WM	17	SW SE
16 S	4 W	WM	20	NE NE
16 S	4 W	WM	20	NW NE
16 S	4 W	WM	20	SW NE
16 S	4 W	WM	20	SE NE
16 S	4 W	WM	20	NE NW
16 S	4 W	WM	20	SE NW
16 S	4 W	WM	20	NE SW
16 S	4 W	WM	20	SE SW
16 S	4 W	WM	20	NE SE
16 S	4 W	WM	20	NW SE
16 S	4 W	WM	20	SW SE
16 S	4 W	WM	20	SE SE
16 S	4 W	WM	21	SW SW
16 S	4 W	WM	29	NW NE
16 S	4 W	WM	29	SW NE
16 S	4 W	WM	29	NE NW
16 S	4 W	WM	29	SE NW


The quantity of water diverted at the additional point of appropriation, together with that diverted at the original point of appropriation, shall not exceed the quantity of water lawfully available at the original point of appropriation.

Water shall be acquired from the same aquifer (water source) as the original point of appropriation.

The right to the use of the water for the purposes aforesaid is restricted to the lands or place of use herein described.


This certificate is issued to confirm a change in PLACE OF USE and AN ADDITIONAL POINT OF APPROPRIATION approved by an order of the Water Resources Director entered January 19, 2018, at Special Order Volume 107, Page 473, approving Transfer Application T-12523, and together with Certificate 93565, supercedes Certificate 41697, State record of Water Right Certificates.

Issued **NOV 21 2025**




Katherine Ratcliffe
Water Right Services Division Administrator, for
Ivan Gall, Director
Oregon Water Resources Department

COPY

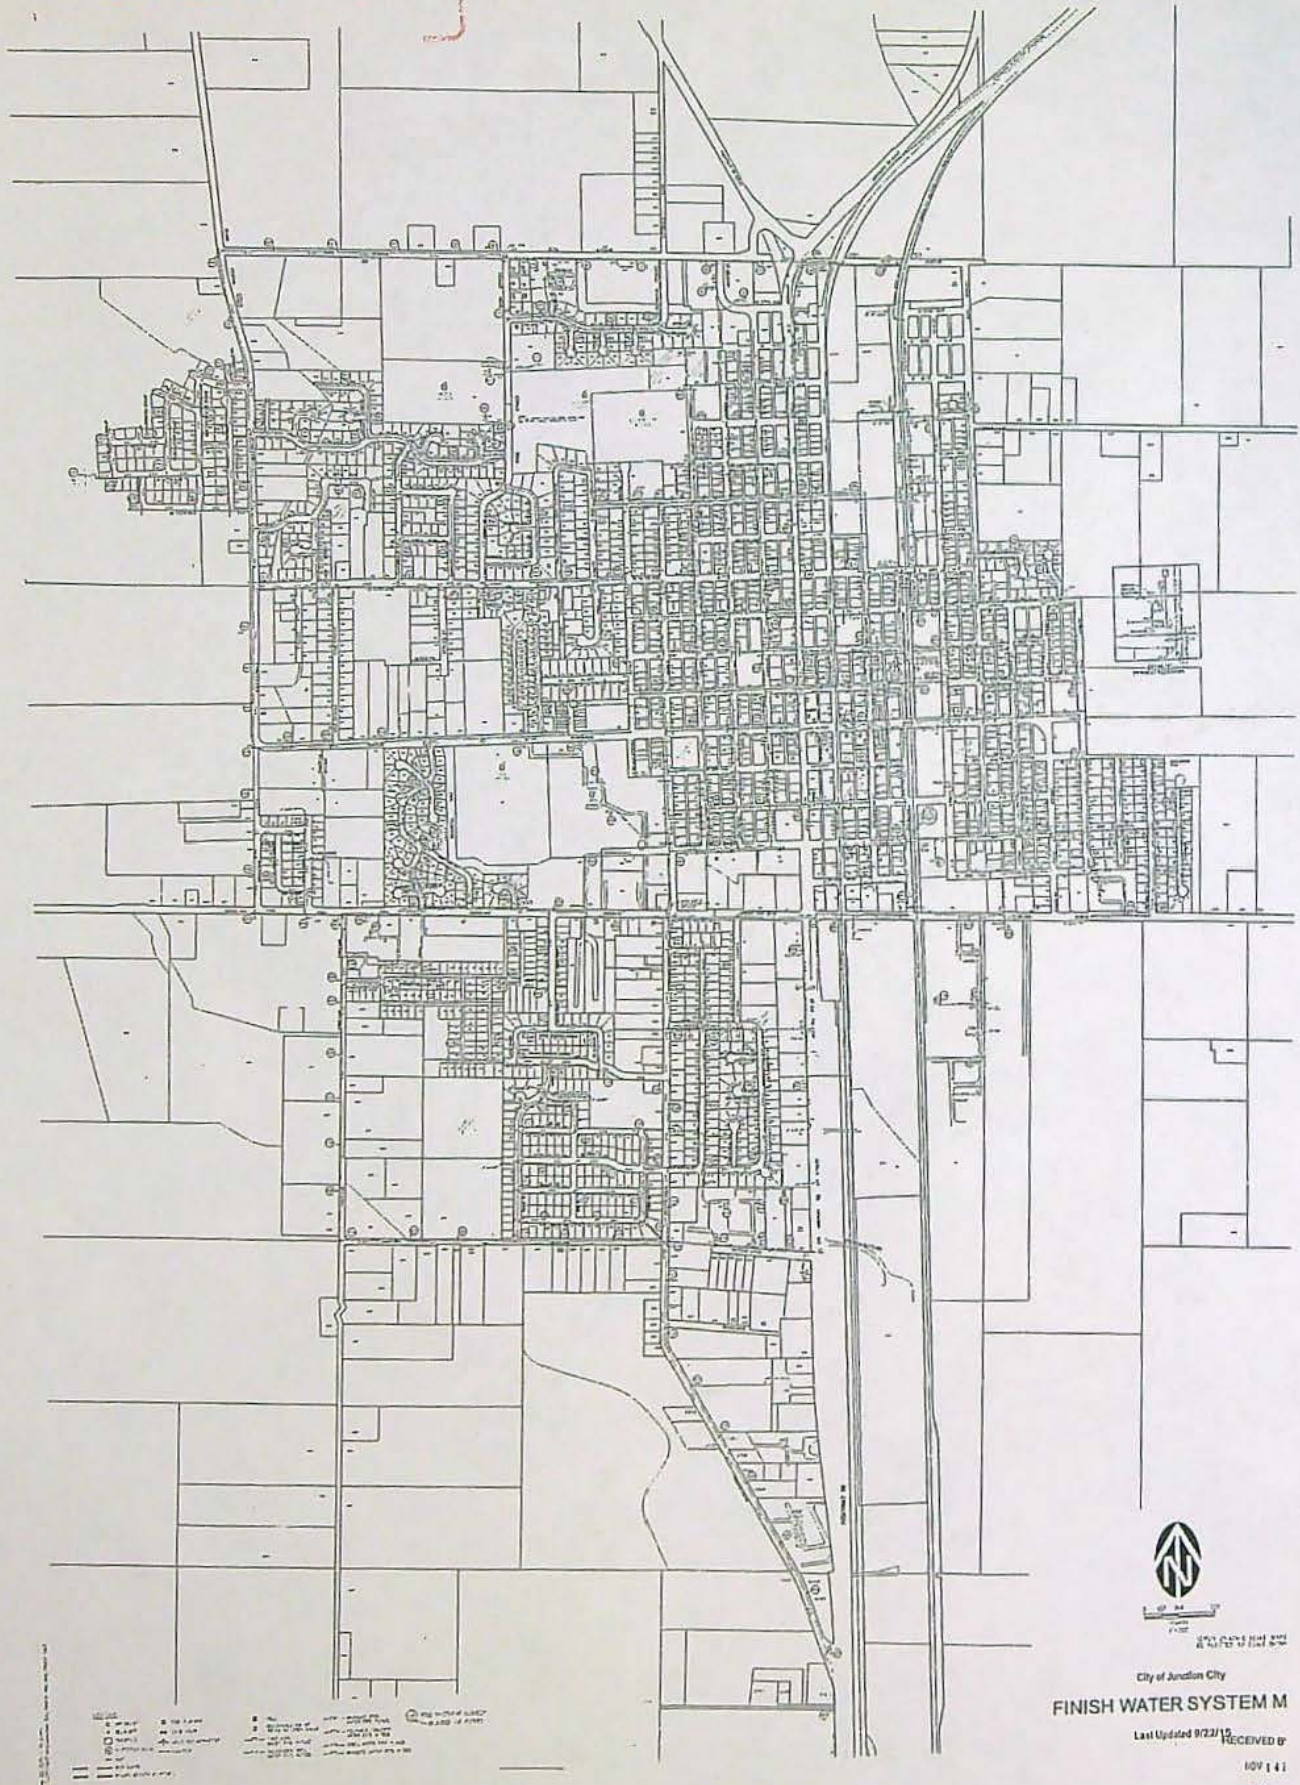

COPY

TRANSFER APPLICATION MAP
 Certificate 41697
 Sections 29, 30, 31 & 32, T15S, R5W, W.M., and
 Section 36, T15S, R5W, W.M., and
 Sections 5, 6, 8, 17, 20, 21 & 29, T16S, R4W, W.M., Lane County
 City of Junction City

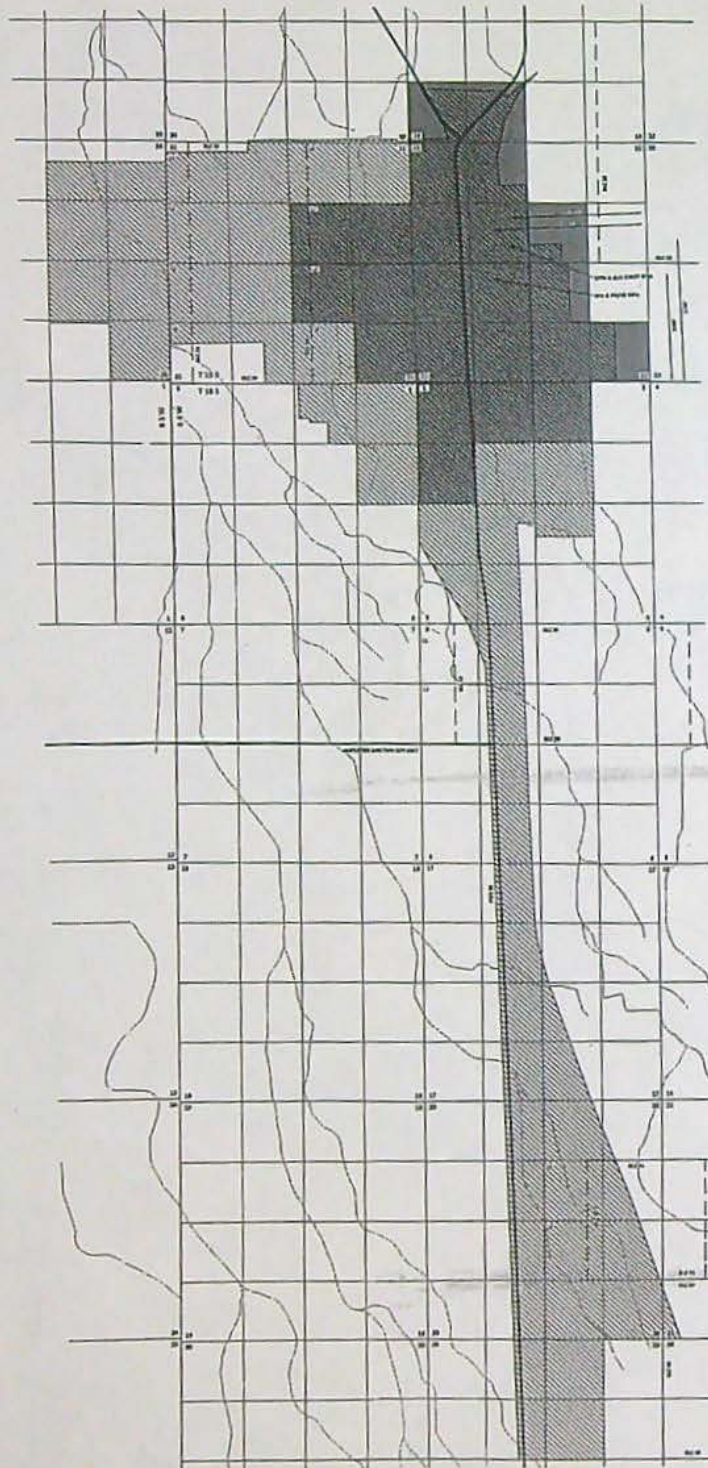

EXPLANATION

AUTHORIZED LANDS	EXPOSED LANDS
- Section 29, 30, 31 & 32, T15S, R5W, W.M. - Section 36, T15S, R5W, W.M. - Sections 5, 6, 8, 17, 20, 21 & 29, T16S, R4W, W.M.	- Section 36, T15S, R5W, W.M. - Sections 5, 6, 8, 17, 20, 21 & 29, T16S, R4W, W.M.

Point of Section Line

NOTE:
 1. The authorized lands are based on the survey and are subject to the provisions of the Oregon Revised Statutes.
 2. The actual section lines are shown as a separate map.



RECEIVED BY ON
 M/TN 1 & 276
 SALEM, OR



This map is not intended to provide legal
 description or location of property
 according to the

FIGURE 1

Mailing List for Proposed Transfer Certificate(s)

Transfer Application: T-12523

Certificate: ⁹⁸⁷⁶³***** (C-41697) JLS

Certificate/Transfer Holder: (include copy of map)

CITY OF JUNCTION CITY

ATTN: GARY KAPING

PO BOX 250

JUNCTION CITY, OR 97448

Is the Transfer Holder(s) of record currently identified as a landowner of any tax lots involved as confirmed by the County records? YES

Copies of Proposed Transfer Certificate(s) to be sent to:

1. Watermaster District #: 2
2. File

Other persons to receive copies: (include map):

Record Marking(s):

1. Original Application# G-4605
2. Old Certificate# 41697

Copies Mailed

by: TM
(STAFF)

on: AUG 15 2025
(DATE)



Oregon

Tina Kotek, Governor

Water Resources Department

725 Summer St NE, Suite A

Salem, OR 97301

(503) 986-0900

www.oregon.gov/owrd

Date Mailed: AUG 15 2025

Reference: Transfer T-12523

Enclosed is a proposed certificate of water right and map. The proposed certificate represents the extent water was used within the terms of an order approving the transfer based upon a Claim of Beneficial Use, prepared by a Certified Water Right Examiner, that either you or a previous transfer holder submitted.

The certificate is the final step in the water right process. The Department encourages you to review this proposal. If you do not agree with the proposed certificate, Oregon Administrative Rule 690-330-010 (2) allows the transferee or landowner 60 days from the mailing date of this notice to request the Department to reconsider the contents of the proposed certificate.

If you do not agree with the proposed certificate, Oregon Administrative Rule 690-380-6040 allows the transferee or landowner 60 days from the mailing date of this notice to request the Department to reconsider the contents of the proposed certificate.

If your name is not listed on the proposed certificate, and you are the current landowner, and would like to have the final certificate issued in your name, you may apply through the Department to have the transfer assigned to you. If you have any questions about the assignment process, please contact Mary Bjork at 503-979-9895.

If you agree with the proposed certificate and map no response to this notice is required. Sometime after the 60 day period, a recommendation will be made to the Director to issue a certificate, and if the Director signs the certificate, the recorded certificate of water right will be mailed to you.

If you have any questions please contact Jonnine Skaug at 503-979-3943.

Sincerely,

Katherine Ratcliffe
Administrator Water Right Services

STATE OF OREGON

COUNTY OF LANE

CERTIFICATE OF WATER RIGHT

THIS CERTIFICATE ISSUED TO

CITY OF JUNCTION CITY
 ATTN: GARY KAPING
 PO BOX 250
 JUNCTION CITY OR 97448

confirms the right to the use of water perfected under the terms of Permit G-4329. The amount of water used to which this right is entitled is limited to the amount used beneficially, and shall not exceed the amount specified, or its equivalent in the case of rotation, measured at the well(s). The specific limits and conditions of the use are listed below.

SOURCE OF WATER: A WELL, A TRIBUTARY OF WILLAMETTE RIVER BASIN

PURPOSE OR USE: MUNICIPAL

MAXIMUM RATE: 1.11 CUBIC FEET PER SECOND

DATE OF PRIORITY: SEPTEMBER 20, 1968

The wells are located as follows:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	ORIGINAL WELL - 915 FEET NORTH AND 595 FEET EAST FROM SW CORNER, NESW, SECTION 32
15 S	4 W	WM	32	SE NW	ADDITIONAL WELL - 3140 FEET NORTH AND 2930 FEET WEST FROM SE CORNER, SECTION 32

A description of the place of use is as follows:

Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	29	NW SE
15 S	4 W	WM	31	NE NE
15 S	4 W	WM	31	NW NE
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE NW
15 S	4 W	WM	31	NW NW
15 S	4 W	WM	31	SW NW
15 S	4 W	WM	31	SE NW

NOTICE OF RIGHT TO PETITION FOR RECONSIDERATION OR JUDICIAL REVIEW

This is an order in other than a contested case. This order is subject to judicial review under ORS 183.482. Any petition for judicial review must be filed within the 60-day time period specified by ORS 183.482. Pursuant to ORS 183.482, ORS 536.075 and OAR 137-003-0675, you may petition for judicial review and petition the Director for reconsideration of this order. A petition for reconsideration may be granted or denied by the Director, and if no action is taken within 60 days following the date the petition was filed, the petition shall be deemed denied.

Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	31	NE SW
15 S	4 W	WM	31	NW SW
15 S	4 W	WM	31	SW SW
15 S	4 W	WM	31	SE SW
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
15 S	5 W	WM	36	NE NE
15 S	5 W	WM	36	NW NE
15 S	5 W	WM	36	SW NE
15 S	5 W	WM	36	SE NE
15 S	5 W	WM	36	NE SE
15 S	5 W	WM	36	NW SE
15 S	5 W	WM	36	SW SE
15 S	5 W	WM	36	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	SW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW
16 S	4 W	WM	5	SE NW
16 S	4 W	WM	5	NE SW
16 S	4 W	WM	5	NW SW
16 S	4 W	WM	5	SW SW
16 S	4 W	WM	5	SE SW
16 S	4 W	WM	5	NW SE
16 S	4 W	WM	6	NE NE
16 S	4 W	WM	6	NW NE
16 S	4 W	WM	6	SE NE
16 S	4 W	WM	8	NE NW
16 S	4 W	WM	8	NW NW
16 S	4 W	WM	8	SE NW
16 S	4 W	WM	8	NE SW
16 S	4 W	WM	8	SE SW
16 S	4 W	WM	17	SW NE
16 S	4 W	WM	17	NE NW
16 S	4 W	WM	17	SE NW

Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	17	NE SW
16 S	4 W	WM	17	SE SW
16 S	4 W	WM	17	NW SE
16 S	4 W	WM	17	SW SE
16 S	4 W	WM	20	NE NE
16 S	4 W	WM	20	NW NE
16 S	4 W	WM	20	SW NE
16 S	4 W	WM	20	SE NE
16 S	4 W	WM	20	NE NW
16 S	4 W	WM	20	SE NW
16 S	4 W	WM	20	NE SW
16 S	4 W	WM	20	SE SW
16 S	4 W	WM	20	NE SE
16 S	4 W	WM	20	NW SE
16 S	4 W	WM	20	SW SE
16 S	4 W	WM	20	SE SE
16 S	4 W	WM	21	SW SW
16 S	4 W	WM	29	NW NE
16 S	4 W	WM	29	SW NE
16 S	4 W	WM	29	NE NW
16 S	4 W	WM	29	SE NW

The quantity of water diverted at the additional point of appropriation, together with that diverted at the original point of appropriation, shall not exceed the quantity of water lawfully available at the original point of appropriation.

Water shall be acquired from the same aquifer (water source) as the original point of appropriation.

The right to the use of the water for the purposes aforesaid is restricted to the lands or place of use herein described.

This certificate is issued to confirm a change in PLACE OF USE and AN ADDITIONAL POINT OF APPROPRIATION approved by an order of the Water Resources Director entered January 19, 2018, at Special Order Volume 107, Page 473, approving Transfer Application T-12523, and together with Certificate 93565, supercedes Certificate 41697, State record of Water Right Certificates.

Issued _____

PROPOSED
Katherine Ratcliffe
Water Right Services Division Administrator, for
Ivan Gall, Director
Oregon Water Resources Department

TRANSFER

Memo- Proof to Satisfaction

Transfer App # <u>7-12523</u>	
WRD Reviewer (CW) <u>J Skaus</u>	Date: <u>July 2025</u>
WRD Peer Reviewer (PR) <u>holmes</u>	Date: <u>Aug 25</u>

ORIGINAL CERT:	CHANGE REQUESTED:	RR Cert:
<u>41697</u>	☒ POU ☐ POD/POA ☒ APOD/APOA ☐ USE ☐ POU ☐ POD/POA ☐ APOD/APOA ☐ USE ☐ POU ☐ POD/POA ☐ APOD/APOA ☐ USE ☐ POU ☐ POD/POA ☐ APOD/APOA ☐ USE	<u>93565</u>

App #
G-4605

PREPARATION:

CW	PR	RESEARCH:
☒	☐	☐ CBU Report/Map ☒ Transfer Order <u>SPov 107</u> Ord Vol <u>Pg 473</u> Issued Date <u>1/19/18</u> ☐ Assignment ☐ Transfer Extension
☐	☐	Electronic Folder: ☒ Create CBU folder ☒ Create Work Packet Folder ☐ SCAN: Above documents into "CBU Folder" ☐ SAVE: other documents in "Work Packet Folder" ☐ Certificate(s) ☐ Transfer App Maps (To/From) ☐ ☐ OrMap Tax Lot Map ☒ Ownership Report ☐ BLM Cadastral Survey ☐ GW Logs ☐ GW Conditions ☐ Mitigation ☐ POU Report (conflict) ☐ Others: [POU ONLY]
☒	☐	SEARCH: ☐ Interactive Mapper ☐ AOI ☒ Map and TaxLot ID New Landowner: <u>Sam</u>

REVIEW OF CLAIM:

ORDER REQ'D	CERTIFICATE REQ'D	COMPLIED YES/NO	CONDITIONS:	NOTES:
☐ Y ☐ N/A	☐ Y ☐ N/A	☐ Y ☐ N	Fish Condition	
☐ Y ☐ N/A	☐ Y ☐ N/A	☐ Y ☐ N	Meter/Measuring Device	
☐ Y ☐ N/A	☐ Y ☐ N/A	☐ Y ☐ N	Water Use Reporting	
☐ Y ☐ N/A	☐ Y ☐ N/A	☐ Y ☐ N	SWL (Month)	
☐ Y ☐ N/A	☐ Y ☐ N/A	☐ Y ☐ N	Dedicated MMS tube	
☐ Y ☐ N/A	☐ Y ☐ N/A	☐ Y ☐ N	Well Id	
☒ Y ☐ N/A	☐ Y ☐ N/A	☒ Y ☐ N	Other:	
☒ Y ☐ N/A	☐ Y ☐ N/A	☒ Y ☐ N	C-date: <u>10/1/2023</u>	EXT C-Date: <u>claim says June 2018</u>

REVIEW OF MAP: (Only the changes approved)

CW	PR	Notes:
☐	☐	Verify POA/POD Location (New Only)
☐	☐	Verify POU (New only)
☐	☐	POU clearly identified by Use Type/Certificate
☐	☐	DLC/GOV'T LOT
		☐ Original Cert Map for <i>unchanged</i> POU/POD/POA (Attached for Peer Reviewer/Data) ☐ Note Maps for Reference

POD/POA/APOD/POA ONLY: RUN CAPACITY CALCULATOR AND SAVE CALCS TO APPLICATION FOLDER:

POD/POA-NEW/ADD'T	AUTHORIZED RATE	CLAIM RATE	CALCULATED RATE	NOTES:
	<u>Full cfs</u>		<u>4.47cfs</u>	<u>See Calc Sheet</u>

DETERMINATION:

CW	PR	DOCUMENT	NOTES:
☐	☐	LETTER FOR CLARIFICATION	
☐	☐	DRAFT (PLEASE EXPLAIN)	
☒	☐	PROPOSED	did not develop in 8sw, 9w8, sese
☐	☐	FINAL	
☐	☐	PROPOSED ORDER TO CANCEL	

FINAL CHECKS: Review your document; BEFORE printing proposed for Support

CW	PR	DID YOU CHECK?	NOTES:
☐	☐	DATA REVIEW	
		☐ POA/POD/DAM TABLES/DESCRIPTIONS	☐ PLACE OF USE TABLES, INCLUDING ACRES FOR GOV'T LOTS/DLC
☐	☐	SPELL CHECK DOC	
☐	☐	MAPS: Identified for Reference	
☐		CERT NUMBER ISSUED:	
		Original Cert # App	New Cert #
		Original Cert # App	New Cert #
		Original Cert # App	New Cert #
		Original Cert # App	New Cert #

EXTRAS: BEFORE Printing your Final Certificate

CW	PR	DID YOU CHECK?	NOTES:
☐	☐	DATA REVIEW COMMENTS UPDATED	
☐	☐	SPELL CHECKED DOC	

CASEWORKER REVIEW COMMENTS:**PEER REVIEWER COMMENTS:**



RECEIVED

JAN 11 2023

SALEM, OREGON

CLAIM OF BENEFICIAL USE
WATER-RIGHT TRANSFER T-12523

CITY OF JUNCTION CITY

P.O. BOX 250
JUNCTION CITY, OR 97448

January 6, 2023

Project 10004.007

Skookum Water Associates Inc.
1626 Victorian Way Eugene, OR 97401
(503) 319-8926

**CLAIM OF
BENEFICIAL USE
for Transfer with Multiple
Changes - Groundwater**



Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, Oregon 97301-1266
(503) 986-0900
www.oregon.gov/OWRD

A fee of \$230 must accompany this form for any Transfer final orders including a water right with a priority date of July 9, 1987, or later.

Example - A transfer involves 5 rights and one of the rights has a priority date of July 9, 1987, or later, the fee is required.

RE
JAN 11 2023
SALEM, OREGON

A separate form shall be completed for each transfer.

This form is subject to revision. **Begin each new claim** by checking for a new version of this form at:
<https://www.oregon.gov/OWRD/Forms/Pages/default.aspx>

The completion of this form is required by OAR 690-014-0100(1) and 690-014-0110(4).

Please type or print in dark ink. If this form is found to contain errors or omissions, it may be returned to you. **Every item must have a response.** If any requested information does not apply to the claim, insert "NA." **Do not delete or alter any section of this form unless directed by the form.** The Department may require the submittal of additional information from any water user or authorized agent.

"Section 7" of this form is intended to aid in the completion of this form and should not be submitted.

A claim of beneficial use includes both this report and a map. If the map is being mailed separately from this form, please include a note with this form indicating such.

If you have questions regarding the completion of this form, please call 503-979-9103.

The Department has a program that allows it to enter into a voluntary agreement with an applicant for expedited services. Under such an agreement, the applicant pays the cost to hire additional staff that would not otherwise be available. This program means a certificate may be issued in about a month. For more information on this program see:

<https://www.oregon.gov/OWRD/programs/WaterRights/RA/Pages/default.aspx>

GENERAL INFORMATION

Type of Authorized Change

This Claim is being submitted for a transfer involving multiple changes.

YES

Mark all that apply:

1. ☒ Change in POA(s) or Additional POA(s)
3. ☐ Change in Character of Use

2. ☒ Change in Place of Use

A separate section will be completed for each type of change authorized in the transfer final order.

1. File Information

APPLICATION #

T-12523

RECEIVED

JAN 11 2023

OWRD
SALEM, OREGON

WR

2. Property Owner (current owner information)

APPLICANT/BUSINESS NAME City of Junction City Attn: Gary Kaping		PHONE NO. (541) 998-3125	ADDITIONAL CONTACT NO.
ADDRESS P.O. Box 250			
CITY Junction City	STATE OR	ZIP 97448	E-MAIL GKaping@ci.junction.city.or.us

If the current property owner is not the transfer holder of record, it is recommended that an assignment be filed with the Department. ***Each transfer holder of record must sign this form.***

3. Transfer holder of record (this may, or may not, be the current property owner)

TRANSFER HOLDER OF RECORD City of Junction City Attn: Gary Kaping		
ADDRESS P.O. Box 250		
CITY Junction City	STATE OR	ZIP 97448

4. Date of Site Inspection:

December 21, 2022

5. Person(s) interviewed and description of their association with the project:

NAME	DATE	ASSOCIATION WITH THE PROJECT
Gary Kaping	12/21/22	Public Works Director

6. County:

Lane

7. If any property described in the place of use of the transfer final order is excluded from this report, identify the owner of record for that property (ORS 537.230(5)):

OWNER OF RECORD NA		
ADDRESS		
CITY	STATE	ZIP

Add additional tables for owners of record as needed

RECEIVED
JAN 11 2023
UWHD
SALEM, OREGON

SECTION 2
SIGNATURES

CWRE Statement, Seal and Signature

The facts contained in this Claim of Beneficial Use are true and correct to the best of my knowledge.




CWRE NAME Steven R. Bruce		PHONE NO. (503) 319-8926	ADDITIONAL CONTACT NO.
ADDRESS 1626 Victorian Way			
CITY Eugene	STATE OR	ZIP 97401	E-MAIL steve@skookumwater.com

Transfer Holder of Record Signature or Acknowledgement

***Each** transfer holder of record must sign this form in the space provided below.*

The facts contained in this Claim of Beneficial Use are true and correct to the best of my knowledge. I request that the Department issue a water right certificate.

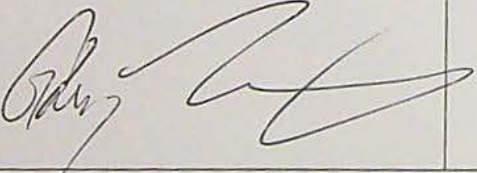SIGNATURE	PRINT OR TYPE NAME	TITLE	DATE
	Gary Kaping	Public Works Director	

RECEIVED
JAN 11 2023
OWRD
SALEM, OREGON

SECTION 3

Changes Made

Note: The Claim only needs to describe the changes that were authorized in the transfer final order.

Change #1

Change in POA(s) or Additional POA(s)

Did the transfer order authorize a change in the points of appropriation or additional points of appropriation?
YES

If "NO", this Section can be deleted.

1. New or additional point of appropriation name or number:

POINT OF APPROPRIATION (POA) NAME OR NUMBER (CORRESPOND TO MAP)	WELL LOG ID # FOR ALL WORK PERFORMED ON THE WELL (IF APPLICABLE)	WELL TAG # (IF APPLICABLE)	SOURCE (IF LISTED IN TRANSFER FINAL ORDER)
11 th & Elm Well	LANE 70495	L-76770	A Well within Willamette River Basin

Attach each well log available for the well (include the log for the original well and any subsequent alterations, reconstructions, or deepenings)

If well logs are available, items A and B below can be deleted

2. Variations:

Was the use developed differently from what was authorized by the transfer final order, or extension final?

NO

If yes, describe below.

(e.g. "The order allowed three new/additional points of appropriation. The water user only developed one of the points.")

3. Claim Summary:

NEW OR ADDITIONAL POA NAME OR #	MAXIMUM RATE AUTHORIZED	CALCULATED THEORETICAL RATE BASED ON SYSTEM	AMOUNT OF WATER MEASURED
11 th & Elm Well	1.11 cfs	4.47 cfs	--

RECEIVED

JAN 11 2023

OWRD
SALEM, OREGON

System Description

Are there multiple new or additional Points of Appropriation (POA)?

NO

If "YES" you will need to copy and complete either Section A or B in this Section for each POA.

POA Name or Number this section describes (only needed if there is more than one):

11th & Elm Well

A. POA System Information

Provide the following information concerning the point of appropriation. Information provided must describe the equipment used to appropriate water from the point of appropriation.

1. Pump Information

MANUFACTURER	MODEL	SERIAL NUMBER	TYPE (CENTRIFUGAL, TURBINE OR SUBMERSIBLE)	INTAKE SIZE	DISCHARGE SIZE
Wolf American Turbine	10M55/22STG-2D	1502056	Submersible	Unknown	8 inch

2. Motor Information

MANUFACTURER	HORSEPOWER
Hitachi	100

3. Theoretical Pump Capacity

HORSEPOWER	OPERATING PSI	LIFT FROM SOURCE TO PUMP *If a well, the water level during pumping	LIFT FROM PUMP TO PLACE OF USE	TOTAL PUMP OUTPUT (IN CFS)
100	14	102 feet reported	20 feet	4.47

4. Provide pump calculations:

$$Q \text{ Pump} = \frac{(\text{horsepower})(\text{pump efficiency})}{(\text{total head in feet})} = \frac{(100)(7.04)}{35.5+102+20} = \frac{704}{157.5} = 4.47 \text{ cfs (approx. 2,006 gpm)}$$

Where:

$$\text{hp} = 100$$

$$\text{efficiency} = 7.04 \text{ ft}^4/\text{sec}/\text{hp}$$

$$\text{total head} = 35.5 \text{ ft (conversion of 14 psi using 2.54 ft head/psi)} + 102 \text{ feet} + 20 \text{ ft to treatment plant} = 157.5 \text{ ft}$$

5. Measured Pump Capacity (using meter if meter was present and system was operating)

INITIAL METER READING	ENDING METER READING	DURATION OF TIME OBSERVED	TOTAL PUMP OUTPUT (IN CFS)
NA – pump off			

Reminder: For pump calculations use the reference information at the end of this document.

RECEIVED

JAN 11 2023

OWRD
SALEM, OREGON

6. Additional notes or comments related to the system:

B. Groundwater Source Information (Well and Sump)

1. Is the appropriation from a dug well (sump)?

NO

If "NO", items 2 through 4 relating to this section may be deleted.

Change #2

Change in Place of Use

Did the transfer order authorize a change in the place of use?

YES

If "NO", this Section can be deleted.

1. Claim Summary – Authorized Use:

If Irrigation or Nursery Use:

THE # OF ACRES ALLOWED	THE # OF ACRES DEVELOPED
NA – Municipal Use	NA

If the new use(s) was not irrigation or nursery:

NEW USE(S)	WAS THE NEW PLACE OF USE DEVELOPED TO THE FULL EXTENT AUTHORIZED UNDER THE ORDER? (INCLUDE THE LOCATION OF THE DEVELOPED PLACE USE ON THE CLAIM MAP)
Municipal	YES

2. Variations:

Was the use developed differently from what was authorized by the transfer final order?

YES

If yes, describe below.

(e.g. "The order authorized a change in place of use for 40 acres. The water user only developed 38 acres.")

The place of use authorized by the Order included the SESW, SWSE and SESE of Section 30 in T15S, R4W, WM. The City currently does not provide water service to these three quarter-quarter sections.

Change #3

Change in Character of Use

Did the transfer order authorize a change in character of use?

NO

If "NO", this Section can be deleted.

RECEIVED

JAN 11 2023

OWRD
SALEM, OREGON

SECTION 4

CONDITIONS

All conditions contained in the transfer final order, or any extension final order shall be addressed. Reports that do not address all performance related conditions will be returned.

1. Time Limits:

Describe how the water user has complied with each of the development timelines established in the transfer final order and any extensions of time issued for the transfer:

	DATE FROM TRANSFER	DATE THE AUTHORIZED CHANGES WERE COMPLETED *THIS DATE MUST FALL BETWEEN THE "ISSUANCE DATE" AND THE "COMPLETENESS DATE"
ISSUANCE DATE	1/22/2018	
COMPLETENESS DATE FROM ORDER (C)	10/1/2023	June 2018

* MUST BE WITHIN PERIOD BETWEEN TRANSFER FINAL ORDER, OR ANY EXTENSION FINAL ORDER ISSUANCE AND THE DATE TO COMPLETE THE CHANGE

2. Is there an extension final order(s)?

NO

If "NO", you may delete the following table.

3. Measurement Conditions:

a. Does the transfer final order, or any extension final order require the installation of a meter or other approved measuring device?

NO

If "NO", items b through f relating to this section may be deleted.

4. Recording and reporting conditions

a. Is the water user required to report the water use to the Department?

NO

If "NO", item b relating to this section may be deleted.

5. Other conditions required by the transfer final order or extension final order:

a. Were there special well construction standards?

NO

b. Was submittal of a ground water monitoring plan required?

NO

c. Other conditions?

YES

If "YES" to any of the above, identify the condition and describe the water user's actions to comply with the condition(s):

The well was required to obtain water from the same aquifer as the original point of appropriation. This requirement is assumed to be met, given the well existed at the time the transfer application was filed and the transfer was approved by the Department.

RECEIVED

JAN 11 2023

OWHD
SALEM, OREGON

SECTION 5
ATTACHMENTS

Provide a list of any additional documents you are attaching to this report:

ATTACHMENT NAME	DESCRIPTION
Figure 1	Claim of Beneficial Use Map for Transfer T-12523
Exhibit A	Water Supply Well Report LANE 70495

SECTION 6
CLAIM OF BENEFICIAL USE MAP

The Claim of Beneficial Use Map must be submitted with this claim. Claims submitted without the Claim of Beneficial Use map will be returned. The map shall be submitted on poly film at a scale of 1" = 1320 feet, 1" = 400 feet, or the original full-size scale of the county assessor map for the location.

The changes that were authorized under the transfer final order must be mapped based on the developed locations; new or additional points of appropriation and place of use.

In cases where the order involved additional points of appropriation, the additional points should be mapped based on their developed locations. The original points of appropriation should be mapped based on the original right of record at the time the transfer final order was issued.

In cases where the order involved changing the place of use for a portion of a water right, the portion of the place of use being changed should be mapped based on the developed location. If the transfer also included portions of the place of use that were not being modified, but were receiving a new or additional point of appropriation, the place of use for those lands should be mapped based on the original right of record at the time the transfer final order was issued.

Provide a general description of the survey method used to prepare the map. Examples of possible methods include, but are not limited to, a traverse survey, GPS, or the use of aerial photos. If the basis of the survey is an aerial photo, provide the source, date, series and the aerial photo identification number.

The map was tied using a Garmin Oregon 750t GPS.

RECEIVED
JAN 11 2023
OWRD
SALEM, OREGON

Map Checklist

Please be sure that the map you submit includes ALL the items listed below.
(Reminder: Incomplete maps and/or claims may be returned.)

- ☒ Map on polyester film
- ☒ Appropriate scale (1" = 400 feet, 1" = 1320 feet, or the original full-size scale of the county assessor map)
- ☒ Township, Range, Section, Donation Land Claims, and Government Lots
- ☐ NA If irrigation, number of acres irrigated within each projected Donation Land Claims, Government Lots, Quarter-Quarters
- ☐ NA Locations of fish screens and/or fish by-pass devices in relationship to point of diversion
- ☐ NA Locations of meters and/or measuring devices in relationship to point of diversion or appropriation
- ☐ Not Required Conveyance structures illustrated (pumps, reservoirs, pipelines, ditches, etc.)
- ☒ Point(s) of diversion or appropriation (illustrated and coordinates)
- ☐ NA – Municipal Use Tax lot boundaries and numbers
- ☐ NA Source illustrated if surface water
- ☒ Disclaimer ("This map is not intended to provide legal dimensions or locations of property ownership lines")
- ☒ Application and permit number or transfer number
- ☒ North arrow
- ☒ Legend
- ☒ CWRE stamp and signature

RECEIVED
JAN 11 2023
OWRD
SALEM, OREGON

MAY 27 2010

STATE OF OREGON
WATER SUPPLY WELL REPORT
(as required by ORS 537.765)

WATER RESOURCES DEPT
SALEM, OREGON

WELL I.D. # L 76770
START CARD # W 205112

Instructions for completing this report are on the last page of this form.

(1) LAND OWNER Well Number _____
Name City of Junction City
Address P.O. Box 250
City Junction City State OR Zip 97448

(2) TYPE OF WORK

☒ New Well ☐ Deepening ☐ Alteration (repair/recondition) ☐ Abandonment

(3) DRILL METHOD:

☐ Rotary Air ☐ Rotary Mud ☒ Cable ☐ Auger

☐ Other _____

(4) PROPOSED USE:

☐ Domestic ☒ Community ☐ Industrial ☐ Irrigation

☐ Thermal ☐ Injection ☐ Livestock ☐ Other _____

(5) BORE HOLE CONSTRUCTION:

Special Construction approval ☐ Yes ☒ No Depth of Completed Well 267.5' ft.

Explosives used ☐ Yes ☒ No Type _____ Amount _____

HOLE				SEAL			
Diameter	From	To	Material	From	To	Sacks or pounds	
20"	0	77	Cement	0	70	76 - 94 lb sbs	
Formation Seal			Quick Grout	70	76	6 - 50 lb sbs	

How was seal placed: Method ☐ A ☐ B ☐ C ☐ D ☐ E

☒ Other Pressure grouted thru trimmie pipe

Backfill placed from _____ ft. to _____ ft. Material _____

Gravel placed from _____ ft. to _____ ft. Size of gravel _____

(6) CASING/LINER:

Diameter	From	To	Gauge	Steel	Plastic	Welded	Threaded
Casing: 16"	+2	142.5		☒	☐	☒	☐
				☐	☐	☐	☐
				☐	☐	☐	☐
10"	132.5	135		☒	☐	☒	☐
Liner: 10"	183	224.5		☒	☐	☒	☐
10"	263.5	267.5		☒	☐	☒	☐

Drive Shoe used ☐ Inside ☐ Outside ☐ None

Final location of shoe(s) _____

(7) PERFORATIONS/SCREENS:

☐ Perforations

Method _____

☒ Screens

Type Alloy

Material Stainless Steel

From	To	Slot size	Number	Diameter	Tele/pipe size	Casing	Liner
135	183	35		10"		☐	☐
224.5	263.5	35		10"		☐	☐
						☐	☐
						☐	☐

(8) WELL TESTS: Minimum testing time is 1 hour

☒ Pump

☐ Bailer

☐ Air

☐ Flowing
☐ Artesian

Yield gal/min

Drawdown

Drill stem at

Time

1102	94'3"		48 Hrs.
------	-------	--	---------

Temperature of water 55.2° Depth Artesian Flow Found _____

Was a water analysis done? ☒ Yes By whom Owner

Did any strata contain water not suitable for use? ☐ Too little

☐ Salty ☐ Muddy ☐ Odor ☐ Colored ☐ Other _____

Depth of strata: _____

(9) LOCATION OF WELL by legal description:

County Lane Latitude _____ Longitude _____

Township 15 S N or S Range 4 W E or W. WM.

Section 32 SE 1/4 NW 1/4

Tax Lot R.O.W. Lot _____ Block _____ Subdivision _____

Street Address of Well (or nearest address) 11th & Elm St.
Junction City, OR

(10) STATIC WATER LEVEL:

15 ft. below land surface.

Date 5-18-10

Artesian pressure _____ lb. per square inch

Date _____

(11) WATER BEARING ZONES:

Depth at which water was first found 18'

From	To	Estimated Flow Rate	SWL
18	35	RECEI	
36	40		
80	102	JAN 11 2	15
138	158		15
170	185	OWRL	

(12) WELL LOG: Continued on page # 2

Ground Elevation _____

Material	From	To	SWL
Fill	0	3	
Brown clay gravel	3	5	
Brown clay	5	14	
Brown gravel clay	14	18	
Brown gravel sand, water	18	35	
Brown sandstone	35	36	
Brown red gravel sandstone,			
clay, less water	36	40	
Blue clay	40	53	
Gray clay sandy seams	53	80	
Gray sandy clay, some water	80	102	
Gray clay sand little gravel	102	113	
Gray blue sandy clay	113	121	
Gray sandy clay wood	121	128	
Gray sandy clay	128	138	
Gray sand, silt, clay, water	138	152	
Gray sand silt clay wood,			
water	152	168	
Gray sandy clay	168	170	

Date started 2-9-10 Completed 5-20-10

(unbonded) Water Well Constructor Certification:

I certify that the work I performed on the construction, alteration, or abandonment of this well is in compliance with Oregon water supply well construction standards. Materials used and information reported above are true to the best of my knowledge and belief. Terry Johnson

Signed Terry Johnson WWC Number 1321
Date 5-24-10

(bonded) Water Well Constructor Certification:

I accept responsibility for the construction, alteration, or abandonment work performed on this well during the construction dates reported above. All work performed during this time is in compliance with Oregon water supply well construction standards. This report is true to the best of my knowledge and belief.

Signed Ron Aspaas WWC Number 1445
Date 5-24-10

WELL I.D. # L 76770
START CARD # W 205112

(9) LOCATION OF WELL by legal description:

(1) LAND OWNER _____ Well Number _____
 Name City of Junction City
 Address P.O. Box 250
 City Junction City State OR Zip 97448

☒ New Well ☐ Deepening ☐ Alteration (repair/recondition) ☐ Abandonment

☐ Rotary Air ☐ Rotary Mud ☒ Cable ☐ Auger
☐ Other _____

☐ Domestic ☒ Community ☐ Industrial ☐ Irrigation
☐ Thermal ☐ Injection ☐ Livestock ☐ Other _____

Special Construction approval ☐ Yes ☒ No Depth of Completed Well 207.5 ft.
Explosives used ☐ Yes ☒ No Type _____ Amount _____

HOLE			SEAL			Sacks or pounds
Diameter	From	To	Material	From	To	

How was seal placed: Method ☐ A ☐ B ☐ C ☐ D ☐ E
☐ Other _____

Backfill placed from _____ ft. to _____ ft. Material _____

Gravel placed from _____ ft. to _____ ft. Size of gravel _____

	Diameter	From	To	Gauge	Steel	Plastic	Welded	Threaded
Casing:					☐	☐	☐	☐
					☐	☐	☐	☐
					☐	☐	☐	☐
					☐	☐	☐	☐
Liner:					☐	☐	☐	☐
					☐	☐	☐	☐

Drive Shoe used ☐ Inside ☐ Outside ☐ None
Final location of shoe(s) _____

☐ Perforations Method _____

☐ Screens Type _____ Material _____

From	To	Slot size	Number	Diameter	Tele/pipe size	Casing	Liner
						☐	☐
						☐	☐
						☐	☐
						☐	☐

☐ Pump	☐ Bailer	☐ Air	☐ Flowing ☐ Artesian
Yield gal/min	Drawdown	Drill stem at	Time

			1 hr.

Temperature of water _____ Depth Artesian Flow _____
Was a water analysis done? ☐ Yes By whom _____

Did any strata contain water not suitable for intended use? ☐ Too little

☐ Salty ☐ Muddy ☐ Odor ☐ Colored ☐ Other

JUL 12 2010

Depth of strata: _____

County Lane Latitude _____ Longitude _____

Township 15 S N or S Range 4 W E or W. WM.

Section 32 SE 1/4 NW 1/4

Tax Lot	R.O.W. Lot	Block	Subdivision
---------	------------	-------	-------------

Street Address of Well (or nearest address) 11th & Elm St.
Junction City, OR

15 ft. below land surface. Date 5-18-10

Artesian pressure _____ lb. per square inch Date _____

Depth at which water was first found 18'

From	To	Estimated Flow Rate	SWL
185	200		15
226	244		15
249	261	1100 GPM	15

(12) WELL LOG: Continued from page # 1

Ground Elevation

[illegible]

Date started 2-9-10 Completed 5-20-10

(unbonded) Water Well Constructor Certification:

I certify that the work I performed on the construction, alteration, or abandonment of this well is in compliance with Oregon water supply well construction standards. Materials used and information reported above are true to the best of my knowledge and belief. Terry Johnson

Signed Gene [Signature] WWC Number 1321
Date 5-24-10

(bonded) Water Well Constructor Certification:

I accept responsibility for the construction, alteration, or abandonment work performed on this well during the construction dates reported above. All work performed during this time is in compliance with Oregon water supply well construction standards. This report is true to the best of my knowledge and belief.

Signed Row Aspaas WWC Number 1445
Date 5-24-10

ORIGINAL - WATER RESOURCES DEPARTMENT FIRST COPY - CONSTRUCTOR SECOND COPY EXHIBIT A (cont.)

January 6, 2023
Project No. 10004.007

City of Junction City
P.O. Box 250
Junction City, OR 97448
Attn: Mr. Gary Kaping

SKOOKUM
WATER ASSOCIATES INC
Via Hand Delivery

RECEIVED
JAN 11 2023
OWRD
SALEM, OREGON

**Transmittal of Claims of Beneficial Use and Filing Instructions
Oregon Water Resources Department Water-Right Transfer T-12523**

Dear Mr. Kaping,

Skookum Water Associates Inc. is pleased to provide the enclosed four Claims of Beneficial Use (CBU) reports and two mylar CBU maps for the referenced Oregon Water Resources Department (WRD) water-right transfer. Please note that each report contains a folded copy of the Figure 1 CBU Map. The WRD will use the CBU as the basis for issuing a water-right certificate to the City.

If the City does not have any changes to the CBU report or map, the following are instructions for executing and filing the documents.

1. Please sign and date the four originals of the CBU report in the space indicated at the bottom of page 3. One signed report and one mylar Figure 1 map should be sent to the WRD at the address shown below. If the documents are mailed, we recommend using a method that provides documentation that the WRD received the CBU.

Oregon Water Resources Department
725 Summer Street N.E., Suite A
Salem, Oregon 97301-1266


2. Please distribute the remaining documents as follows:
 - Two reports and one mylar Figure 1 map are intended for the City's records.
 - One report should be returned to us for our records.

Currently, the WRD estimates the CBU will be processed in 2 to 4 years. Please contact me if the City is interested in using the WRD Reimbursement Authority program to expedite the CBU processing. Under this program, the City would pay a fee (estimated to be less than \$3,000) to have the WRD process the CBU in about 4 to 5 months.

Please call or email us if you have any questions about the CBU documents or the filing process. We appreciate this opportunity to be of service to the City of Junction City.

Sincerely,

SKOOKUM WATER ASSOCIATES INC.



Steven R. Bruce, RG, CWRE
Principal Hydrogeologist

attachments

Checklist for Claims of Beneficial Use Received at CSG Counter

Application #:	WRD Reviewer:Dante Luongo
Transfer #:T-12523	
Date Received:1-11-2023	
CWRE Name:Steven Bruce	
Priority Date (s):2-13-1975	

Fees Required:

- ☐ YES ☒ NO ☐ A fee of \$230 must accompany this form for permits with priority dates of July 9, 1987, or later.
- ☐ YES ☒ NO ☐ A fee of \$230 must accompany this form for any transfers including a water right with a priority date of July 9, 1987, or later.
- Example – A transfer involves 5 rights and one of the rights has a priority date of July 9, 1987, or later, the fee is required.
- Fill in

Map Review:

- ☒ Map on polyester film (OAR 690-014-0170(1) & 310-0050(1)(b))
- ☒ Application & permit #; or transfer # (OAR 690-014-0100(1))
- ☒ Disclaimer (OAR 690-014-0170(5))
- ☒ North arrow (OAR 690-310-0050(2)(c))
- ☒ CWRE stamp and signature (OAR 690-014 & 310-0050)
- ☒ Appropriate scale (1" = 1320', 1" = 400', or the original full-size scale of the county assessor map) (014 & 310)
- ☒ Township, range, section, and tax lot numbers (OAR 690-310-0050(4))

Report Review:

- ☒ On form provided by the Department (OAR 690-014-0100(1))
- ☒ Application & permit #; or transfer # (OAR 690-014)
- ☒ Ownership information (OAR 690-014)
- ☒ Date of survey (OAR 690-014)
- ☒ Person interviewed (OAR 690-014)
- ☒ County (OAR 690-014)
- ☒ CWRE stamp and signature (OAR 690-014-0100)
- ☒ Signature(s) of all permittee of transfer holder (OAR 690-014-0100)

MONEY SLIP

DATE: _____

RECEIPT #: _____

APPLICATION

ADDRESS: _____

CITY: _____ STATE: _____ OTHER (COUNTRY): _____

MAIL: ☐ TELEPHONE: _____ CITY: _____ DISTRICT: _____

4017 COPIES _____ (COUNTRY): _____

4017 OTHER _____ (COUNTRY): _____

4018 Insurance Plan _____ 4018 Water Meter Sign _____ 4018 Core View _____

4018 Trenching _____ 4018 Sewer Operation _____

4017	4018	4019	4020	4021	4022	4023	4024	4025	4026	4027	4028	4029	4030	4031	4032	4033	4034	4035	4036	4037	4038	4039	4040	4041	4042	4043	4044	4045	4046	4047	4048	4049	4050	4051	4052	4053	4054	4055	4056	4057	4058	4059	4060	4061	4062	4063	4064	4065	4066	4067	4068	4069	4070	4071	4072	4073	4074	4075	4076	4077	4078	4079	4080	4081	4082	4083	4084	4085	4086	4087	4088	4089	4090	4091	4092	4093	4094	4095	4096	4097	4098	4099	4100	4101	4102	4103	4104	4105	4106	4107	4108	4109	4110	4111	4112	4113	4114	4115	4116	4117	4118	4119	4120	4121	4122	4123	4124	4125	4126	4127	4128	4129	4130	4131	4132	4133	4134	4135	4136	4137	4138	4139	4140	4141	4142	4143	4144	4145	4146	4147	4148	4149	4150	4151	4152	4153	4154	4155	4156	4157	4158	4159	4160	4161	4162	4163	4164	4165	4166	4167	4168	4169	4170	4171	4172	4173	4174	4175	4176	4177	4178	4179	4180	4181	4182	4183	4184	4185	4186	4187	4188	4189	4190	4191	4192	4193	4194	4195	4196	4197	4198	4199	4200	4201	4202	4203	4204	4205	4206	4207	4208	4209	4210	4211	4212	4213	4214	4215	4216	4217	4218	4219	4220	4221	4222	4223	4224	4225	4226	4227	4228	4229	4230	4231	4232	4233	4234	4235	4236	4237	4238	4239	4240	4241	4242	4243	4244	4245	4246	4247	4248	4249	4250	4251	4252	4253	4254	4255	4256	4257	4258	4259	4260	4261	4262	4263	4264	4265	4266	4267	4268	4269	4270	4271	4272	4273	4274	4275	4276	4277	4278	4279	4280	4281	4282	4283	4284	4285	4286	4287	4288	4289	4290	4291	4292	4293	4294	4295	4296	4297	4298	4299	4300	4301	4302	4303	4304	4305	4306	4307	4308	4309	4310	4311	4312	4313	4314	4315	4316	4317	4318	4319	4320	4321	4322	4323	4324	4325	4326	4327	4328	4329	4330	4331	4332	4333	4334	4335	4336	4337	4338	4339	4340	4341	4342	4343	4344	4345	4346	4347	4348	4349	4350	4351	4352	4353	4354	4355	4356	4357	4358	4359	4360	4361	4362	4363	4364	4365	4366	4367	4368	4369	4370	4371	4372	4373	4374	4375	4376	4377	4378	4379	4380	4381	4382	4383	4384	4385	4386	4387	4388	4389	4390	4391	4392	4393	4394	4395	4396	4397	4398	4399	4400	4401	4402	4403	4404	4405	4406	4407	4408	4409	4410	4411	4412	4413	4414	4415	4416	4417	4418	4419	4420	4421	4422	4423	4424	4425	4426	4427	4428	4429	4430	4431	4432	4433	4434	4435	4436	4437	4438	4439	4440	4441	4442	4443	4444	4445	4446	44
------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	----

Fill in App
or Transfer
Number

Groundwater File Review:

- ☒ Pump Test not required (Priority Date prior to December 20, 1988) *If no, include pump test flyer w/acknowledgment letter
☐ Pump Test required (Priority Date on or after December 20, 1988)
☐ Pump Test submitted
☒ Pump Test not submitted

Water Right Transfer Cover Sheet

Transfer T-12523

Transfer Specialist: JLJ

Transfer Type: Regular

Applicant Name/Address: CITY OF JUNCTION CITY ATTN: GARY KAPING PO BOX 250 JUNCTION CITY, OR 97448	Agent Name/Address: STEVEN R. BRUCE 1626 VICTORIAN WAY EUGENE, OR 97401	Ree Landowner Name/Address: MARTA PAGEL Schwab, Williamson & Wyatt 530 Center St NE, Suite 730 Salem, OR 97301
CWRE Name/Number:	Irr. District Name/Address:	Affected Gov'ts Name/Address: Lane County
Commentors: Name/Address:		Current Landowner Name/Address:

Water Rights Affected

Records Marked	Records Copied	App File No. or Decree Name	Permit No.	Certificate No.	RR/CR Needed	RR/CR Nos.
☐	☐	G-4605	G-4329	41697	☒ Yes ☐ No	
☐	☐				☐ Yes ☐ No	
☐	☐				☐ Yes ☐ No	

Key Dates & Initial Actions

Rec'd: November 14, 2016	Proposed Action(s): ADDITIONAL POINT OF APPROPRIATION; PLACE OF USE	
Fees Pd: 2450.00	WM District: 2	ODFW District:
Initial Notice: November 22, 2016	WM Review sent: 11/22/2016	ODFW Review sent:
Acknowledgement Letter Sent ☒	GW Review sent: 11/22/2016	

Processing Dates & Actions

Deficiency Contacts: _____

DENY

DPD Mailed: 8-28-17 10-25-17 **APPROVED**

☐ ODFW contact sheet sent with DPD, or ☐ N/A

☐ WM measurement contact sheet sent, or ☐ N/A

PD Signed: 12-7-17

PD Weekly Notice: 12-12-17

Newspaper quote requested: _____

☐ not required

Request for news \$ sent: _____

News \$ received: _____

Request to publish sent to newspaper: _____

Affidavit of publication received: _____

DPD Review (Optional)	PD Review (Salem)	Final Order Review (Salem)
Reviewer: <u>JLJ</u>	Reviewer: <u>APUA</u>	Reviewer: _____
Date: <u>8-25-17</u>	Date: <u>2/1/17</u>	Date: _____
Coordinator: <u>PCS</u>	Coordinator: _____	Coordinator: <u>JLJ</u>
Date: <u>8-27-17</u>	Date: _____	Date: <u>1-12-18</u>

Comments/Special Issues:

Expand POU of City water supply boundary
APCA, POU 2nd Rev. DPD - Lisa 11/29/17

Special Order Volume: Vol 107 Pages 477

Final Order Signature Date: 1-19-18

Notice of FO email'd to processors _____



Oregon

Kate Brown, Governor

Water Resources Department

North Mall Office Building
725 Summer St NE, Suite A
Salem, OR 97301
Phone (503) 986-0900
Fax (503) 986-0904
www.wrd.state.or.us

January 22, 2018

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY, OR 97448

REFERENCE: Transfer Application T-12523

Enclosed is a copy of the final order approving your water right transfer application.

The time allowed to complete the transfer is specified in the final order. **YOU SHOULD GIVE PARTICULAR ATTENTION TO THE TIME LIMIT.** The water right for any portion of the authorized change in character of use or change in place of use NOT carried out within the time allowed will be lost.

An extension of the time limit can be allowed only upon a showing that diligent effort has been made to complete the actual change(s) within the time allowed.

You are required to hire a Certified Water Rights Examiner (CWRE) to complete a Claim of Beneficial Use report and map which must be submitted to this Department within one year of the date you complete the change(s) or within one year of the completion date authorized in the transfer final order, whichever occurs first.

If you have any questions related to the approval of this transfer, you may contact your caseworker, Jessica Joye, by telephone at (503) 986-0814 or by e-mail at Jessica.L.Joye@oregon.gov.

Sincerely,

Marissa Andrews
Water Right Services Support

cc: Lanaya F. Blakely, Watermaster Dist. #2 (via email)
Steven R. Bruce, Agent
Landowners (other or receiving)

Enclosure



**BEFORE THE WATER RESOURCES DEPARTMENT
OF THE
STATE OF OREGON**

In the Matter of Transfer Application	)	FINAL ORDER APPROVING OF AN
T-12523, Lane County	)	ADDITIONAL POINT OF
	)	APPROPRIATION AND A CHANGE IN
	)	PLACE OF USE

Authority

Oregon Revised Statutes (ORS) 537.705 and 540.505 to 540.580 establish the process in which a water right holder may submit a request to transfer the point of appropriation, place of use, or character of use authorized under an existing water right. Oregon Administrative Rules (OAR) Chapter 690, Division 380 implement the statutes and provides the Department's procedures and criteria for evaluating transfer applications.

Applicant

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY, OR 97448

Findings of Fact

1. On November 14, 2016, the CITY OF JUNCTION CITY filed an application for an additional point of appropriation and a change in place of use under Certificate 41697. The Department assigned the application number T-12523.
2. Notice of the application for transfer was published on November 29, 2016, pursuant to OAR 690-380-4000. No comments were filed in response to the notice.
3. On August 28, 2017, the Department mailed a copy of the draft Preliminary Determination proposing to deny Transfer Application T-12523 to the applicant. The draft Preliminary Determination cover letter set forth a deadline of September 27, 2017, for the applicant to respond.

This final order is subject to judicial review by the Court of Appeals under ORS 183.482. Any petition for judicial review must be filed within the 60-day time period specified by ORS 183.482(1). Pursuant to ORS 536.075 and OAR 137-003-0675, you may petition for judicial review or petition the Director for reconsideration of this order. A petition for reconsideration may be granted or denied by the Director, and if no action is taken within 60 days following the date the petition was filed, the petition shall be deemed denied.

4. On September 29, 2017, the applicant requested that the Department not proceed with issuance of a Preliminary Determination at this time.
5. The previous draft Preliminary Determination, mailed to the applicant on August 28, 2017, proposed to deny Transfer Application T-12523. On October 25, 2017, the Department mailed a revised draft Preliminary Determination proposing to approve Transfer Application T-12523.
6. On November 8, 2017, the applicant's agent submitted comments on the revised draft Preliminary Determination sent by the Department on October 25, 2017.
7. This second revised draft Preliminary Determination is prepared to address the comments received and to clarify that, for the purposes of injury review under OAR 690-380, a Ground Water Registration is not a water right subject to injury.
8. On November 27, 2017, the Department mailed a copy of the second revised draft Preliminary Determination proposing to approve Transfer Application T-12523 to the applicant. The draft Preliminary Determination cover letter set forth a deadline of December 27, 2017, for the applicant to respond. The applicant requested that the Department proceed with issuance of a Preliminary Determination and provided the necessary information to demonstrate that the applicant is authorized to pursue the transfer.
9. On December 4, 2017, the Department issued a Preliminary Determination proposing to approve Transfer T-12523 and mailed a copy to the applicant. Additionally, notice of the Preliminary Determination for the transfer application was published on the Department's weekly notice on December 12, 2017 pursuant to ORS 540.520 and OAR 690-380-4020. No protests were filed in response to the notice.
10. The right to be transferred is as follows:

Certificate: 41697 in the name of CITY OF JUNCTION CITY
(perfected under Permit G-4329)
Use: MUNICIPAL
Priority Date: SEPTEMBER 20, 1968
Rate: 1.11 CUBIC FEET PER SECOND
Source: A WELL within the WILLAMETTE RIVER BASIN

Authorized Point of Appropriation:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	915 FEET NORTH AND 595 FEET EAST FROM THE SW CORNER OF THE NESW OF SECTION 32

Authorized Place of Use:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW

11. Transfer Application T-12523 proposes an additional point of appropriation approximately 850 feet from the existing point of appropriation to:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	SE NW	3140 FEET NORTH AND 2930 FEET WEST FROM THE SE CORNER OF SECTION 32

12. Transfer Application T-12523 also proposes to change the place of use of the right to:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	29	NW SE
15 S	4 W	WM	29	SW SE
15 S	4 W	WM	30	SE SW
15 S	4 W	WM	30	SW SE
15 S	4 W	WM	30	SE SE
15 S	4 W	WM	31	NE NE
15 S	4 W	WM	31	NW NE
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE NW
15 S	4 W	WM	31	NW NW
15 S	4 W	WM	31	SW NW
15 S	4 W	WM	31	SE NW
15 S	4 W	WM	31	NE SW
15 S	4 W	WM	31	NW SW
15 S	4 W	WM	31	SW SW
15 S	4 W	WM	31	SE SW
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
15 S	5 W	WM	36	NE NE
15 S	5 W	WM	36	NW NE
15 S	5 W	WM	36	SW NE
15 S	5 W	WM	36	SE NE
15 S	5 W	WM	36	NE SE
15 S	5 W	WM	36	NW SE
15 S	5 W	WM	36	SW SE
15 S	5 W	WM	36	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	SW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	5	SE NW
16 S	4 W	WM	5	NE SW
16 S	4 W	WM	5	NW SW
16 S	4 W	WM	5	SW SW
16 S	4 W	WM	5	SE SW
16 S	4 W	WM	5	NW SE
16 S	4 W	WM	6	NE NE
16 S	4 W	WM	6	NW NE
16 S	4 W	WM	6	SE NE
16 S	4 W	WM	8	NE NW
16 S	4 W	WM	8	NW NW
16 S	4 W	WM	8	SE NW
16 S	4 W	WM	8	NE SW
16 S	4 W	WM	8	SE SW
16 S	4 W	WM	17	SW NE
16 S	4 W	WM	17	NE NW
16 S	4 W	WM	17	SE NW
16 S	4 W	WM	17	NE SW
16 S	4 W	WM	17	SE SW

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	17	NW SE
16 S	4 W	WM	17	SW SE
16 S	4 W	WM	20	NE NE
16 S	4 W	WM	20	NW NE
16 S	4 W	WM	20	SW NE
16 S	4 W	WM	20	SE NE
16 S	4 W	WM	20	NE NW
16 S	4 W	WM	20	SE NW
16 S	4 W	WM	20	NE SW
16 S	4 W	WM	20	SE SW
16 S	4 W	WM	20	NE SE
16 S	4 W	WM	20	NW SE
16 S	4 W	WM	20	SW SE
16 S	4 W	WM	20	SE SE
16 S	4 W	WM	21	SW SW
16 S	4 W	WM	29	NW NE
16 S	4 W	WM	29	SW NE
16 S	4 W	WM	29	NE NW
16 S	4 W	WM	29	SE NW

Transfer Review Criteria (OAR 690-380-4010)

13. Water has been used within the last five years according to the terms and conditions of the right. There is no information in the record that would demonstrate that the right is subject to forfeiture under ORS 540.610.
14. A pump, pipeline, and sprinkler system sufficient to use the full amount of water allowed under the existing right were present within the five-year period prior to submittal of Transfer Application T-12523.
15. The proposed change would not result in enlargement of the right.
16. The proposed change would not result in injury to other water rights.
17. All other application requirements are met.

Conclusions of Law


The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 is consistent with the requirements of ORS 537.705 and 540.505 to 540.580 and OAR 690-380-5000. If protests are not filed pursuant to OAR 690-380-4030, the application will be approved.

Now, therefore, it is ORDERED:

1. The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 is approved.

2. The right to the use of the water is restricted to beneficial use at the place of use described, and is subject to all other conditions and limitations contained in Certificate 41697 and any related decree.
3. Water right Certificate 41697 is cancelled. A new certificate will be issued describing that portion of the right not affected by this transfer.
4. The quantity of water diverted at the additional point of appropriation, together with that diverted at the original point of appropriation, shall not exceed the quantity of water lawfully available at the original point of appropriation.
5. Water shall be acquired from the same aquifer (water source) as the original point of appropriation.
6. Full beneficial use of the water shall be made, consistent with the terms of this order, on or before **October 1, 2023**. A Claim of Beneficial Use prepared by a Certified Water Right Examiner shall be submitted by the applicant to the Department within one year after the deadline for completion of the changes and full beneficial use of the water.
7. After satisfactory proof of beneficial use is received, a new certificate confirming the right transferred will be issued.

Dated at Salem, Oregon this 19 day of January, 2018.

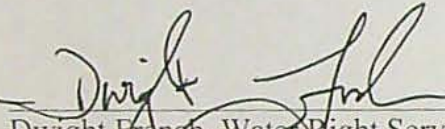

Dwight French, Water Right Services Administrator, for
Thomas M. Byler, Director
Oregon Water Resources Department

Mailing date: JAN 22 2018

STATE OF OREGON

COUNTY OF LANE

CERTIFICATE OF WATER RIGHT

THIS CERTIFICATE ISSUED TO

CITY OF JUNCTION CITY
 ATTN: GARY KAPING
 PO BOX 250
 JUNCTION CITY, OR 97448

confirms the right to use the waters of a WELL, a tributary of the WILLAMETTE RIVER, for MUNICIPAL.

This right was perfected under Permit G-4329. The date of priority is SEPTEMBER 20, 1968. The amount of water to which this right is entitled is limited to an amount actually used beneficially, and shall not exceed 0.72 CUBIC FEET PER SECOND or its equivalent in case of rotation, measured at the well.

The well is located as follows:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	915 FEET NORTH AND 595 FEET EAST FROM THE SW CORNER OF THE NESW OF SECTION 32

A description of the place of use to which this right is appurtenant is as follows:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
16 S	4 W	WM	5	NW NE


MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW

This certificate describes that portion of the water right Certificate 41697, State Record of Water Right Certificates, NOT modified by the provisions of an order of the Water Resources Director entered JAN 19 2013, approving Transfer Application T-12523.

The issuance of this superseding certificate does not confirm the status of the water right in regard to the provisions of ORS 540.610 pertaining to forfeiture or abandonment.

The right to the use of the water for the above purpose is restricted to beneficial use on the lands or place of use described.

WITNESS the signature of the Water Resources Director, affixed JAN 19 2018.

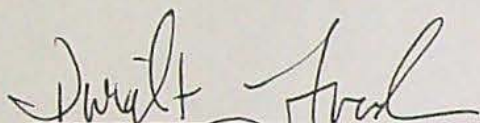A handwritten signature in black ink, appearing to read "Dwight French", is written over a horizontal line.

Dwight French, Water Right Services Administrator, for
Thomas M. Byler, Director
Oregon Water Resources Department



Oregon

Kate Brown, Governor

Water Resources Department

725 Summer St NE, Suite A

Salem, OR 97301

(503) 986-0900

Fax (503) 986-0904

December 8, 2017

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY, OR 97448

SUBJECT: Water Right Transfer Application T-12523

Please find enclosed the Preliminary Determination indicating that, based on the information available, the Department intends to approve application T-12523. This document is an intermediate step in the approval process; water may not be used legally as proposed in the transfer application until a Final Order has been issued by the Department. Please read this entire letter carefully to determine your responsibility for additional action.

A public notice is being published in the Department's weekly publication, simultaneously with issuance of the Preliminary Determination. The notice initiates a period in which any person may file either a protest opposing the decision proposed by the Department in the Preliminary Determination or a standing statement supporting the Department's decision. The protest period will end 30 days after the Department's notice.

If no protest is filed, the Department will issue a Final Order consistent with the Preliminary Determination. You should receive a copy of the Final Order about 30 days after the close of the protest period.

If a protest is filed, the application may be referred to a contested case proceeding. A contested case provides an opportunity for the proponents and opponents of the decision proposed in the Preliminary Determination to present information and arguments supporting their position in a quasi-judicial proceeding.

Please do not hesitate to contact me at 503-986-0814 or Jessica.L.Joye@oregon.gov, if I may be of assistance.

Sincerely,

Jessica Joye
Reimbursement Authority Transfer Specialist
Transfer and Conservation Section

cc: Transfer Application T-12523
Lanaya Blakely, District 2 Watermaster (*via e-mail*)
Steven R. Bruce, Agent for the applicant (*via e-mail*)

encs

**BEFORE THE WATER RESOURCES DEPARTMENT
OF THE
STATE OF OREGON**

In the Matter of Transfer Application	)	PRELIMINARY DETERMINATION
T-12523, Lane County	)	PROPOSING APPROVAL OF AN
	)	ADDITIONAL POINT OF
	)	APPROPRIATION AND A CHANGE IN
	)	PLACE OF USE

Authority

Oregon Revised Statutes (ORS) 537.705 and 540.505 to 540.580 establish the process in which a water right holder may submit a request to transfer the point of appropriation, place of use, or character of use authorized under an existing water right. Oregon Administrative Rules (OAR) Chapter 690, Division 380 implement the statutes and provides the Department's procedures and criteria for evaluating transfer applications.

Applicant

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY OR 97448

Findings of Fact

1. On November 14, 2016, the CITY OF JUNCTION CITY filed an application for an additional point of appropriation and a change in place of use under Certificate 41697. The Department assigned the application number T-12523.
2. Notice of the application for transfer was published on November 29, 2016, pursuant to OAR 690-380-4000. No comments were filed in response to the notice.
3. On August 28, 2017, the Department mailed a copy of the draft Preliminary Determination proposing to deny Transfer Application T-12523 to the applicant. The draft Preliminary Determination cover letter set forth a deadline of September 27, 2017, for the applicant to respond.
4. On September 29, 2017, the applicant requested that the Department not proceed with issuance of a Preliminary Determination at this time.

Pursuant to OAR 690-380-4030, any person may file a protest or standing statement within 30 days after the last date of publication of notice of this preliminary determination.
--

5. The previous draft Preliminary Determination, mailed to the applicant on August 28, 2017, proposed to deny Transfer Application T-12523. On October 25, 2017, the Department mailed a revised draft Preliminary Determination proposing to approve Transfer Application T-12523.
6. On November 8, 2017, the applicant's agent submitted comments on the revised draft Preliminary Determination sent by the Department on October 25, 2017.
7. This second revised draft Preliminary Determination is prepared to address the comments received and to clarify that, for the purposes of injury review under OAR 690-380, a Ground Water Registration is not a water right subject to injury.
8. On November 27, 2017, the Department mailed a copy of the second revised draft Preliminary Determination proposing to approve Transfer Application T-12523 to the applicant. The draft Preliminary Determination cover letter set forth a deadline of December 27, 2017, for the applicant to respond. The applicant requested that the Department proceed with issuance of a Preliminary Determination and provided the necessary information to demonstrate that the applicant is authorized to pursue the transfer.
9. The right to be transferred is as follows:

Certificate: 41697 in the name of CITY OF JUNCTION CITY
(perfected under Permit G-4329)
Use: MUNICIPAL
Priority Date: SEPTEMBER 20, 1968
Rate: 1.11 CUBIC FEET PER SECOND
Source: A WELL within the WILLAMETTE RIVER BASIN

Authorized Point of Appropriation:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	915 FEET NORTH AND 595 FEET EAST FROM THE SW CORNER OF THE NESW OF SECTION 32

Authorized Place of Use:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW

10. Transfer Application T-12523 proposes an additional point of appropriation approximately 850 feet from the existing point of appropriation to:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	SE NW	3140 FEET NORTH AND 2930 FEET WEST OF THE SE CORNER OF SECTION 32

11. Transfer Application T-12523 also proposes to change the place of use of the right to:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	29	NW SE
15 S	4 W	WM	29	SW SE
15 S	4 W	WM	30	SE SW
15 S	4 W	WM	30	SW SE
15 S	4 W	WM	30	SE SE
15 S	4 W	WM	31	NE NE
15 S	4 W	WM	31	NW NE
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE NW
15 S	4 W	WM	31	NW NW
15 S	4 W	WM	31	SW NW
15 S	4 W	WM	31	SE NW
15 S	4 W	WM	31	NE SW
15 S	4 W	WM	31	NW SW
15 S	4 W	WM	31	SW SW
15 S	4 W	WM	31	SE SW
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
15 S	5 W	WM	36	NE NE
15 S	5 W	WM	36	NW NE
15 S	5 W	WM	36	SW NE
15 S	5 W	WM	36	SE NE
15 S	5 W	WM	36	NE SE
15 S	5 W	WM	36	NW SE
15 S	5 W	WM	36	SW SE

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	5 W	WM	36	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	SW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW
16 S	4 W	WM	5	SE NW
16 S	4 W	WM	5	NE SW
16 S	4 W	WM	5	NW SW
16 S	4 W	WM	5	SW SW
16 S	4 W	WM	5	SE SW
16 S	4 W	WM	5	NW SE
16 S	4 W	WM	6	NE NE
16 S	4 W	WM	6	NW NE
16 S	4 W	WM	6	SE NE
16 S	4 W	WM	8	NE NW
16 S	4 W	WM	8	NW NW
16 S	4 W	WM	8	SE NW
16 S	4 W	WM	8	NE SW
16 S	4 W	WM	8	SE SW
16 S	4 W	WM	17	SW NE
16 S	4 W	WM	17	NE NW
16 S	4 W	WM	17	SE NW
16 S	4 W	WM	17	NE SW
16 S	4 W	WM	17	SE SW
16 S	4 W	WM	17	NW SE
16 S	4 W	WM	17	SW SE
16 S	4 W	WM	20	NE NE
16 S	4 W	WM	20	NW NE
16 S	4 W	WM	20	SW NE
16 S	4 W	WM	20	SE NE
16 S	4 W	WM	20	NE NW
16 S	4 W	WM	20	SE NW
16 S	4 W	WM	20	NE SW
16 S	4 W	WM	20	SE SW
16 S	4 W	WM	20	NE SE
16 S	4 W	WM	20	NW SE
16 S	4 W	WM	20	SW SE
16 S	4 W	WM	20	SE SE
16 S	4 W	WM	21	SW SW

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	29	NW NE
16 S	4 W	WM	29	SW NE
16 S	4 W	WM	29	NE NW
16 S	4 W	WM	29	SE NW

Transfer Review Criteria (OAR 690-380-4010)

12. Water has been used within the last five years according to the terms and conditions of the right. There is no information in the record that would demonstrate that the right is subject to forfeiture under ORS 540.610.
13. A pump, pipeline, and sprinkler system sufficient to use the full amount of water allowed under the existing right were present within the five-year period prior to submittal of Transfer Application T-12523.
14. The proposed change would not result in enlargement of the right.
15. The proposed change would not result in injury to other water rights.
16. All other application requirements are met.

Determination and Proposed Action


The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 appears to be consistent with the requirements of ORS 537.705 and 540.505 to 540.580 and OAR 690-380-5000. If protests are not filed pursuant to OAR 690-380-4030, the application will be approved.


If Transfer Application T-12523 is approved, the final order will include the following:

1. *The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 are approved.*
2. *The right to the use of the water is restricted to beneficial use at the place of use described, and is subject to all other conditions and limitations contained in Certificate 41697 and any related decree.*
3. *Water right Certificate 41697 is cancelled. A new certificate will be issued describing that portion of the right not affected by this transfer.*
4. *The quantity of water diverted at the additional point of appropriation, together with that diverted at the original point of appropriation, shall not exceed the quantity of water lawfully available at the original point of appropriation.*

5. *Water shall be acquired from the same aquifer (water source) as the original point of appropriation.*
6. *Full beneficial use of the water shall be made, consistent with the terms of this order, on or before **October 1, 2023**. A Claim of Beneficial Use prepared by a Certified Water Right Examiner shall be submitted by the applicant to the Department within one year after the deadline for completion of the changes and full beneficial use of the water.*
7. *After satisfactory proof of beneficial use is received, a new certificate confirming the right transferred will be issued.*

Dated at Salem, Oregon this 4 day of December, 2017.

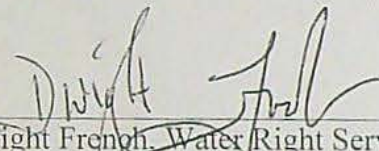
Dwight French, Water Right Services Administrator, for
Thomas M. Byler, Director
Oregon Water Resources Department

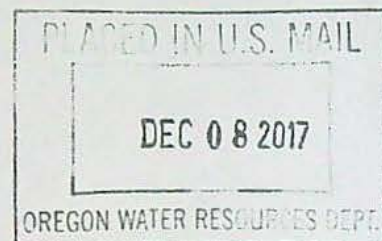

This Preliminary Determination was prepared by Jessica Joye. If you have questions about the information in this document, you may reach me at 503-986-0814 or Jessica.L.Joye@oregon.gov

Protests should be addressed to the attention of Water Rights Services Division, Water Resources Department, 725 Summer St. NE, Suite A, Salem, OR 97301-1266.

Notice Regarding Service Members: Active duty service members have a right to stay proceedings under the federal Service Members Civil Relief Act, 50 U.S.C. App. §§501-597b. You may contact the Oregon State Bar or the Oregon Military Department for more information. The toll-free telephone number for the Oregon State Bar is: 1 (800) 452-8260. The toll-free telephone number of the Oregon Military Department is: 1 (800) 452-7500. The Internet address for the United States Armed Forces Legal Assistance Legal Services Locator website is: <http://legalassistance.law.af.mil>



Oregon

Kate Brown, Governor

FILE

Water Resources Department
725 Summer St NE, Suite A
Salem, OR 97301
(503) 986-0900
Fax (503) 986-0904

November 27, 2017

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY, OR 97448

Reference: Water Right Transfer Application T-12523

Your water right transfer is in one of three phases of processing. Enclosed is a draft of our second revised Preliminary Determination regarding Transfer Application T-12523. The document reflects the Department's conclusion that, based on the information currently available, the transfer will be approved.

Items needed before the next phase of processing...

1. Please review the draft carefully to see if it accurately reflects the changes you intend to make, and to become familiar with all proposed conditions. **You will need to respond in writing** by the deadline provided below, whether you agree with the proposed action and conditions. Also we will appreciate having you let us know if there are typographical errors that need to be corrected.

Please note the proposed date by which all conditions must be met: October 1, 2023. If the required completion date is insufficient to comply with any of the conditions, you may extend the date at no cost to you during this stage of processing. Please let me know by the comment deadline so we can make the proper arrangements to get you the time you need.

What happens next...

Once the preliminary determination is issued a publication period is required. The Department will publish a notice in their weekly publication, which opens a 30-day period in which the transfer can be protested.

Issuance of the Preliminary Determination will occur shortly after we receive:

1. your written response to the conditions and proposed action in the draft Preliminary Determination (e-mail is acceptable).

If we do not receive the items listed above by December 27, 2017, a Preliminary Determination may be issued denying the application as incomplete.

Please do not hesitate to contact me at 503-480-9139 or Jessica.L.Joye@oregon.gov, if I may be of assistance.

Sincerely,

A handwritten signature in cursive script, appearing to read "Jessica Joye".

Jessica Joye
Reimbursement Authority Transfer Specialist
Transfer and Conservation Section

cc: Transfer Application file T-12523
Lanaya Blakely, District 2 Watermaster (*via e-mail*)
Steven R. Bruce, Agent for the applicant (*via e-mail*)

Encl.

**BEFORE THE WATER RESOURCES DEPARTMENT
OF THE
STATE OF OREGON**

In the Matter of Transfer Application
T-12523, Lane County

) **R E V I S E D**
)
) **D R A F T**
)
) PRELIMINARY DETERMINATION
) PROPOSING APPROVAL OF AN
) ADDITIONAL POINT OF
) APPROPRIATION AND A CHANGE IN
) PLACE OF USE

Authority

Oregon Revised Statutes (ORS) 537.705 and 540.505 to 540.580 establish the process in which a water right holder may submit a request to transfer the point of appropriation, place of use, or character of use authorized under an existing water right. Oregon Administrative Rules (OAR) Chapter 690, Division 380 implement the statutes and provides the Department's procedures and criteria for evaluating transfer applications.

Applicant

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY OR 97448

Findings of Fact

1. On November 14, 2016, the CITY OF JUNCTION CITY filed an application for an additional point of appropriation and a change in place of use under Certificate 41697. The Department assigned the application number T-12523.
2. Notice of the application for transfer was published on November 29, 2016, pursuant to OAR 690-380-4000. No comments were filed in response to the notice.
3. On August 28, 2017, the Department mailed a copy of the draft Preliminary Determination proposing to deny Transfer Application T-12523 to the applicant. The draft Preliminary Determination cover letter set forth a deadline of September 27, 2017, for the applicant to respond.
4. On September 29, 2017, the applicant requested that the Department not proceed with issuance of a Preliminary Determination at this time.

5. The right to be transferred is as follows:

Certificate: 41697 in the name of CITY OF JUNCTION CITY
(perfected under Permit G-4329)
Use: MUNICIPAL
Priority Date: SEPTEMBER 20, 1968
Rate: 1.11 CUBIC FEET PER SECOND
Source: A WELL within the WILLAMETTE RIVER BASIN

Authorized Point of Appropriation:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	915 FEET NORTH AND 595 FEET EAST FROM THE SW CORNER OF THE NESW OF SECTION 32

Authorized Place of Use:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW

6. Transfer Application T-12523 proposes an additional point of appropriation approximately 850 feet from the existing point of appropriation to:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	SE NW	3140 FEET NORTH AND 2930 FEET WEST OF THE SE CORNER OF SECTION 32

7. Transfer Application T-12523 also proposes to change the place of use of the right to:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	29	NW SE
15 S	4 W	WM	29	SW SE
15 S	4 W	WM	30	SE SW
15 S	4 W	WM	30	SW SE
15 S	4 W	WM	30	SE SE
15 S	4 W	WM	31	NE NE
15 S	4 W	WM	31	NW NE
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE NW
15 S	4 W	WM	31	NW NW
15 S	4 W	WM	31	SW NW
15 S	4 W	WM	31	SE NW
15 S	4 W	WM	31	NE SW
15 S	4 W	WM	31	NW SW
15 S	4 W	WM	31	SW SW
15 S	4 W	WM	31	SE SW
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
15 S	5 W	WM	36	NE NE
15 S	5 W	WM	36	NW NE
15 S	5 W	WM	36	SW NE
15 S	5 W	WM	36	SE NE
15 S	5 W	WM	36	NE SE
15 S	5 W	WM	36	NW SE
15 S	5 W	WM	36	SW SE
15 S	5 W	WM	36	SE SE
16 S	4 W	WM	5	NW NE

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	5	SW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW
16 S	4 W	WM	5	SE NW
16 S	4 W	WM	5	NE SW
16 S	4 W	WM	5	NW SW
16 S	4 W	WM	5	SW SW
16 S	4 W	WM	5	SE SW
16 S	4 W	WM	5	NW SE
16 S	4 W	WM	5	SE NE
16 S	4 W	WM	6	NE NE
16 S	4 W	WM	6	NW NE
16 S	4 W	WM	6	SE NE
16 S	4 W	WM	8	NE NW
16 S	4 W	WM	8	NW NW
16 S	4 W	WM	8	SE NW
16 S	4 W	WM	8	NE SW
16 S	4 W	WM	8	SE SW
16 S	4 W	WM	17	SW NE
16 S	4 W	WM	17	NE NW
16 S	4 W	WM	17	SE NW
16 S	4 W	WM	17	NE SW
16 S	4 W	WM	17	SE SW
16 S	4 W	WM	17	NW SE
16 S	4 W	WM	17	SW SE
16 S	4 W	WM	20	NE NE
16 S	4 W	WM	20	NW NE
16 S	4 W	WM	20	SW NE
16 S	4 W	WM	20	SE NE
16 S	4 W	WM	20	NE NW
16 S	4 W	WM	20	SE NW
16 S	4 W	WM	20	NE SW
16 S	4 W	WM	20	SE SW
16 S	4 W	WM	20	NE SE
16 S	4 W	WM	20	NW SE
16 S	4 W	WM	20	SW SE
16 S	4 W	WM	20	SE SE
16 S	4 W	WM	21	SW SW
16 S	4 W	WM	29	NW NE
16 S	4 W	WM	29	SW NE
16 S	4 W	WM	29	NE NW
16 S	4 W	WM	29	SE NW

8. The previous draft Preliminary Determination, mailed to the applicant on August 28, 2017, proposed to deny Transfer Application T-12523. On October 25, 2017, the Department mailed a revised draft Preliminary Determination proposing to approve Transfer Application T-12523.
9. On November 8, 2017, the applicant's agent submitted comments on the revised draft Preliminary Determination sent by the Department on October 25, 2017.
10. This second revised draft Preliminary Determination is prepared to address the comments received and to clarify that, for the purposes of injury review under OAR 690-380, a Ground Water Registration is not a water right subject to injury.

Transfer Review Criteria (OAR 690-380-4010)

11. Water has been used within the last five years according to the terms and conditions of the right. There is no information in the record that would demonstrate that the right is subject to forfeiture under ORS 540.610.
12. A pump, pipeline, and sprinkler system sufficient to use the full amount of water allowed under the existing right were present within the five-year period prior to submittal of Transfer Application T-12523.
13. The proposed change would not result in enlargement of the right.
14. The proposed change would not result in injury to other water rights.
15. All other application requirements are met.

Determination and Proposed Action

The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 appears to be consistent with the requirements of ORS 537.705 and 540.505 to 540.580 and OAR 690-380-5000. If protests are not filed pursuant to OAR 690-380-4030, the application will be approved.

If Transfer Application T-12523 is approved, the final order will include the following:

1. *The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 are approved.*
2. *The right to the use of the water is restricted to beneficial use at the place of use described, and is subject to all other conditions and limitations contained in Certificate 41697 and any related decree.*
3. *The Watermaster may determine that it is necessary to regulate the use, as approved in this transfer, in favor of a senior water user.*

4. *Water right Certificate 41697 is cancelled. A new certificate will be issued describing that portion of the right not affected by this transfer.*
5. *The quantity of water diverted at the additional point of appropriation, together with that diverted at the original point of appropriation, shall not exceed the quantity of water lawfully available at the original point of appropriation.*
6. *Water shall be acquired from the same aquifer (water source) as the original point of appropriation.*
7. *Full beneficial use of the water shall be made, consistent with the terms of this order, on or before **October 1, 2023**. A Claim of Beneficial Use prepared by a Certified Water Right Examiner shall be submitted by the applicant to the Department within one year after the deadline for completion of the changes and full beneficial use of the water.*
8. *After satisfactory proof of beneficial use is received, a new certificate confirming the right transferred will be issued.*

Dated at Salem, Oregon this ____ day of November, 2017.

D R A F T

Dwight French, Water Right Services Administrator, for
Thomas M. Byler, Director
Oregon Water Resources Department

This draft Preliminary Determination was prepared by Jessica Joye. If you have questions about the information in this document, you may reach me at 503-986-0814 or Jessica.L.Joye@oregon.gov



Oregon

Kate Brown, Governor

FILE

Water Resources Department

725 Summer St NE, Suite A

Salem, OR 97301

(503) 986-0900

Fax (503) 986-0904

October 25, 2017

Applicant

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY, OR 97448

Reference: Water Right Transfer Application T-12523 (Revised)

Your water right transfer is in one of three phases of processing. Enclosed is a revised draft of our Preliminary Determination regarding Transfer Application T-12523. The document reflects the Department's conclusion that, based on the information currently available, the transfer will be approved.

Items needed before the next phase of processing...

1. Please review the draft carefully to see if it accurately reflects the changes you intend to make, and to become familiar with all proposed conditions. **You will need to respond in writing** by the deadline provided below, whether you agree with the proposed action and conditions. Also we will appreciate having you let us know if there are typographical errors that need to be corrected.

Please note the proposed date by which all conditions must be met: November 24, 2017. If the required completion date is insufficient to comply with any of the conditions, you may extend the date at no cost to you during this stage of processing. Please let me know by the comment deadline so we can make the proper arrangements to get you the time you need.

What happens next...

Once the preliminary determination is issued a publication period is required. The Department will publish a notice in their weekly publication, which opens a 30-day period in which the transfer can be protested.


Issuance of the Preliminary Determination will occur shortly after we receive:

1. your written response to the conditions and proposed action in the draft Preliminary Determination (e-mail is acceptable).

If we do not receive the items listed above by November 24, 2017, a Preliminary Determination may be issued denying the application as incomplete.

Please do not hesitate to contact me at 503-986-0814 or Jessica.L.Joye@oregon.gov, if I may be of assistance.

Sincerely,

A handwritten signature in blue ink that reads "Jessica Joye". The signature is fluid and cursive, with the first name "Jessica" being more prominent than the last name "Joye".

Jessica Joye
Reimbursement Authority Transfer Specialist
Transfer and Conservation Section

cc: Transfer Application file T-12523
Steven R. Bruce, Agent for the applicant (*via email*)
Martha Pagel, Agent for the applicant (*via email*)

**BEFORE THE WATER RESOURCES DEPARTMENT
OF THE
STATE OF OREGON**

In the Matter of Transfer Application
T-12523, Lane County

) **R E V I S E D**
)
) **D R A F T**
)
) PRELIMINARY DETERMINATION
) PROPOSING APPROVAL OF AN
) ADDITIONAL POINT OF
) APPROPRIATION AND A CHANGE IN
) PLACE OF USE

Authority

Oregon Revised Statutes (ORS) 537.705 and 540.505 to 540.580 establish the process in which a water right holder may submit a request to transfer the point of appropriation, place of use, or character of use authorized under an existing water right. Oregon Administrative Rules (OAR) Chapter 690, Division 380 implement the statutes and provides the Department's procedures and criteria for evaluating transfer applications.

Applicant

CITY OF JUNCTION CITY
ATTN: GARY KAPING
PO BOX 250
JUNCTION CITY OR 97448

Findings of Fact

1. On November 14, 2016, the CITY OF JUNCTION CITY filed an application for an additional point of appropriation and a change in place of use under Certificate 41697. The Department assigned the application number T-12523.
2. Notice of the application for transfer was published on November 29, 2016, pursuant to OAR 690-380-4000. No comments were filed in response to the notice.
3. On August 28, 2017, the Department mailed a copy of the draft Preliminary Determination proposing to deny Transfer Application T-12523 to the applicant. The draft Preliminary Determination cover letter set forth a deadline of September 27, 2017, for the applicant to respond.
4. On September 29, 2017, the applicant requested that the Department not proceed with issuance of a Preliminary Determination at this time.

5. The right to be transferred is as follows:

Certificate: 41697 in the name of CITY OF JUNCTION CITY
(perfected under Permit G-4329)
Use: MUNICIPAL
Priority Date: SEPTEMBER 20, 1968
Rate: 1.11 CUBIC FEET PER SECOND
Source: A WELL within the WILLAMETTE RIVER BASIN

Authorized Point of Appropriation:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	NE SW	915 FEET NORTH AND 595 FEET EAST FROM THE SW CORNER OF THE NESW OF SECTION 32

Authorized Place of Use:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
16 S	4 W	WM	5	NW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW

6. Transfer Application T-12523 proposes an additional point of appropriation approximately 850 feet from the existing point of appropriation to:

Twp	Rng	Mer	Sec	Q-Q	Measured Distances
15 S	4 W	WM	32	SE NW	3140 FEET NORTH AND 2930 FEET WEST OF THE SE CORNER OF SECTION 32

7. Transfer Application T-12523 also proposes to change the place of use of the right to:

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
15 S	4 W	WM	29	SW SW
15 S	4 W	WM	29	SE SW
15 S	4 W	WM	29	NW SE
15 S	4 W	WM	29	SW SE
15 S	4 W	WM	30	SE SW
15 S	4 W	WM	30	SW SE
15 S	4 W	WM	30	SE SE
15 S	4 W	WM	31	NE NE
15 S	4 W	WM	31	NW NE
15 S	4 W	WM	31	SW NE
15 S	4 W	WM	31	SE NE
15 S	4 W	WM	31	NE NW
15 S	4 W	WM	31	NW NW
15 S	4 W	WM	31	SW NW
15 S	4 W	WM	31	SE NW
15 S	4 W	WM	31	NE SW
15 S	4 W	WM	31	NW SW
15 S	4 W	WM	31	SW SW
15 S	4 W	WM	31	SE SW
15 S	4 W	WM	31	NE SE
15 S	4 W	WM	31	NW SE
15 S	4 W	WM	31	SW SE
15 S	4 W	WM	31	SE SE
15 S	4 W	WM	32	SW NE
15 S	4 W	WM	32	NE NW
15 S	4 W	WM	32	NW NW
15 S	4 W	WM	32	SW NW
15 S	4 W	WM	32	SE NW
15 S	4 W	WM	32	NE SW
15 S	4 W	WM	32	NW SW
15 S	4 W	WM	32	SW SW
15 S	4 W	WM	32	SE SW
15 S	4 W	WM	32	NW SE
15 S	4 W	WM	32	SW SE
15 S	4 W	WM	32	SE SE
15 S	5 W	WM	36	NE NE
15 S	5 W	WM	36	NW NE
15 S	5 W	WM	36	SW NE
15 S	5 W	WM	36	SE NE
15 S	5 W	WM	36	NE SE
15 S	5 W	WM	36	NW SE
15 S	5 W	WM	36	SW SE
15 S	5 W	WM	36	SE SE
16 S	4 W	WM	5	NW NE

MUNICIPAL				
Twp	Rng	Mer	Sec	Q-Q
16 S	4 W	WM	5	SW NE
16 S	4 W	WM	5	NE NW
16 S	4 W	WM	5	NW NW
16 S	4 W	WM	5	SW NW
16 S	4 W	WM	5	SE NW
16 S	4 W	WM	5	NE SW
16 S	4 W	WM	5	NW SW
16 S	4 W	WM	5	SW SW
16 S	4 W	WM	5	SE SW
16 S	4 W	WM	5	NW SE
16 S	4 W	WM	6	NE NE
16 S	4 W	WM	6	NW NE
16 S	4 W	WM	6	SE NE
16 S	4 W	WM	8	NE NW
16 S	4 W	WM	8	NW NW
16 S	4 W	WM	8	SE NW
16 S	4 W	WM	8	NE SW
16 S	4 W	WM	8	SE SW
16 S	4 W	WM	17	SW NE
16 S	4 W	WM	17	NE NW
16 S	4 W	WM	17	SE NW
16 S	4 W	WM	17	NE SW
16 S	4 W	WM	17	SE SW
16 S	4 W	WM	17	NW SE
16 S	4 W	WM	17	SW SE
16 S	4 W	WM	20	NE NE
16 S	4 W	WM	20	NW NE
16 S	4 W	WM	20	SW NE
16 S	4 W	WM	20	SE NE
16 S	4 W	WM	20	NE NW
16 S	4 W	WM	20	SE NW
16 S	4 W	WM	20	NE SW
16 S	4 W	WM	20	SE SW
16 S	4 W	WM	20	NE SE
16 S	4 W	WM	20	NW SE
16 S	4 W	WM	20	SW SE
16 S	4 W	WM	20	SE SE
16 S	4 W	WM	21	SW SW
16 S	4 W	WM	29	NW NE
16 S	4 W	WM	29	SW NE
16 S	4 W	WM	29	NE NW
16 S	4 W	WM	29	SE NW

8. The Department's Groundwater Section has determined that the use of the proposed additional point of appropriation will result in an increase in interference with another ground water right, Ground Water Registration GR-2915. The Registration Statement for GR-2915 reports that the authorized point of appropriation is a well with a total depth of 22 feet. At that depth, the well is likely producing from productive, coarser alluvial sediments (sands and gravels) that are efficiently hydraulically connected to surface water. However, the reported static water level in the GR-2915 well is 16 feet leaving only 6 feet of available water. Pumping impacts from the proposed additional point of appropriation could potentially lead to tens of feet of drawdown in the GR-2915 well.
9. The previous draft Preliminary Determination, mailed to the applicant on August 28, 2017, proposed to deny Transfer Application T-12523. This revised draft Preliminary Determination is issued because the Department has determined that Ground Water Registration GR-2915 is not presently subject to injury. However, Certificate 41697 is a junior water right to Ground Water Registration GR-2915 and may be regulated in favor of the senior Ground Water Registration GR-2915.

Transfer Review Criteria (OAR 690-380-4010)

10. Water has been used within the last five years according to the terms and conditions of the right. There is no information in the record that would demonstrate that the right is subject to forfeiture under ORS 540.610.
11. A pump, pipeline, and sprinkler system sufficient to use the full amount of water allowed under the existing right were present within the five-year period prior to submittal of Transfer Application T-12523.
12. The proposed change would not result in enlargement of the right.
13. The proposed change would not result in injury to other water rights.
14. All other application requirements are met.

Determination and Proposed Action

The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 appears to be consistent with the requirements of ORS 537.705 and 540.505 to 540.580 and OAR 690-380-5000. If protests are not filed pursuant to OAR 690-380-4030, the application will be approved.

If Transfer Application T-12523 is approved, the final order will include the following:

1. *The additional point of appropriation and a change in place of use proposed in Transfer Application T-12523 are approved.*
2. *The right to the use of the water is restricted to beneficial use at the place of use described, and is subject to all other conditions and limitations contained in Certificate 41697 and any related decree.*

3. *The Watermaster may determine that it is necessary to regulate the use, as approved in this transfer, in favor of a senior water user.*
4. *Water right Certificate 41697 is cancelled. A new certificate will be issued describing that portion of the right not affected by this transfer.*
5. *The quantity of water diverted at the additional point of appropriation, together with that diverted at the original point of appropriation, shall not exceed the quantity of water lawfully available at the original point of appropriation.*
6. *Water shall be acquired from the same aquifer (water source) as the original point of appropriation.*
7. *Full beneficial use of the water shall be made, consistent with the terms of this order, on or before October 1, 2023. A Claim of Beneficial Use prepared by a Certified Water Right Examiner shall be submitted by the applicant to the Department within one year after the deadline for completion of the changes and full beneficial use of the water.*
8. *After satisfactory proof of beneficial use is received, a new certificate confirming the right transferred will be issued.*

Dated at Salem, Oregon this ____ day of October, 2017.

D R A F T

Dwight French, Water Right Services Administrator, for
Thomas M. Byler, Director
Oregon Water Resources Department

This draft Preliminary Determination was prepared by Jessica Joye. If you have questions about the information in this document, you may reach me at 503-986-0814 or Jessica.L.Joye@oregon.gov

**Notice of Preliminary Determination for
Water Right Transfer T-12523**

T-12523 filed by City Of Junction City, Attn: Gary Kaping, PO Box 250, Junction City, Oregon 97448, proposes an additional point of appropriation and a change in place of use under Certificate 41697. The right allows the use of 1.11 cubic foot per second from a well in Sec. 32, T15S, R4W, W.M. for municipal use in Sects. 29, 31, and 32, T15S, R4W, WM and Sec. 5, T16S, R4W, WM. The applicant proposes an additional point of appropriation in Sec. 32, T15S, R 4W, WM. and to change the place of use to Sects. 29, 30, 31, and 32, T15S, R4W, WM, Sects. 36, T15S, R5W, WM, and Sects. 5, 6, 8, 17, 20, 21, and 29, T16S, R4W, WM . The Water Resources Department proposes to approve the transfer, based on the requirements of ORS Chapter 540 and OAR 690-380-5000.

Any person may protest the preliminary determination or may file a standing statement. Pursuant to OAR 690-380-4030(3) and OAR 690-382-9000, protests must raise all reasonably ascertainable issues and include all reasonably available arguments supporting the person's position. In addition, protests must be accompanied by a \$700 protest fee for non-applicant, or \$350 protest fee for applicant. A Water Right Transfer Protest Form is available at http://www.oregon.gov/OWRD/PUBS/docs/forms/TransferProtestForm09_09.pdf, or by calling 503-986-0807. Protests must be received by the Department on or before [30 days after WRD notice], or within 30 days of the last date of publication in a newspaper, whichever is later. If no protests are filed, the Department will issue a final order consistent with the preliminary determination.

Groundwater Transfer Review Summary Form

Transfer/PA # T- 12523

GW Reviewer M. Thoma Date Review Completed: 04-25-17

Summary of Enlargement (Same Source) Review:

☐ The proposed transfer fails to keep the original place of use from receiving water from the same source.

Summary of Injury Review:

☒ The proposed transfer will result in another, existing water right not receiving previously available water to which it is legally entitled.

Summary of Well Construction Assessment:

☐ The proposed POA does not have a well log.

☐ The proposed POA does not appear to meet current well construction standards. Route through Well Construction and Compliance Section.

This is only a summary. Documentation is attached and should be read thoroughly to understand the basis for determinations.



Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, Oregon 97301-1271
(503) 986-0900
www.wrd.state.or.us

Ground Water Review Form:

- ☒ Water Right Transfer
☐ Permit Amendment
☐ GR Modification
☐ Other

Application: T-12523

Applicant Name: City of Junction City

Proposed Changes: ☐ POA
☐ USE

☒ APOA
☒ POU

☐ SW→GW
☐ OTHER

☒ RA

Reviewer(s): Michael Thoma

Date of Review: 04/25/2017

The information provided in the application is insufficient to evaluate whether the proposed transfer may be approved because:

- ☐ The water well reports provided with the application do not correspond to the water rights affected by the transfer.
- ☐ The application does not include water well reports or a description of the well construction details sufficient to establish the ground water body developed or proposed to be developed.
- ☐ Other _____

1. Basic description of the changes proposed in this transfer: Transfer 1.11 cfs of use from a well (LANE 8367) on Certificate 41697 to an APOA (LANE 70495) and expand POU
2. Will the proposed POA develop the same aquifer (source) as the existing authorized POA?
☒ Yes ☐ No Comments: Both the existing POA and the proposed APOA will be producing from fine-grained (sand/clay), deep, alluvial sediments (Willamette Confining Unit described in Woodward et al., 1998)
3. a) Is there more than one source developed under the right (e.g., basalt and alluvium)?
☐ Yes ☒ No _____
- b) If yes, estimate the portion of the right supplied by each of the sources and describe any limitations that will need to be placed on the proposed change (rate, duty, etc.): _____
4. a) Will this proposed change, at its maximum allowed rate of use, likely result in an increase in interference with **another ground water right**?
☒ Yes ☐ No Comments: There are several mapped POAs in the vicinity of the POA and proposed APOA but all but one are owned by the city of Junction City so interference will not be considered for those. There is one claim, GR 2915 for irrigation of 15.2 acres, that is within 750 ft of the proposed APOA (~1400 ft from original POA) and may be impacted by the proposed change. GR 2915 is senior to Cert. 41697.
- b) If yes, would this proposed change, at its maximum allowed rate of use, likely result in another groundwater right not receiving the water to which it is legally entitled?

☒ Yes ☐ No If yes, explain: The Registration Statement for GR 2915 reports that the POA is a 22 ft deep well. At this depth the well is likely producing from productive, coarser alluvial sediments (sands and gravels) that are efficiently hydraulically connected to surface water. However, the reported SWL in the GR 2915 well is 16 ft leaving only 6 ft of available water and pumping impacts from the proposed APOA could potentially lead to 10s of feet of drawdown in the GR 2915 well and thus cause significant injury.

5. a) Will this proposed change, at its maximum allowed rate of use, likely result in an increase in interference with **another surface water source**?

☐ Yes ☒ No Comments: The proposed APOA is only slightly closer to the nearest surface water source, the Willamette River, and any additional interference would be insignificant and immeasurable.


b) If yes, at its maximum allowed rate of use, what is the expected change in degree of interference with any **surface water sources** resulting from the proposed change?


Stream: _____ ☐ Minimal ☐ Significant

Stream: _____ ☐ Minimal ☐ Significant

Provide context for minimal/significant impact: _____

6. What conditions or other changes in the application are necessary to address any potential issues identified above: If it could be established that the use of the proposed APOA will not significantly impair GR 2915 use, or an agreement with the owner of GR 2915 can be reached where the impairment is allowed, then this transfer could likely proceed.
7. Any additional comments: The analysis of injury in 4b was done using the Theis (1935) distance-drawdown equation. Values of transmissivity were taken from OWRD Pump Test database.

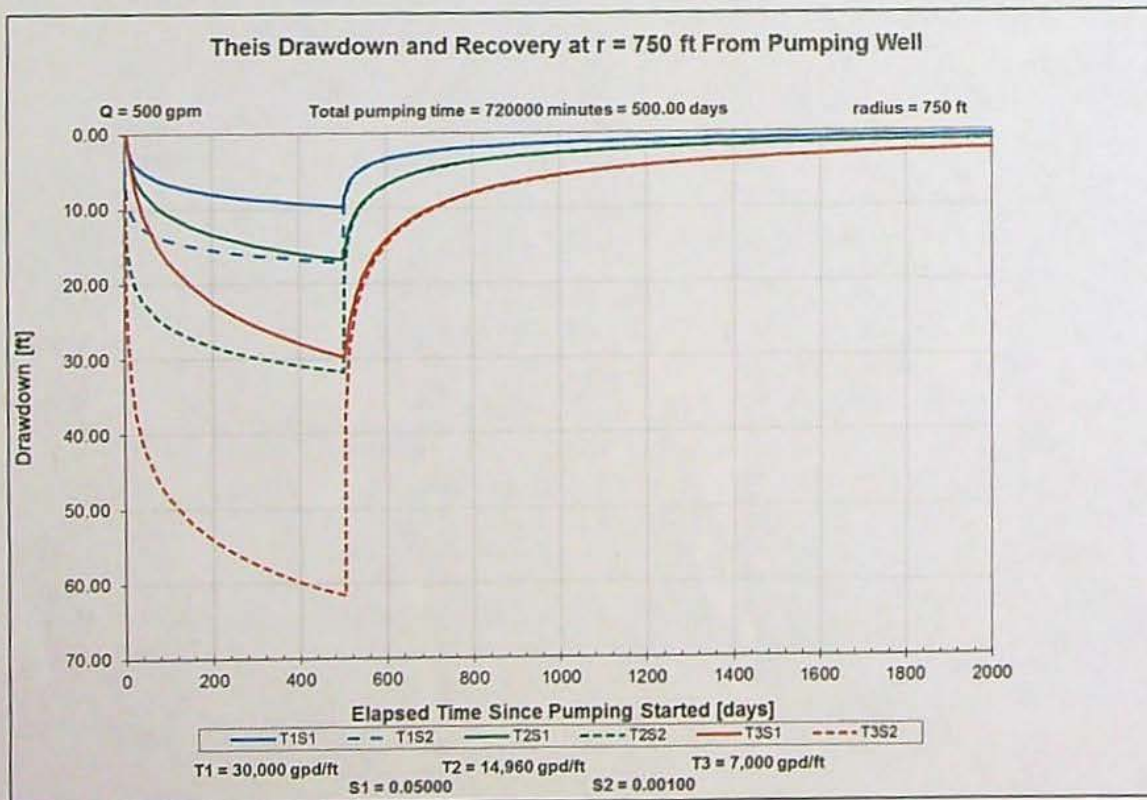

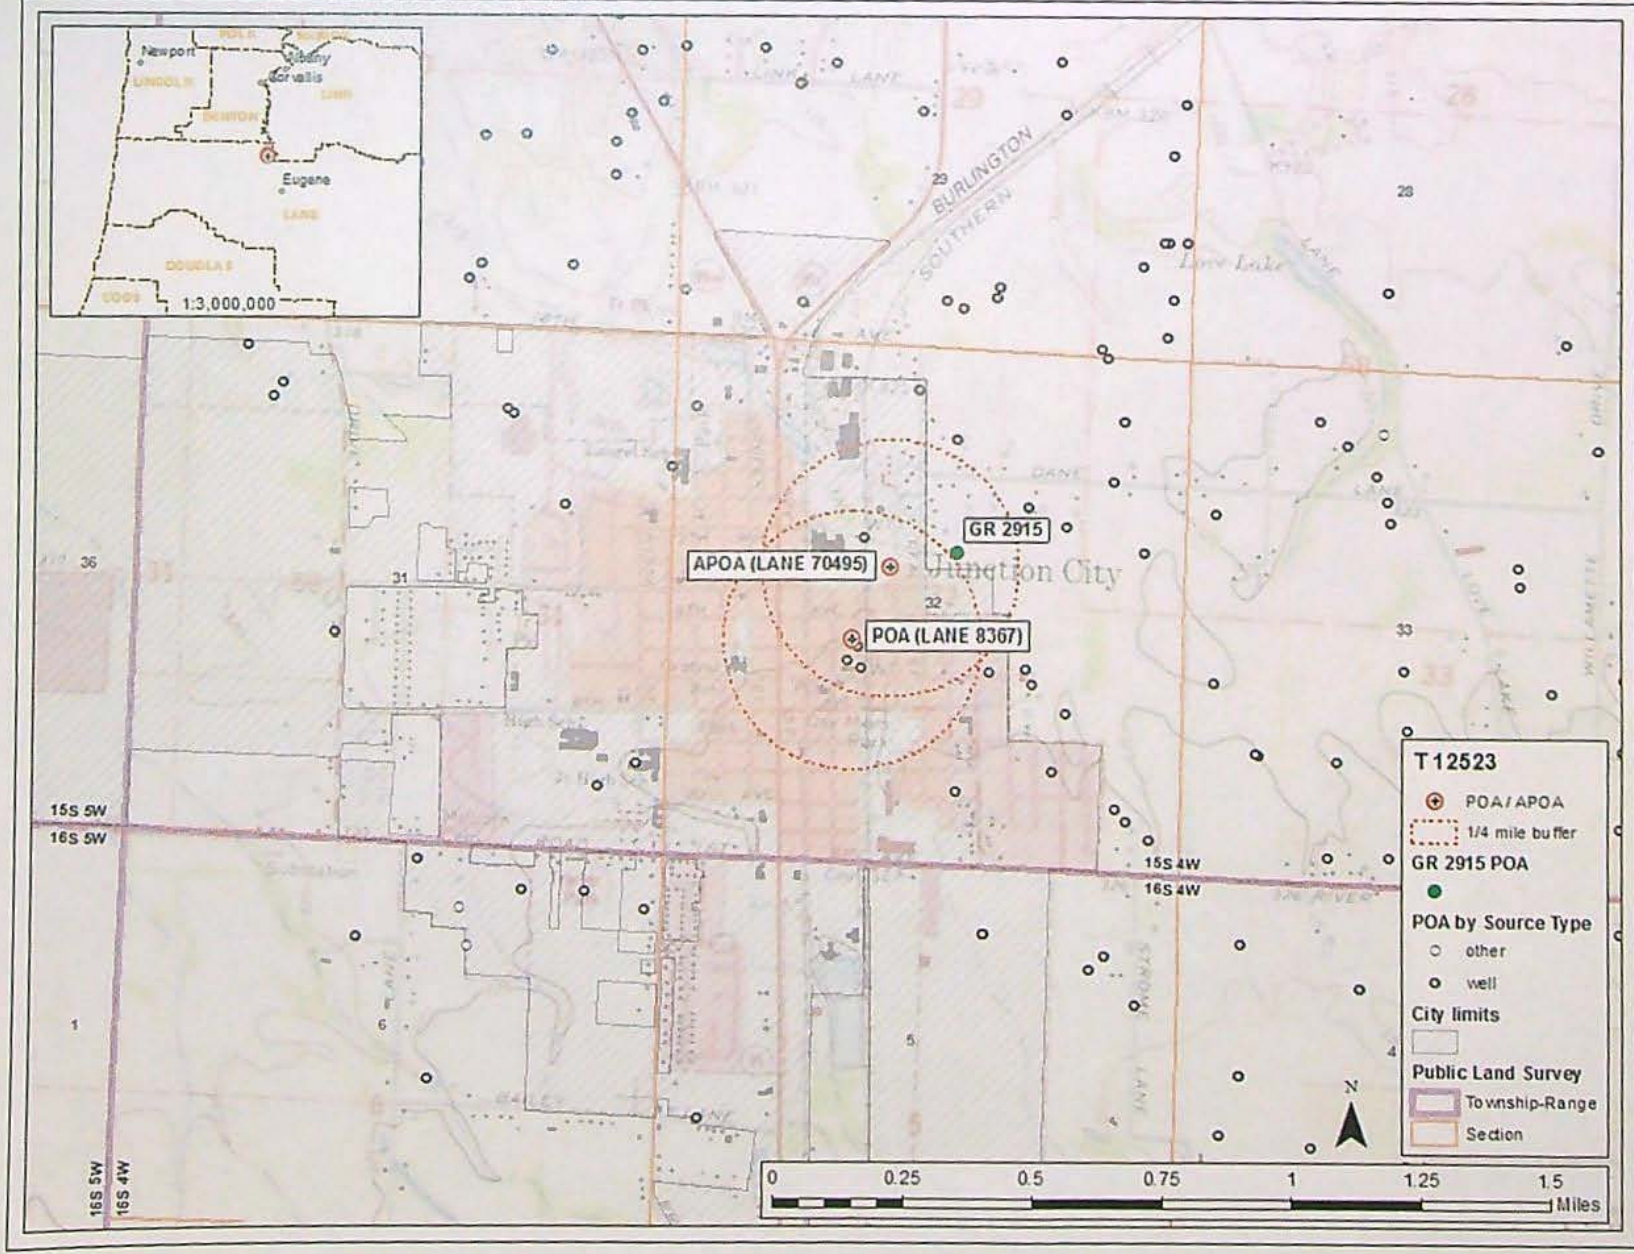



Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, Oregon 97301-1266
(503) 986-0900
www.wrd.state.or.us

Watermaster Review Form: Water Right Transfer

Transfer Application: T-12523

Review Due Date: 1/22/2016

Applicant Name: City of Junction City

Proposed Changes: ☒ POU ☐ POD ☒ POA ☐ USE ☐ OTHER

Reviewer(s): M. Mattick

Date of Review: Apr. 14, 2017

1. Do you have evidence that the right has not been used in the last 5 years and that the presumption of forfeiture would not likely be rebuttable? ☐ Yes ☒ No If "yes", attach evidence (e.g. dated aerial photo showing pavement or building on the land for >5 yrs.)
2. Is there a history of regulation on the source that serves this (or these) right(s) that has involved the transferred right(s) and downstream water rights? ☐ Yes ☒ No
Generally characterize the frequency of any regulation or explain why regulation has not occurred: _____
3. Have headgate notices been issued for the source that serves the transferred right(s)?
☐ Yes ☒ No ☐ Records not available.
4. In your estimation, after the proposed change would distribution of water for the right(s) result in regulation of other water rights that would not have occurred if use under the original right(s) was/were maximized?
☐ Yes ☒ No If "Yes", explain: _____
5. In your estimation, if the proposed change is approved, are there upstream water rights that would be affected? ☐ Yes ☒ No If "Yes", describe how the rights would be affected and list the rights most affected: _____
6. Check here ☐ if it appears that downstream water rights benefit from return flows resulting from the current use of the transferred right(s)? If you check the box, generally characterize the locations where the return flows likely occur and list the water rights that benefit most: _____
☒ N/A
7. For POD changes and instream transfers, check here ☐ if there are channel losses between the old and new PODs or within the proposed instream reach? If you check the box, describe and, if possible, estimate the losses: _____
☒ N/A
8. For instream transfers that propose protection of a reach beyond the mouth of the source stream: ☒ N/A Would the quantity be measureable into the receiving stream consistent with OAR 690-077-0015(8)? ☐ Yes ☐ No
9. For POU changes: ☐ N/A Is it likely the original place of use would continue to receive water from the same source? ☒ Yes ☐ No If "Yes", explain: This is to expand the service area of a municipality. I think that is OK.

10. For POU or USE changes: ☐ N/A In your best judgment, would use of the existing right at "full face value," result in the diversion of more water than can be used beneficially and without waste? ☐ Yes ☒ No If "Yes", explain: _____
11. Are there other issues not identified through the above questions that should be considered in determining whether the change "can be effected without injury to other rights"? ☐ Yes ☒ No If "Yes", explain: _____
12. What alternatives may be available for addressing any issues identified above: NA
13. Do conditions need to be included in the transfer order to avoid enlargement of the right or injury to other rights? ☐ No ☐ Yes, as checked below:
- ☐ A Headgate should be required prior to diverting water.
- ☐ Measurement Devices for POD or POA: (if this condition is selected, also fill in the top sections of page 3)
- a. *Before water use may begin under this order, the water user shall install a **totalizing flow meter***, or, with prior approval of the Director, another suitable measuring device, ☐ at each point of diversion/appropriation (new and existing) or ☐ at each new point of diversion/appropriation.*
- b. *The water user shall maintain the meters or measuring devices in good working order.*
- c. *The water user shall allow the Watermaster access to the meters or measuring devices; provided however, where the meters or measuring devices are located within a private structure, the Watermaster shall request access upon reasonable notice.*
- ☐ Reservoir water use measurement: (if this condition is selected, also fill in the top sections of page 3)
- a. *Before water use may begin under this order, the water user shall install **staff gages***, or, with prior approval of the Director, other suitable measuring devices, that measure the entire range and stage between empty and full in each reservoir. Staff gages shall be United States Geological Survey style.*
- b. *Before water use may begin under this order, if the reservoir is located in channel, weirs or other suitable measuring devices must be installed upstream and downstream of the reservoir, and, an adjustable outlet valve must be installed. The water user shall maintain such devices in good working order. A written waiver may be obtained, if in the judgment of the Director, the installation of weirs or other suitable measuring devices, or the adjustable outlet valve, will provide no public benefit.*

* The following alternative device(s) should be substituted for the bold, underlined device in the above selected condition:

- | | |
|---|--|
| ☐ Weir | ☐ Submerged Orifice |
| ☐ Parshall Flume | ☐ Flow Restrictor |
| ☐ Other: _____ | |

Oregon Water Resources Department**Measurement Condition Information for the Applicant***(to be sent with the Draft Preliminary Determination or Final Order)*

Transfer #: T-_____

☐ In order to avoid enlargement of the right or injury to other rights, a _____ will be required to be installed **prior to diversion of water**, as a condition of this transfer:

☐ at each point of diversion/appropriation (new and existing) **or**

☐ at each new point of diversion/appropriation.

For additional information, or to obtain approval of a different type of measurement device, the applicant should contact the area Watermaster:

Watermaster name: _____

District: _____

Address: _____

City/State/Zip: _____

Phone: _____

Email: _____

Note: If a device other than the one specified in the Preliminary Determination or Final Order is approved by the Watermaster, fill out and mail the form below to the Salem office.

Approval of an Alternate Measurement Device

T-_____

(to be filled out after consultation with the applicant, or after a site visit)

On behalf of the Director, I authorize use of the following suitable **alternate measurement device**:

Watermaster signature

District

Date

If this form is used for approval of an alternative measurement device, it must be mailed to:

Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, OR 97301-1266

10-3-17 - updated
Stakeholder
info. to incl.
Martha Pagel.
-JPagel

JOYE Jessica L * WRD

From: Pagel, Martha <MPagel@SCHWABE.com>
Sent: Friday, September 29, 2017 2:10 PM
To: JOYE Jessica L * WRD
Cc: FRENCH Dwight W * WRD; 'Gary Kaping'; 'Steve Bruce'
Subject: City of Junction City (T-12523)
Attachments: SKM_C65817092814370.pdf

Hi Jessica,

I am writing on behalf of the City of Junction City regarding the above-referenced transfer application, and in response to the draft Preliminary Determination letter that was sent directly to the City on August 28, 2017. Unfortunately, I did not receive a copy of the letter and was unaware that the draft PD had been sent until yesterday. I do apologize for the delay in responding to the September 27 deadline set in the letter, and hope it will be possible to arrange for additional time to address the question of potential injury. As you may know, I have been in communication with the Department on that issue since early August, and it appears we will need a little more time to continue the discussions. Accordingly, we ask that you not proceed with issuance of the final Preliminary Determination at this time.

If you have questions or need additional information from us, please let me know. Would you also please add me to the "cc" list to receive copies of any future correspondence with the City regarding the application.

Thank you for your assistance.

Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com

JOYE Jessica L * WRD

From: JARAMILLO Lisa J * WRD
Sent: Monday, November 27, 2017 1:39 PM
To: JOYE Jessica L * WRD
Subject: RE: T-12523 - City of Junction City

Great! Thank you!!! ☺

Lisa J. Jaramillo

Transfer and Conservation Section Manager
Water Right Services Division
Oregon Water Resources Department
Phone: 503-986-0880
Lisa.J.Jaramillo@oregon.gov

From: JOYE Jessica L * WRD
Sent: Monday, November 27, 2017 1:38 PM
To: JARAMILLO Lisa J * WRD
Subject: RE: T-12523 - City of Junction City

Awesome! Thanks, Lisa. I'm going to get this sent out today ☺

From: JARAMILLO Lisa J * WRD
Sent: Monday, November 27, 2017 1:37 PM
To: JOYE Jessica L * WRD
Subject: RE: T-12523 - City of Junction City

Hi Jessica,

I would just add the word "revised" to Finding #9:

9. On November 8, 2017, the applicant's agent submitted comments on the revised draft Preliminary Determination sent by the Department on October 25, 2017.

Thanks.... looks good!
-Lisa

Lisa J. Jaramillo

Transfer and Conservation Section Manager
Water Right Services Division
Oregon Water Resources Department
Phone: 503-986-0880
Lisa.J.Jaramillo@oregon.gov

From: JOYE Jessica L * WRD
Sent: Monday, November 27, 2017 1:34 PM

To: JARAMILLO Lisa J * WRD
Subject: RE: T-12523 - City of Junction City

Hi Lisa,

I've addressed your questions. Thank you for the edits. If you don't mind, please check to make sure that I've clarified everything ☺

Thanks so much,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



From: JARAMILLO Lisa J * WRD
Sent: Monday, November 27, 2017 1:20 PM
To: JOYE Jessica L * WRD
Subject: T-12523 - City of Junction City

Hi Jessica,

Please see my questions/edits attached. Feel free to let me know if you feel other language is warranted.

Thanks for getting this drafted so quickly.

-Lisa

Lisa J. Jaramillo

Transfer and Conservation Section Manager

Water Right Services Division

Oregon Water Resources Department

Phone: 503-986-0880

Lisa.J.Jaramillo@oregon.gov

JOYE Jessica L * WRD

From: Gary Kaping <gkaping@ci.junction-city.or.us>
Sent: Monday, December 04, 2017 7:27 AM
To: JOYE Jessica L * WRD; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD; Jeremy Tracer
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Great, thanks.

Gary

From: JOYE Jessica L * WRD [mailto:Jessica.L.Joye@oregon.gov]
Sent: Monday, December 04, 2017 7:26 AM
To: Gary Kaping; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD; Jeremy Tracer
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Good morning Gary,

Yes, I've received this email. The preliminary determination is in peer review and should be issued by the end of the week.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



From: Gary Kaping [mailto:gkaping@ci.junction-city.or.us]
Sent: Monday, December 04, 2017 6:49 AM
To: JOYE Jessica L * WRD; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD; Jeremy Tracer
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Jessica,

Just checking in to make sure you received this email. Please let me know if you need anything else from the City of Junction City.

Thanks,

Gary L. Kaping
Public Works Director
City of Junction City
541-998-3125

From: Gary Kaping
Sent: Tuesday, November 28, 2017 6:37 AM
To: 'JOYE Jessica L * WRD'; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Jessica,

The City of Junction City agrees with the conditions and proposal in the draft preliminary determination and would like to move forward with the water rights transfer application T-12523.
Please let me know if you need anything else from the City in order to move forward.

Thanks,

Gary L. Kaping
Public Works Director
City of Junction City
541-998-3125

From: JOYE Jessica L * WRD [<mailto:Jessica.L.Joye@oregon.gov>]
Sent: Monday, November 27, 2017 2:04 PM
To: Gary Kaping; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City


Good Afternoon,

Please see attached second revised draft preliminary determination. If you have any questions or comments please feel free to contact me.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301
Ph: 503 986-0814 | Fax: 503 986-0901
Email: Jessica.L.Joye@oregon.gov



From: JOYE Jessica L * WRD
Sent: Wednesday, November 22, 2017 8:03 AM
To: 'Gary Kaping'; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Good Morning Gary,

I will be setting up a meeting with Lisa and Dwight next week to go over the draft preliminary determination comments submitted.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301
Ph: 503 986-0814 | Fax: 503 986-0901
Email: Jessica.L.Joye@oregon.gov



From: Gary Kaping [<mailto:gkaping@ci.junction-city.or.us>]
Sent: Wednesday, November 22, 2017 7:56 AM
To: Pagel, Martha; JOYE Jessica L * WRD
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Martha,

Just checking in to see if have you received a response to your letter yet?

Gary

From: Pagel, Martha [<mailto:MPagel@SCHWABE.com>]
Sent: Wednesday, November 08, 2017 11:20 AM
To: 'JOYE Jessica L * WRD'

Cc: Gary Kaping; 'Steve Bruce'; 'FRENCH Dwight W * WRD'

Subject: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Hi Jessica,

Please see the attached letter with comments on the draft preliminary determination.

If you have questions or need any additional information from the City, please let us know.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com

NOTICE: This email may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

JOYE Jessica L * WRD

From: Pagel, Martha <MPagel@SCHWABE.com>
Sent: Wednesday, November 08, 2017 11:20 AM
To: JOYE Jessica L * WRD
Cc: 'Gary Kaping'; 'Steve Bruce'; FRENCH Dwight W * WRD
Subject: Comments on Draft Preliminary Determination for T-12523/City of Junction City
Attachments: ScanAttachment.pdf

Hi Jessica,

Please see the attached letter with comments on the draft preliminary determination.

If you have questions or need any additional information from the City, please let us know.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com

NOTICE: This email may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

NOV 08 2017

OWRD

November 8, 2017

Martha O. Pagel

Admitted in Oregon and Washington
T: 503-540-4260
mpagel@schwabe.com

VIA E-MAIL (JESSICA.L.JOYE@OREGON.GOV)

Jessica Joye
Reimbursement Authority Transfer Specialist
Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, OR 97301-1271

RE: Comments on Draft Preliminary Determination for City of Junction City (T-12523)

Dear Ms. Joye:

I am writing on behalf of our client, the City of Junction City, to provide comments on the Draft Preliminary Determination ("PD") for Transfer Application T-12523.

Although the City is in agreement with other findings and conclusions reflected in the Draft PD, the City objects to the proposed wording of Findings of Fact 8 and 9, relating to potential impacts on a nearby water use authorized under a groundwater registration statement. The City hereby requests Finding of Fact 8 be deleted and Finding of Fact 9 be modified as follows to clarify the Department's determinations:

The previous draft Preliminary Determination, mailed to the applicant on August 28, 2017, proposed to deny Transfer Application T-12523 on the basis of a finding that the proposed change would result in injury to another existing ground water right, Ground Water Registration GR-2915. This revised draft Preliminary Determination is issued because the Department has determined that an un-adjudicated ground water registration is not subject to injury under ORS 540.530 and OAR 690-380-4010 until such time as the right is adjudicated and confirmed pursuant to ORS 537.670 to 537.695. Following adjudication, any groundwater right confirmed under GR-2915 may be entitled to regulation on the basis of a priority date senior to the water right to be modified under this transfer application.


Because of the Department's determination that a ground water registration is not subject to injury, the detailed information contained in Finding of Fact 8 is unnecessary and could be confusing. Because the Department does not regulate in favor of or against un-adjudicated claims, we think the last sentence in Finding 9, as currently drafted, should be deleted. The other wording changes recommended above are intended to help clarify the current and potential future status of the groundwater use claimed under GR-2915.

Jessica Joye
November 8, 2017
Page 2

In its current state, we understand the groundwater registration is not subject to injury for purposes of the transfer process. In the future, if the registration were ultimately approved through an adjudication proceeding, we understand the confirmed water right would then be entitled to protection on the basis of priority date in the same manner as other duly issued rights. Notwithstanding these determinations, we wish to note that the City has been working cooperatively with the owner of the well authorized under the groundwater registration and has obtained his consent to proceed with the proposed transfer. We would be happy to provide this documentation for your records, if desired.

Thank you for the opportunity to comment on the draft PD. Please feel free to contact me if you have questions or would like to discuss the proposed changes in further detail.

Sincerely,

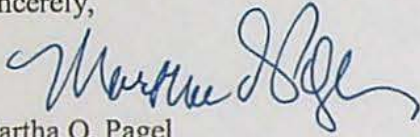

Martha O. Pagel

MOP

cc: *(all via email)*
Dwight French
Gary Kaping
Steven R. Bruce RG CWRE

PDX\126949\194318\MOP\21806161.1

RECEIVED

NOV 08 2017

OWRD

JOYE Jessica L * WRD

From: JOYE Jessica L * WRD
Sent: Wednesday, October 25, 2017 9:09 AM
To: 'Pagel, Martha'; 'Steve Bruce'; 'Gary Kaping'
Cc: FRENCH Dwight W * WRD; JARAMILLO Lisa J * WRD
Subject: Transfer Application T-12523 - City of Junction City
Attachments: T-12523-dpd+cov ltr.pdf

Good Morning,

Attached you will find the revised draft preliminary determination for Transfer Application T-12523. In addition to emailed copies, hard copies will be sent out in the mail today.

Please feel free to contact me if you have any questions about the attached draft preliminary determination.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



JOYE Jessica L * WRD

From: JOYE Jessica L * WRD
Sent: Wednesday, October 25, 2017 9:18 AM
To: 'Pagel, Martha'; 'Steve Bruce'; 'Gary Kaping'
Cc: FRENCH Dwight W * WRD; JARAMILLO Lisa J * WRD
Subject: RE: Transfer Application T-12523 - City of Junction City
Attachments: T-12523-dpd cov. ltr(rev. 10-25-17).pdf

The date set forth in the first cover letter falls on a holiday and I've revised the date to respond in writing to the DPD to Monday, November 27, 2017. I apologize for the oversight. Have a good day.


Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



From: JOYE Jessica L * WRD
Sent: Wednesday, October 25, 2017 9:09 AM
To: 'Pagel, Martha'; 'Steve Bruce'; 'Gary Kaping'
Cc: FRENCH Dwight W * WRD; JARAMILLO Lisa J * WRD
Subject: Transfer Application T-12523 - City of Junction City

Good Morning,

Attached you will find the revised draft preliminary determination for Transfer Application T-12523. In addition to emailed copies, hard copies will be sent out in the mail today.

Please feel free to contact me if you have any questions about the attached draft preliminary determination.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov

JOYE Jessica L * WRD

From: Gary Kaping <gkaping@ci.junction-city.or.us>
Sent: Tuesday, November 28, 2017 6:38 AM
To: JOYE Jessica L * WRD; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Jessica,

The City of Junction City agrees with the conditions and proposal in the draft preliminary determination and would like to move forward with the water rights transfer application T-12523.
Please let me know if you need anything else from the City in order to move forward.

Thanks,

Gary L. Kaping
Public Works Director
City of Junction City
541-998-3125

From: JOYE Jessica L * WRD [<mailto:Jessica.L.Joye@oregon.gov>]
Sent: Monday, November 27, 2017 2:04 PM
To: Gary Kaping; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD; BLAKELY Lanaya F * WRD; JARAMILLO Lisa J * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Good Afternoon,

Please see attached second revised draft preliminary determination. If you have any questions or comments please feel free to contact me.


Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



From: JOYE Jessica L * WRD
Sent: Wednesday, November 22, 2017 8:03 AM
To: 'Gary Kaping'; Pagel, Martha
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Good Morning Gary,

I will be setting up a meeting with Lisa and Dwight next week to go over the draft preliminary determination comments submitted.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



From: Gary Kaping [<mailto:gkaping@ci.junction-city.or.us>]
Sent: Wednesday, November 22, 2017 7:56 AM
To: Pagel, Martha; JOYE Jessica L * WRD
Cc: 'Steve Bruce'; FRENCH Dwight W * WRD
Subject: RE: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Martha,

Just checking in to see if have you received a response to your letter yet?

Gary

From: Pagel, Martha [<mailto:MPagel@SCHWABE.com>]
Sent: Wednesday, November 08, 2017 11:20 AM
To: 'JOYE Jessica L * WRD'
Cc: Gary Kaping; 'Steve Bruce'; 'FRENCH Dwight W * WRD'
Subject: Comments on Draft Preliminary Determination for T-12523/City of Junction City

Hi Jessica,

Please see the attached letter with comments on the draft preliminary determination.

If you have questions or need any additional information from the City, please let us know.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293


mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com



NOTICE: This email may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

HENDERSON Sarah A * WRD

From: HENDERSON Sarah A * WRD
Sent: Monday, July 31, 2017 2:02 PM
To: Pagel, Martha
Cc: 'IVERSON Justin T'; 'Steve Bruce'; 'Gary Kaping'; THOMA Michael J * WRD
Subject: RE: T-12523 - City of Junction City
Attachments: Affidavit of Agreement-example.pdf

Hi Martha,

After a discussion with Kelly Starnes , the Department will need to have the GR cancelled or an affidavit of consent to injure (example attached) from the GR owner(s) in order to move forward without injury.

If the GR is in place and has not been cancelled by a court or the Department, the two options that are available are the voluntary cancellation or affidavit of consent.

Please let me know if you have any other questions.

Sarah

Sarah Henderson | Transfer Specialist, Transfer and Conservation Division
Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301
Ph: 503.986.0890 | Fax: 503.986.0901
Email: sarah.a.henderson@oregon.gov | Web: <http://www.wrd.state.or.us>

From: Pagel, Martha [mailto:MPagel@SCHWABE.com]
Sent: Monday, July 31, 2017 11:25 AM
To: THOMA Michael J * WRD; HENDERSON Sarah A * WRD
Cc: 'IVERSON Justin T'; 'Steve Bruce'; 'Gary Kaping'
Subject: RE: T-12523 - City of Junction City

Mike and Sarah,

I'm checking back to see if you have had a chance to consider the additional information we provided regarding the apparent conversion of much of the "GR" place of use from irrigation to residential housing. In addition, I have since learned the GR well may no longer be functional/in existence at all. If that is the case, it seems that we would no longer have an injury issue. Is there something the applicant should do at this point to confirm/document the additional information in order to move forward with the transfer?

Thank you,
Martha

Schwabe Williamson & Wyatt
Martha Pagel
Attorney

530 Center St NE, Ste 730
Salem, OR 97301
Direct: 503-540-4260
Cell: 503-507-7293

mpagel@schwabe.com

[Vcard](#)

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com

From: Pagel, Martha

Sent: Wednesday, July 19, 2017 12:39 PM

To: 'Michael.J.Thoma@oregon.gov' <Michael.J.Thoma@oregon.gov>; 'HENDERSON Sarah A * WRD'

<Sarah.A.Henderson@oregon.gov>

Cc: 'IVERSON Justin T' <justin.t.iverson@state.or.us>; 'Steve Bruce' <steve@skookumwater.com>; 'Gary Kaping'

<gkaping@ci.junction-city.or.us>

Subject: T-12523 - City of Junction City

Hi Mike and Sarah,

I am working with Steve Bruce on this application for the City of Junction City, and I wanted to follow-up with you both regarding the injury analysis and next steps.

Since receiving Mike's email (below), we have taken a closer look at GR-2915, the existing water right that was identified as potentially being affected by the transfer. Based on aerial photos and city records, we have confirmed that since at least 2009, about 60% of the place of use claimed under the GR has been converted to a residential subdivision that is served by City water. It is unclear whether the remainder of the site is being irrigated, but we are wondering whether this substantial reduction in the use subject to the claim in combination with the unproven nature and unenforceable legal status of a GR claim in the first place, would make a difference in the injury analysis? Could you please take another look and let us know.

We would be happy to provide additional details, or to schedule a meeting or conference call to discuss this further.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

[Vcard](#)

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

From: THOMA Michael J * WRD [<mailto:Michael.J.Thoma@oregon.gov>]
Sent: Saturday, June 10, 2017 10:29 AM
To: Steve Bruce <steve@skookumwater.com>; HENDERSON Sarah A * WRD <Sarah.A.Henderson@oregon.gov>
Cc: 'Gary Kaping' <gkaping@ci.junction-city.or.us>; IVERSON Justin T * WRD <Justin.T.Iverson@oregon.gov>
Subject: RE: Junction City Pumping Test Memorandum

Hi Steve,

Sorry I didn't get to this yesterday.

I talked this over internally and we came to the conclusion that it is the Department's stance that injury, as defined in OAR 690-380-0100 (see below), does not require a well to fully penetrate the aquifer. Therefore I don't think we will be changing our finding in the review. The requirement to fully penetrate the aquifer comes in with how the Department handles interference (one well over-pumping and drawing down another well). I know it seems like we're splitting hairs but that is our current stance, as I understand it.

I have also looked over the report summary of the aquifer test that you sent and, unfortunately I could not find anything in there to change my finding. I agree with the interpretation of the fine-grained layer between the upper and lower aquifer zones and I suspect that it would likely limit interference between the city's well and the claim's well, but without a reasonable model that demonstrates that (e.g., a three-layer interference model, which I don't believe AQTESOLV is capable of), we will have to err on the side of over-protection rather than under-protection.

So at this point I can think of two options for moving forward:

- 1) contacting Sarah to work on developing an agreement with the holders of the nearby claim
 - 2) preparing and submitting a model that predicts drawdown with the claim's well and shows it is minimal
- There may be other options worth pursuing and these are only my thoughts.

Feel free to contact me with any questions

- Mike

OAR 690-380-0100

http://arcweb.sos.state.or.us/pages/rules/oars_600/oar_690/690_380.html

(3) "Injury" or "Injury to an existing water right" means a proposed transfer would result in another, existing water right not receiving previously available water to which it is legally entitled.

Michael J Thoma, Ph.D.
Hydrogeologist | Oregon Water Resources Dept
725 Summer St. NE, Suite A
Salem, OR 97301
ph. 503-986-0845

Affidavit of Agreement

By signing below, I hereby acknowledge that I am the holder of the water right listed below. By signing below, I am consenting to the injury to water right Application _____, Permit _____, Certificate _____, caused by the ADDITIONAL POINTS OF APPROPRIATION proposed by Transfer Application _____.

Printed Name

Certificate

Signature of Affiant

Date

Signed and sworn to (or affirmed) before me this ____ day of _____, 20____

Notary Republic for Oregon

My Commission Expires: _____

JOYE Jessica L * WRD

From: JOYE Jessica L * WRD
Sent: Monday, August 28, 2017 2:30 PM
To: 'gkaping@ci.junction-city.or.us'
Cc: 'Steve Bruce'
Subject: RA Transfer Application T-12523
Attachments: 12523 -dpd + cov.pdf

Good Afternoon,

Attached you will find the draft preliminary determination for Reimbursement Authority Transfer Application T-12523 in the name of City of Junction City.

If you have any questions please feel free to contact me.

Sincerely,

Jessica L Joye | Reimbursement Authority Transfers, Transfer and Conservation Section

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503 986-0814 | Fax: 503 986-0901

Email: Jessica.L.Joye@oregon.gov



JOYE Jessica L * WRD

From: JARAMILLO Lisa J * WRD
Sent: Monday, October 16, 2017 2:30 PM
To: JOYE Jessica L * WRD
Subject: FW: T-12523 - City of Junction City

Hi Jessica,

Please see Dwight's email below. We need to get this one moving again.

If you have any questions or if you'd like to sit down to discuss any part of this application, please feel free to come see me or send me a meeting request invite.

Thanks,
Lisa

Lisa J. Jaramillo

Transfer and Conservation Section Manager
Water Right Services Division
Oregon Water Resources Department
Phone: 503-986-0880
Lisa.J.Jaramillo@oregon.gov

From: FRENCH Dwight W * WRD
Sent: Monday, October 16, 2017 1:27 PM
To: JARAMILLO Lisa J * WRD
Subject: T-12523 - City of Junction City

Lisa,
I still haven't heard any decent/good argument for limiting or holding up this transfer because of the GW registration. We need to move ahead a process this application with a finding of no injury.
Can you work with the transfer CW to make this happen? *Language for revised DPD. ROP*
Thank you,
Dwight

Dwight French

Water Right Services Division Administrator
Oregon Water Resources Department
dwight.w.french@oregon.gov
503-986-0819

HENDERSON Sarah A * WRD

From: Pagel, Martha <MPagel@SCHWABE.com>
Sent: Monday, July 31, 2017 2:54 PM
To: HENDERSON Sarah A * WRD
Cc: 'IVERSON Justin T'; 'Steve Bruce'; 'Gary Kaping'; THOMA Michael J * WRD
Subject: RE: T-12523 - City of Junction City

Hi Sarah,

Thanks for getting back to me. I'm wondering if I can schedule a meeting to discuss this further with Kelly and you, and/or Dwight?

I am concerned that the department would require an applicant to obtain consent to injury from the home owners within the subdivision. This seems to be an obvious case of non-use as to the 60% of the GR place of use that has unquestionably been converted to residential housing for more than five years. While I can see the department would not be in a position to cancel the GR on the basis of this information (and we are not suggesting that), it seems logical that OWRD would at least find no potential for injury as to the portion of the GR that cannot possibly be used.

Is this something that you and Kelly can take another look at it – or would the next step be for me to request a meeting with Dwight and Justin?

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

[Vcard](#)

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Send DPD w/ Denial

Ideas fuel industries. Learn more at:

www.schwabe.com

From: HENDERSON Sarah A * WRD [mailto:Sarah.A.Henderson@oregon.gov]

Sent: Monday, July 31, 2017 2:02 PM

To: Pagel, Martha <MPagel@SCHWABE.com>

Cc: 'IVERSON Justin T' <justin.t.iverson@state.or.us>; 'Steve Bruce' <steve@skookumwater.com>; 'Gary Kaping' <gkaping@ci.junction-city.or.us>; THOMA Michael J * WRD <Michael.J.Thoma@oregon.gov>

Subject: RE: T-12523 - City of Junction City

Hi Martha,

After a discussion with Kelly Starnes, the Department will need to have the GR cancelled or an affidavit of consent to injure (example attached) from the GR owner(s) in order to move forward without injury.

If the GR is in place and has not been cancelled by a court or the Department, the two options that are available are the voluntary cancellation or affidavit of consent.

Please let me know if you have any other questions.

Sarah

Sarah Henderson | Transfer Specialist, Transfer and Conservation Division

Water Resources Department | 725 Summer St. NE, Suite A | Salem, Oregon 97301

Ph: 503.986.0890 | Fax: 503.986.0901

Email: sarah.a.henderson@oregon.gov | Web: <http://www.wrd.state.or.us>

From: Pagel, Martha [<mailto:MPagel@SCHWABE.com>]

Sent: Monday, July 31, 2017 11:25 AM

To: THOMA Michael J * WRD; HENDERSON Sarah A * WRD

Cc: 'IVERSON Justin T'; 'Steve Bruce'; 'Gary Kaping'

Subject: RE: T-12523 - City of Junction City

Mike and Sarah,

I'm checking back to see if you have had a chance to consider the additional information we provided regarding the apparent conversion of much of the "GR" place of use from irrigation to residential housing. In addition, I have since learned the GR well may no longer be functional/in existence at all. If that is the case, it seems that we would no longer have an injury issue. Is there something the applicant should do at this point to confirm/document the additional information in order to move forward with the transfer?

Thank you,

Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com


From: Pagel, Martha

Sent: Wednesday, July 19, 2017 12:39 PM

To: 'Michael.J.Thoma@oregon.gov' <Michael.J.Thoma@oregon.gov>; 'HENDERSON Sarah A * WRD'

<Sarah.A.Henderson@oregon.gov>

Cc: 'IVERSON Justin T' <justin.t.iverson@state.or.us>; 'Steve Bruce' <steve@skookumwater.com>; 'Gary Kaping' <gkaping@ci.junction-city.or.us>

Subject: T-12523 - City of Junction City

Hi Mike and Sarah,

I am working with Steve Bruce on this application for the City of Junction City, and I wanted to follow-up with you both regarding the injury analysis and next steps.

Since receiving Mike's email (below), we have taken a closer look at GR-2915, the existing water right that was identified as potentially being affected by the transfer. Based on aerial photos and city records, we have confirmed that since at least 2009, about 60% of the place of use claimed under the GR has been converted to a residential subdivision that is served by City water. It is unclear whether the remainder of the site is being irrigated, but we are wondering whether this substantial reduction in the use subject to the claim in combination with the unproven nature and unenforceable legal status of a GR claim in the first place, would make a difference in the injury analysis? Could you please take another look and let us know.

We would be happy to provide additional details, or to schedule a meeting or conference call to discuss this further.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com



From: THOMA Michael J * WRD [<mailto:Michael.J.Thoma@oregon.gov>]

Sent: Saturday, June 10, 2017 10:29 AM

To: Steve Bruce <steve@skookumwater.com>; HENDERSON Sarah A * WRD <Sarah.A.Henderson@oregon.gov>

Cc: 'Gary Kaping' <gkaping@ci.junction-city.or.us>; IVERSON Justin T * WRD <Justin.T.Iverson@oregon.gov>

Subject: RE: Junction City Pumping Test Memorandum

Hi Steve,

Sorry I didn't get to this yesterday.

I talked this over internally and we came to the conclusion that it is the Department's stance that injury, as defined in OAR 690-380-0100 (see below), does not require a well to fully penetrate the aquifer. Therefore I don't think we will be changing our finding in the review. The requirement to fully penetrate the aquifer comes in with how the Department handles interference (one well over-pumping and drawing down another well). I know it seems like we're splitting hairs but that is our current stance, as I understand it.

I have also looked over the report summary of the aquifer test that you sent and, unfortunately I could not find anything in there to change my finding. I agree with the interpretation of the fine-grained layer between the upper and lower aquifer zones and I suspect that it would likely limit interference between the city's well and the claim's well, but without a reasonable model that demonstrates that (e.g., a three-layer interference model, which I don't believe AQTESOLV is capable of), we will have to err on the side of over-protection rather than under-protection.

So at this point I can think of two options for moving forward:

- 1) contacting Sarah to work on developing an agreement with the holders of the nearby claim
 - 2) preparing and submitting a model that predicts drawdown with the claim's well and shows it is minimal
- There may be other options worth pursuing and these are only my thoughts.

Feel free to contact me with any questions

- Mike

OAR 690-380-0100

http://arcweb.sos.state.or.us/pages/rules/oars_600/oar_690/690_380.html

(3) "Injury" or "Injury to an existing water right" means a proposed transfer would result in another, existing water right not receiving previously available water to which it is legally entitled.

Michael J Thoma, Ph.D.

Hydrogeologist | Oregon Water Resources Dept

725 Summer St. NE, Suite A

Salem, OR 97301

ph. 503-986-0845

NOTICE: This email may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

HENDERSON Sarah A * WRD

From: Pagel, Martha <MPagel@SCHWABE.com>
Sent: Monday, July 31, 2017 11:25 AM
To: THOMA Michael J * WRD; HENDERSON Sarah A * WRD
Cc: 'IVERSON Justin T'; 'Steve Bruce'; 'Gary Kaping'
Subject: RE: T-12523 - City of Junction City

Mike and Sarah,

I'm checking back to see if you have had a chance to consider the additional information we provided regarding the apparent conversion of much of the "GR" place of use from irrigation to residential housing. In addition, I have since learned the GR well may no longer be functional/in existence at all. If that is the case, it seems that we would no longer have an injury issue. Is there something the applicant should do at this point to confirm/document the additional information in order to move forward with the transfer?

Thank you,
Martha

Schwabe Williamson & Wyatt
Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:
www.schwabe.com

*Submit volum case
or affidavit of consent
of all who own
GR -
still in affect
per dep't*

From: Pagel, Martha
Sent: Wednesday, July 19, 2017 12:39 PM
To: 'Michael.J.Thoma@oregon.gov' <Michael.J.Thoma@oregon.gov>; 'HENDERSON Sarah A * WRD' <Sarah.A.Henderson@oregon.gov>
Cc: 'IVERSON Justin T' <justin.t.iverson@state.or.us>; 'Steve Bruce' <steve@skookumwater.com>; 'Gary Kaping' <gkaping@ci.junction-city.or.us>
Subject: T-12523 - City of Junction City

Hi Mike and Sarah,

I am working with Steve Bruce on this application for the City of Junction City, and I wanted to follow-up with you both regarding the injury analysis and next steps.

Since receiving Mike's email (below), we have taken a closer look at GR-2915, the existing water right that was identified as potentially being affected by the transfer. Based on aerial photos and city records, we have confirmed that since at least 2009, about 60% of the place of use claimed under the GR has been converted to a residential subdivision that is served by City water. It is unclear whether the remainder of the site is being irrigated, but we are wondering whether this substantial reduction in the use subject to the claim in combination with the unproven nature and unenforceable legal status of a GR claim in the first place, would make a difference in the injury analysis? Could you please take another look and let us know.

We would be happy to provide additional details, or to schedule a meeting or conference call to discuss this further.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com

From: THOMA Michael J * WRD [<mailto:Michael.J.Thoma@oregon.gov>]

Sent: Saturday, June 10, 2017 10:29 AM

To: Steve Bruce <steve@skookumwater.com>; HENDERSON Sarah A * WRD <Sarah.A.Henderson@oregon.gov>

Cc: 'Gary Kaping' <gkaping@ci.junction-city.or.us>; IVERSON Justin T * WRD <Justin.T.Iverson@oregon.gov>

Subject: RE: Junction City Pumping Test Memorandum

Hi Steve,

Sorry I didn't get to this yesterday.

I talked this over internally and we came to the conclusion that it is the Department's stance that injury, as defined in OAR 690-380-0100 (see below), does not require a well to fully penetrate the aquifer. Therefore I don't think we will be changing our finding in the review. The requirement to fully penetrate the aquifer comes in with how the Department handles interference (one well over-pumping and drawing down another well). I know it seems like we're splitting hairs but that is our current stance, as I understand it.

I have also looked over the report summary of the aquifer test that you sent and, unfortunately I could not find anything in there to change my finding. I agree with the interpretation of the fine-grained layer between the upper and lower aquifer zones and I suspect that it would likely limit interference between the city's well and the claim's well, but without a reasonable model that demonstrates that (e.g., a three-layer interference

model, which I don't believe AQTESOLV is capable of), we will have to err on the side of over-protection rather than under-protection.

So at this point I can think of two options for moving forward:

- 1) contacting Sarah to work on developing an agreement with the holders of the nearby claim
 - 2) preparing and submitting a model that predicts drawdown with the claim's well and shows it is minimal
- There may be other options worth pursuing and these are only my thoughts.

Feel free to contact me with any questions

- Mike

OAR 690-380-0100

http://arcweb.sos.state.or.us/pages/rules/oars_600/oar_690/690_380.html

(3) "Injury" or "Injury to an existing water right" means a proposed transfer would result in another, existing water right not receiving previously available water to which it is legally entitled.

Michael J Thoma, Ph.D.

Hydrogeologist | Oregon Water Resources Dept

725 Summer St. NE, Suite A

Salem, OR 97301

ph. 503-986-0845

NOTICE: This email may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

HENDERSON Sarah A * WRD

From: THOMA Michael J * WRD
Sent: Friday, July 21, 2017 10:27 AM
To: HENDERSON Sarah A * WRD
Subject: FW: T-12523 - City of Junction City

Follow Up Flag: Follow up
Flag Status: Flagged

Hi Sarah,

For the reasons we just talked about, this information would not change the findings regarding injury, as there may still be a portion of the right that is being exercised – until we receive evidence to the contrary (i.e., the right is cancelled).

I spoke with Justin briefly and he recommended that the Departments response should come from you instead of me.

(sorry ☹. He said it was due to some conversations he'd had lately with other management).

Thanks,
- Mike

Michael J Thoma, Ph.D.
Hydrogeologist | Oregon Water Resources Dept
725 Summer St. NE, Suite A
Salem, OR 97301
ph. 503-986-0845

From: Pagel, Martha [mailto:MPagel@SCHWABE.com]
Sent: Wednesday, July 19, 2017 12:39 PM
To: THOMA Michael J * WRD; HENDERSON Sarah A * WRD
Cc: 'IVERSON Justin T'; 'Steve Bruce'; 'Gary Kaping'
Subject: T-12523 - City of Junction City

Hi Mike and Sarah,

I am working with Steve Bruce on this application for the City of Junction City, and I wanted to follow-up with you both regarding the injury analysis and next steps.

Since receiving Mike's email (below), we have taken a closer look at GR-2915, the existing water right that was identified as potentially being affected by the transfer. Based on aerial photos and city records, we have confirmed that since at least 2009, about 60% of the place of use claimed under the GR has been converted to a residential subdivision that is served by City water. It is unclear whether the remainder of the site is being irrigated, but we are wondering whether this substantial reduction in the use subject to the claim in

combination with the unproven nature and unenforceable legal status of a GR claim in the first place, would make a difference in the injury analysis? Could you please take another look and let us know.

We would be happy to provide additional details, or to schedule a meeting or conference call to discuss this further.

Thank you,
Martha

Schwabe Williamson & Wyatt

Martha Pagel

Attorney

530 Center St NE, Ste 730

Salem, OR 97301

Direct: 503-540-4260

Cell: 503-507-7293

mpagel@schwabe.com

Vcard

Assistant: Karen L. Donohue 503-540-4262, kdonohue@schwabe.com

Ideas fuel industries. Learn more at:

www.schwabe.com

From: THOMA Michael J * WRD [<mailto:Michael.J.Thoma@oregon.gov>]

Sent: Saturday, June 10, 2017 10:29 AM

To: Steve Bruce <steve@skookumwater.com>; HENDERSON Sarah A * WRD <Sarah.A.Henderson@oregon.gov>

Cc: 'Gary Kaping' <gkaping@ci.junction-city.or.us>; IVERSON Justin T * WRD <Justin.T.Iverson@oregon.gov>

Subject: RE: Junction City Pumping Test Memorandum

Hi Steve,

Sorry I didn't get to this yesterday.

I talked this over internally and we came to the conclusion that it is the Department's stance that injury, as defined in OAR 690-380-0100 (see below), does not require a well to fully penetrate the aquifer. Therefore I don't think we will be changing our finding in the review. The requirement to fully penetrate the aquifer comes in with how the Department handles interference (one well over-pumping and drawing down another well). I know it seems like we're splitting hairs but that is our current stance, as I understand it.

I have also looked over the report summary of the aquifer test that you sent and, unfortunately I could not find anything in there to change my finding. I agree with the interpretation of the fine-grained layer between the upper and lower aquifer zones and I suspect that it would likely limit interference between the city's well and the claim's well, but without a reasonable model that demonstrates that (e.g., a three-layer interference model, which I don't believe AQTESOLV is capable of), we will have to err on the side of over-protection rather than under-protection.

So at this point I can think of two options for moving forward:

1) contacting Sarah to work on developing an agreement with the holders of the nearby claim

2) preparing and submitting a model that predicts drawdown with the claim's well and shows it is minimal

There may be other options worth pursuing and these are only my thoughts.

Feel free to contact me with any questions

- Mike

OAR 690-380-0100

http://arcweb.sos.state.or.us/pages/rules/oars_600/oar_690/690_380.html

(3) "Injury" or "Injury to an existing water right" means a proposed transfer would result in another, existing water right not receiving previously available water to which it is legally entitled.

Michael J Thoma, Ph.D.
Hydrogeologist | Oregon Water Resources Dept
725 Summer St. NE, Suite A
Salem, OR 97301
ph. 503-986-0845

NOTICE: This email may contain material that is confidential, privileged and/or attorney work product for the sole use of the intended recipient. Any review, reliance or distribution by others or forwarding without express permission is strictly prohibited. If you are not the intended recipient, please contact the sender and delete all copies.

Steve Bruce

From: STARNES Kelly <patrick.k.starnes@state.or.us>
Sent: Wednesday, October 26, 2016 8:51 AM
To: Steve Bruce
Subject: RE: City of Junction City Transfer Application Map

Hi Steve –

The Department grants a map size waiver for the map described below.

Please include a copy of this e-mail with the map when you submit the application..

Kelly

From: Steve Bruce [mailto:steve@skookumwater.com]
Sent: Monday, October 24, 2016 3:10 PM
To: 'Kelly Starnes '
Subject: City of Junction City Transfer Application Map

Hi Kelly,

I am preparing a map on behalf of Junction City for a water-right transfer. The scale is 1 inch = 1,320 feet. I would like approval from the Department to submit a 22-inch x 34-inch map.

Thank you,
Steve

SKOOKUM
WATER ASSOCIATES INC

Steven R. Bruce, RG, LHg, CWRE
1626 Victorian Way
Eugene, OR 97401
(503) 319-8926
www.skookumwater.com

RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

FOR ASSESSMENT AND
TAXATION ONLY

SECTION 5 T.16S. R.4W. W.M.
Lane County
1" = 400'

16040500
JUNCTION CITY

LCATJG - 2014-06-28 06:15



REVISIONS
06/10/2014 - LCATJG - CORRECT MAP TO BE
06/10/2014 - LCATJG - CORRECT MAP TO BE
06/10/2014 - LCATJG - CORRECT MAP TO BE

JUNCTION CITY
16040500

S.W.1/4 N.W.1/4 SEC.5 T.16S. R.4W. W.M.
Lane County
1" = 100'

16040523
JUNCTION CITY

GIS DATA
7/25/2006 11:07:34 AM / kcarton

CANCELLED
900
903



105308-CONTR- CONVERT MAP TO GIB

JUNCTION CITY
16040523

N.E.1/4 N.W.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

REVISIONS
 10/1/2007 - LEA2130 - CONVERT MAP TO GIS
 06/27/2011 - LEA2158 - VAC FPN EAST FRONT ST INTO TL 400
 09/23/2013 - LEA2175 - ADDED LOT NUMBERS TO BLOCKS

15043221
JUNCTION CITY

LCATCAR - 2013-09-23 11:40

CANCELLED
1200
1300
1600
301




JUNCTION CITY
15043221

FOR ASSESSMENT AND
TAXATION ONLY

N.W.1/4 N.W.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

15043222
JUNCTION CITY

Map - 2013-04-15 09:43

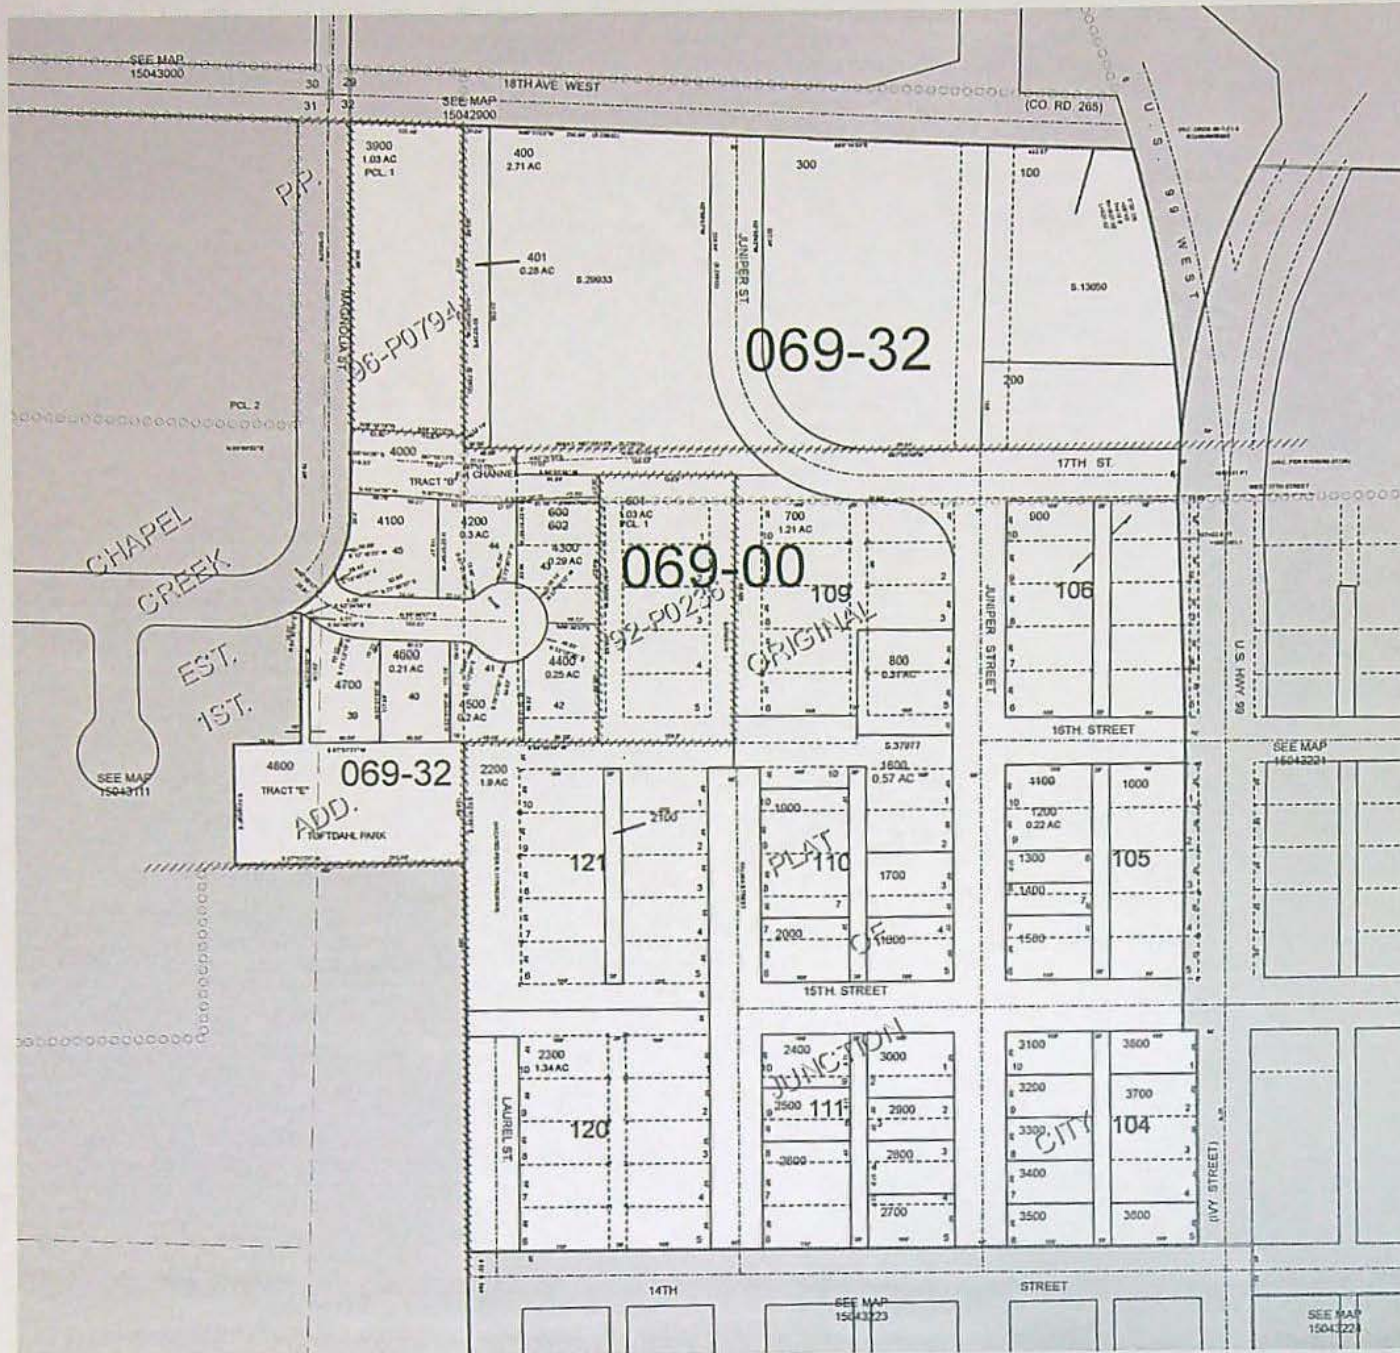

S.W.1/4 N.W.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

15043223
JUNCTION CITY

LCATJCG - 2015-07-02 08:51

CANCELLED
9600
1000
800
4101



REVISIONS

REVISED BY	LEAF 130	CONVERT MAP TO Q62
ON 11/22/88	LEAF 188	MAP CORRECTION TL 11100
OF 03/22/85	LEAF 174	CANG TL 4101 INTO 2035 P264

JUNCTION CITY
15043223

FOR ASSESSMENT AND
TAXATION ONLY

S.E. 1/4 N.W. 1/4 SEC. 32 T.15S. R.4W. W.M.

Lane County

1" = 100'

REVISIONS
01/13/2003 - LEAT 100 - CONVERT MAP TO GIS
07/18/2008 - LEAT 101 - MERGE ALLEY BLK. 10 INTO ADJOINING T19
06/27/2011 - LEAT 83 - VAC. PINE FRONT ST. 300' WIDE. ADD BLK 10
06/27/2011 - LEAT 100 - VAC. TRAIL OUT OF AND PTH OF E. FRONT ST

15043224
JUNCTION CITY

Scaping - 2011-07-22 00:44


CANCELLED



JUNCTION CITY
15043224

S.W.1/4 N.E.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

LEATJOG - 2016-02-03 15:00



```

#REVISIONS
#REV00001 - LGAR115 - CONVERT MAP TO CDS
#REV00002 - LGAR115 - CLARIFY THE CDS IN T1 43304333
#REV00003 - LGAR115 - CDS T1 4331 0101 T1 4330
#REV00004 - LGAR115 - CDS T1 4331 INTO T1 4330

```

JUNCTION CITY
15043213

FOR ASSESSMENT AND
TAXATION ONLY

S.W.1/4 S.W.1/4 SEC. 32 T.15S. R.4W. W.M.

Lane County

1" = 100'

15043233
JUNCTION CITY

LCATCAB - 2015-05-29 14:42



CANCELLED
8200
700
600

REVISIONS
15040523 - LCAT142 - CONVERT MAP TO GIS
15040523 - LCAT142 - CORR. KALMA ST. TO KALMA ST.
15040523 - LCAT142 - CORR. TL 2800 TO 2700
15040523 - LCAT119 - LLA BETWEEN TL'S 8000 & TL 1000


JUNCTION CITY
15043233

FOR ASSESSMENT AND
TAXATION ONLY

N.W.1/4 S.W.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

15043232
JUNCTION CITY

Map - 2011-09-19 13:32

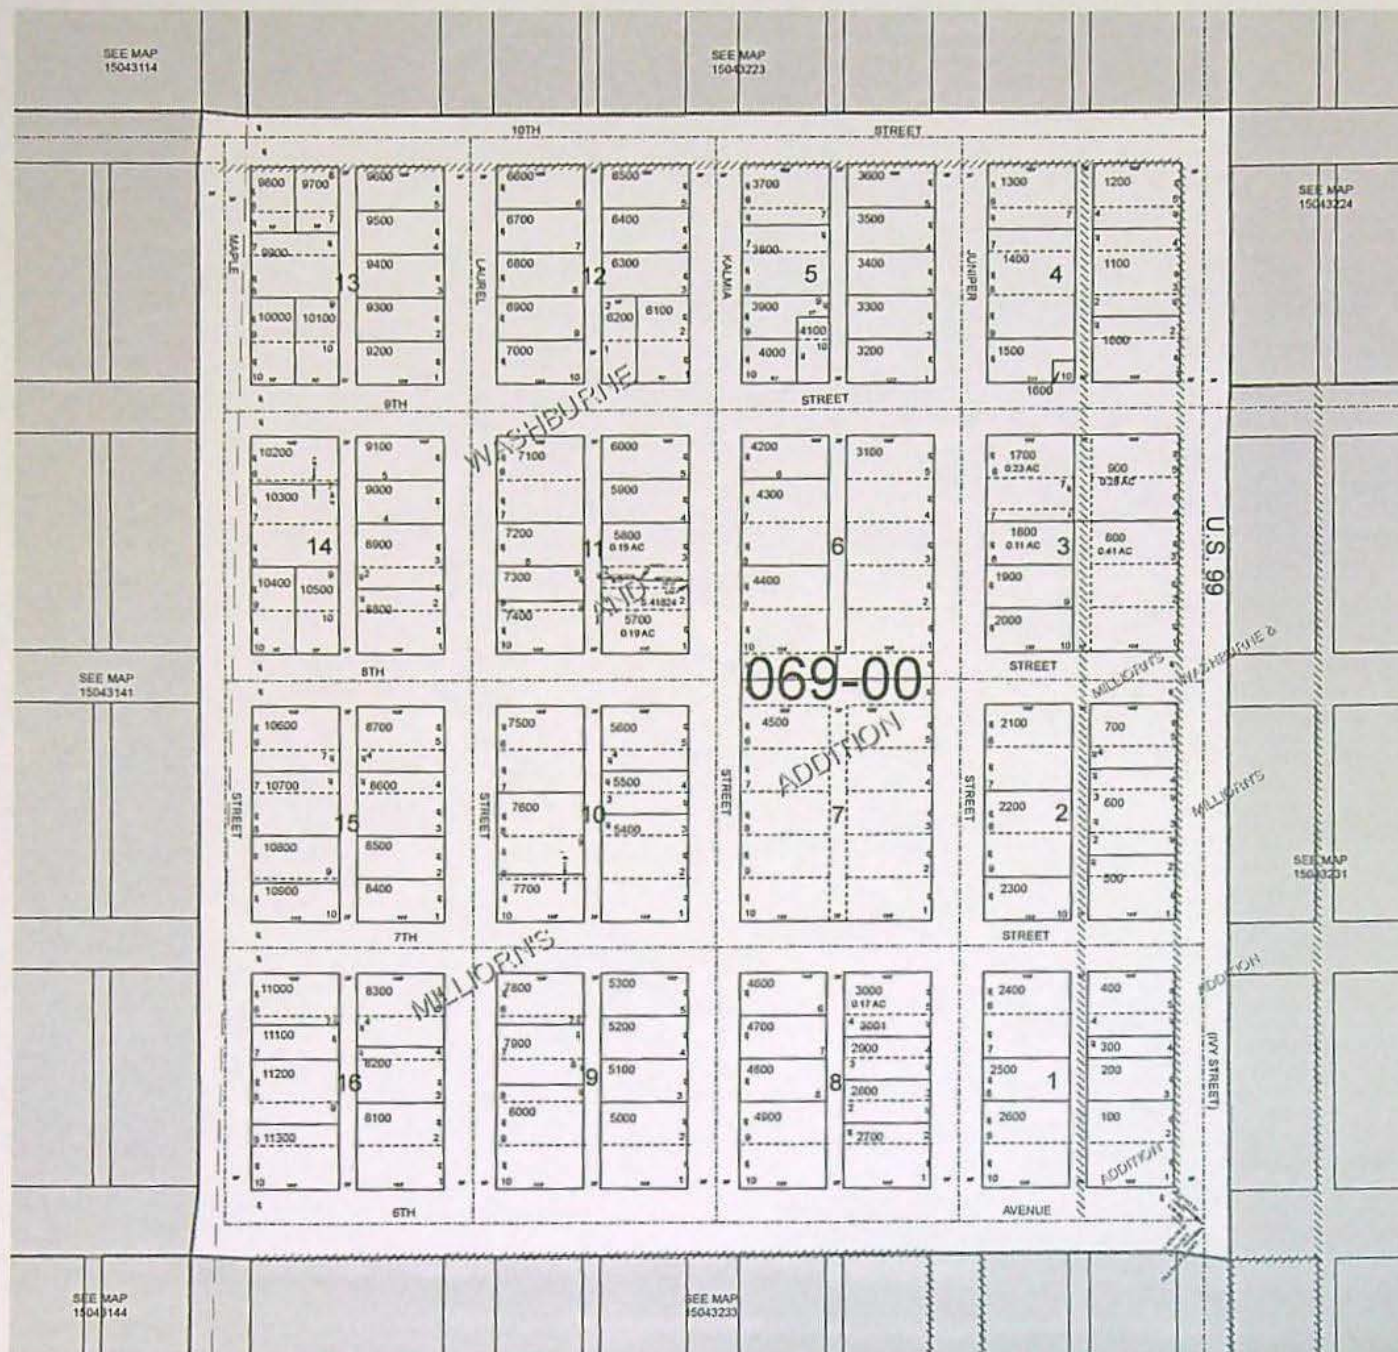


REVISIONS
05/05/07 - LOCATED - CORRECT MAP TO 1504
05/05/08 - LOCATED - L.A. 80' WIDE ON 1504 & 1505
05/05/08 - LOCATED - MAP COR. TO 1505
05/05/08 - LOCATED - CORRECT MAP TO 1505 & 1506
05/05/08 - LOCATED - L.A. 80' WIDE ON 1505 & 1506
05/05/08 - LOCATED - ALLEY INTO 1505 & 1506

JUNCTION CITY
15043232

N.E.1/4 S.W.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

Exatime - 2011-08-29 13:36

CANCELLED

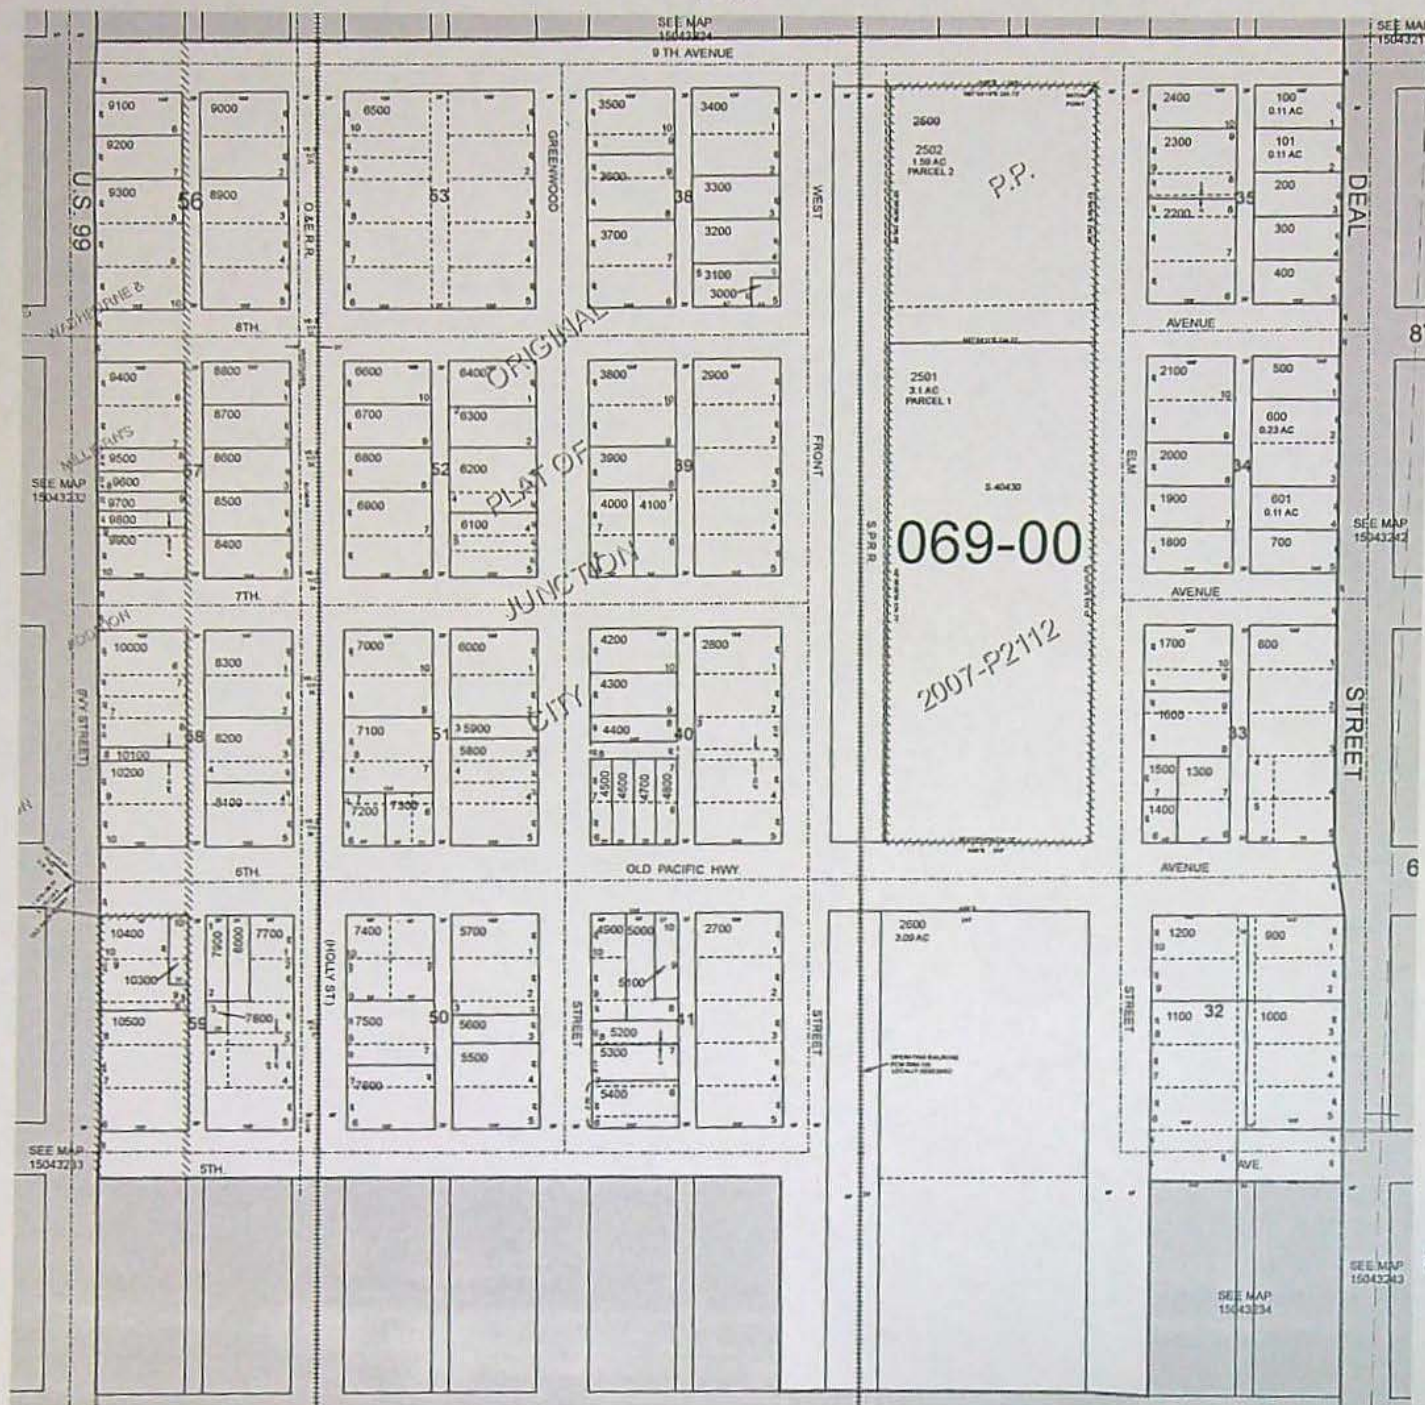

JUNCTION CITY
15043231

S.E. 1/4 S.W. 1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County

 $1'' = 100'$

REVISIONS
01/23/2007 - LCAF 115 - CONVERT MAP TO GIS
01/11/2008 - LCAF 112 - CORN MISSING TL NUM 1000
03/14/2011 - LCAF 115 - LLA TLB 2000 2 160 2200 1004324311700

15043234
JUNCTION CITY

kalkab - 2017-01-13 08:43

CANCELLED
1002
2100
2100

069-00

JUNCTION CITY
15043234

FOR ASSESSMENT AND
TAXATION ONLY


S.E. 1/4 S.E. 1/4 SEC. 32 T. 15S. R. 4W. W.M.
Lane County
1" = 100'

15043244
JUNCTION CITY

GIS DATA
9/25/2009 2:44:41 PM kash

CANCELLED:
400

SEE MAP
15043200

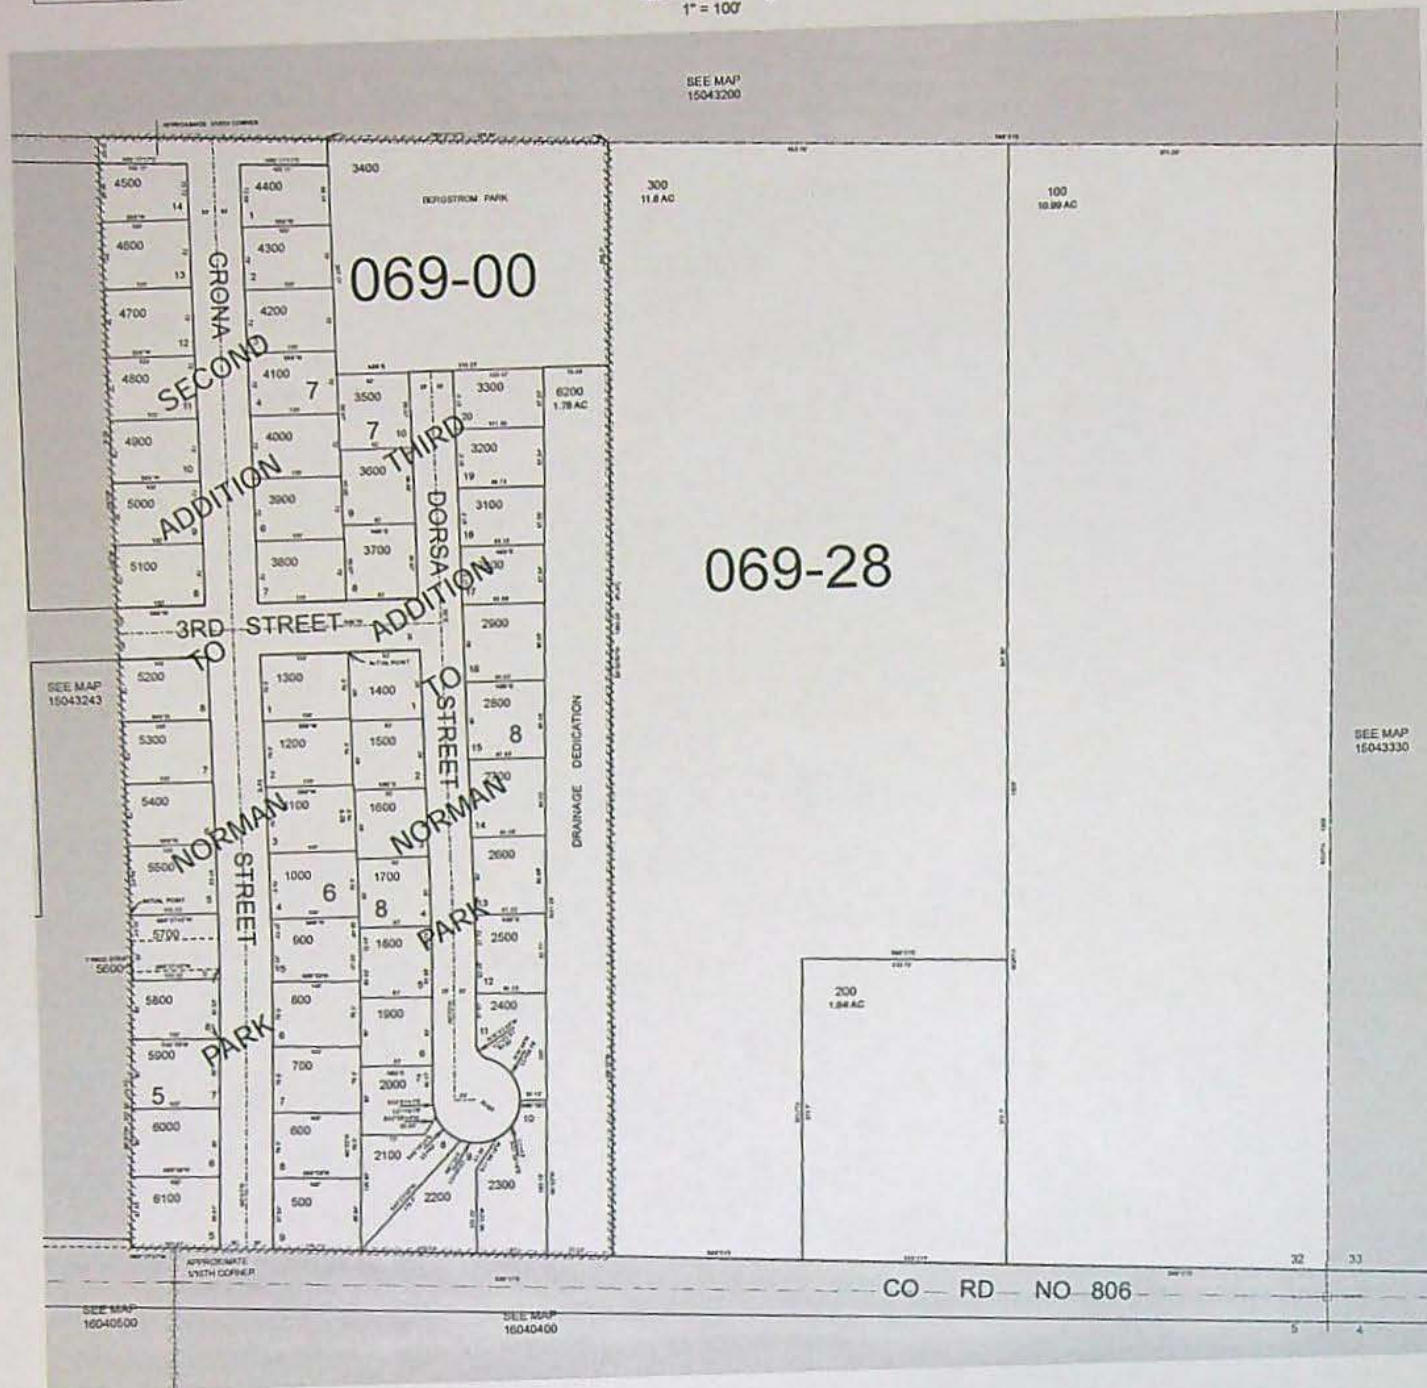


FOR ASSESSMENT AND
TAXATION ONLY

N.W.1/4 S.E.1/4 SEC. 32 T.15S. R.4W. W.M.
Lane County
1" = 100'

15043242
JUNCTION CITY

LCATCAB - 2014-12-23 09:11

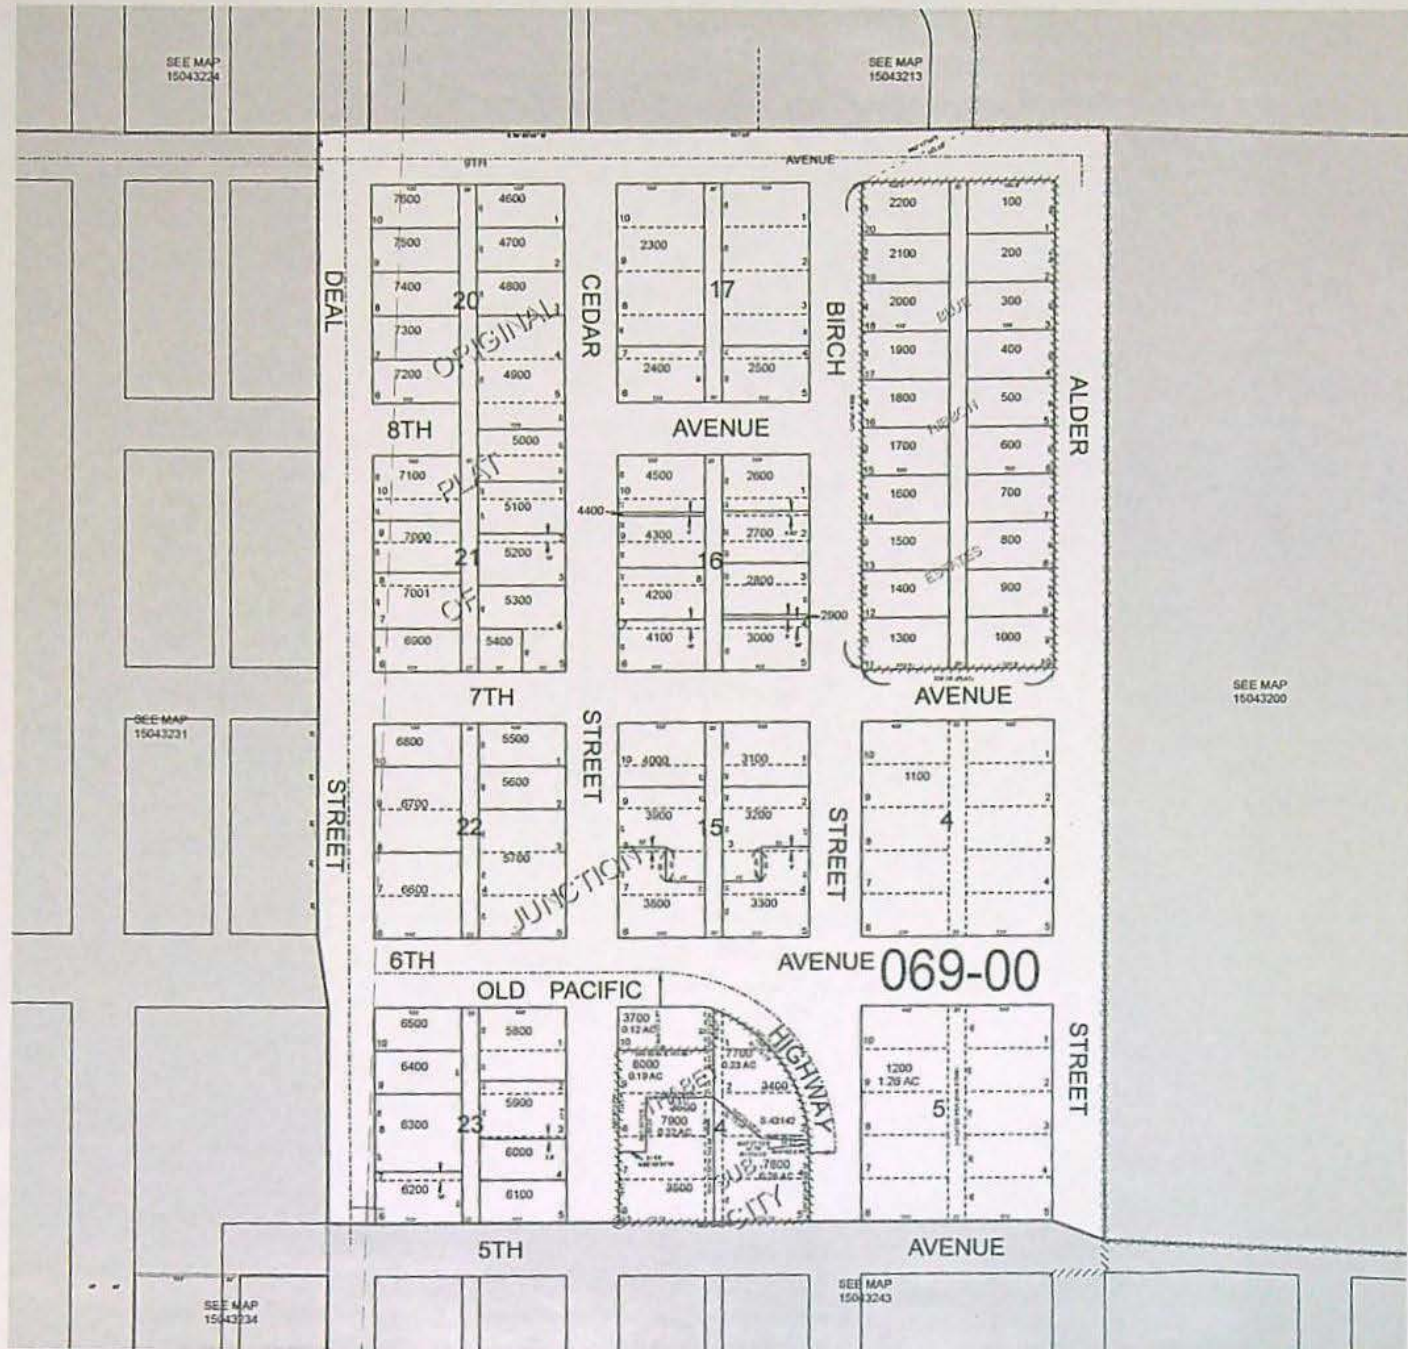

CANCELLED
3400
3500
3600

REVISIONS:
01/12/2014 - LORNE - CORRECT MAP TO 23
01/12/2014 - LORNE - CORRECT MAP TO 23
01/12/2014 - LORNE - CORRECT MAP TO 23
01/12/2014 - LORNE - CORRECT MAP TO 23

JUNCTION CITY
15043242

JUNCTION CITY
15043243


FOR ASSESSMENT AND
TAXATION ONLY

N.W.1/4 S.E.1/4 SEC.31 T.15S. R.4W. W.M.
Lane County
1" = 100'

15043142
JUNCTION CITY

GIS DATA
3/25/2008 12:30:22 PM : kashner

CANCELLED

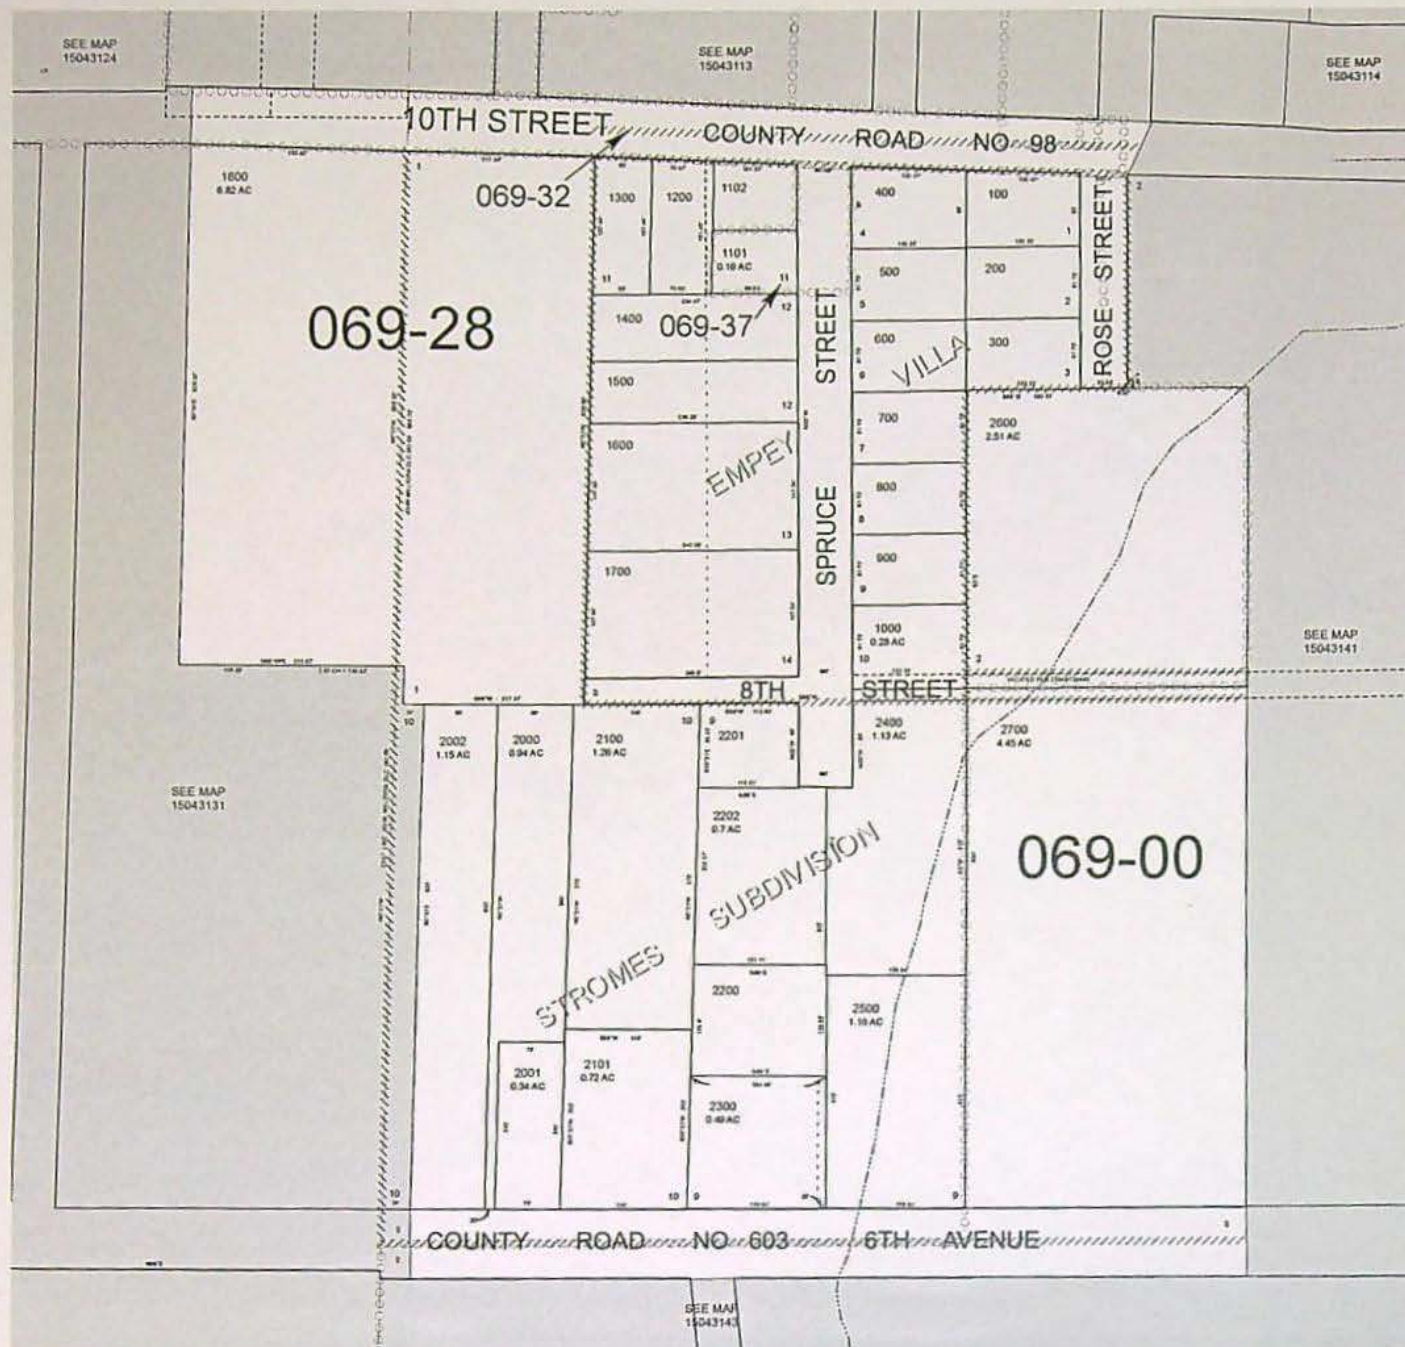

REVISIONS
REVISION - CATCH - CONVERT MAP TO GIS
REVISED - CATCH - CORRECTION OF 15, 100, 1000
REVISION - CATCH - CORRECTION OF 15, 100, 1000

JUNCTION CITY
15043142


FOR ASSESSMENT AND
TAXATION ONLY

N.E. 1/4 S.E. 1/4 SEC. 31 T. 15S. R. 4W. W.M.
Lane County
1" = 20'

15043141S001
JUNCTION CITY

GIS DATA
10/21/2008 12:09:42 PM : kadeh

CANCELLED

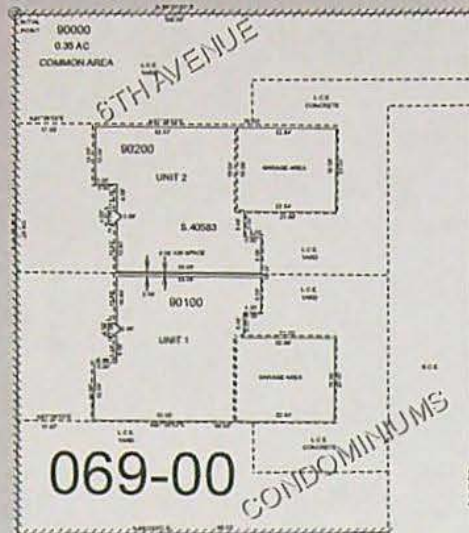

SEE MAP
15043141

6TH STREET

REVISIONS
15043141 - 15043142 - CONVERT MAP TO GIS


JUNCTION CITY
15043141S001

JUNCTION CITY
15043141

S.W.1/4 N.E.1/4 SEC. 31 T.15S. R.4W. W.M.
Lane County
1" = 100'

LCATJXG - 2016-10-18 14:18

CANCELLED
1100
2131
2700
500
1800
1901
213
300, 301
310
311
400
401
501
4600
1001
601
1300

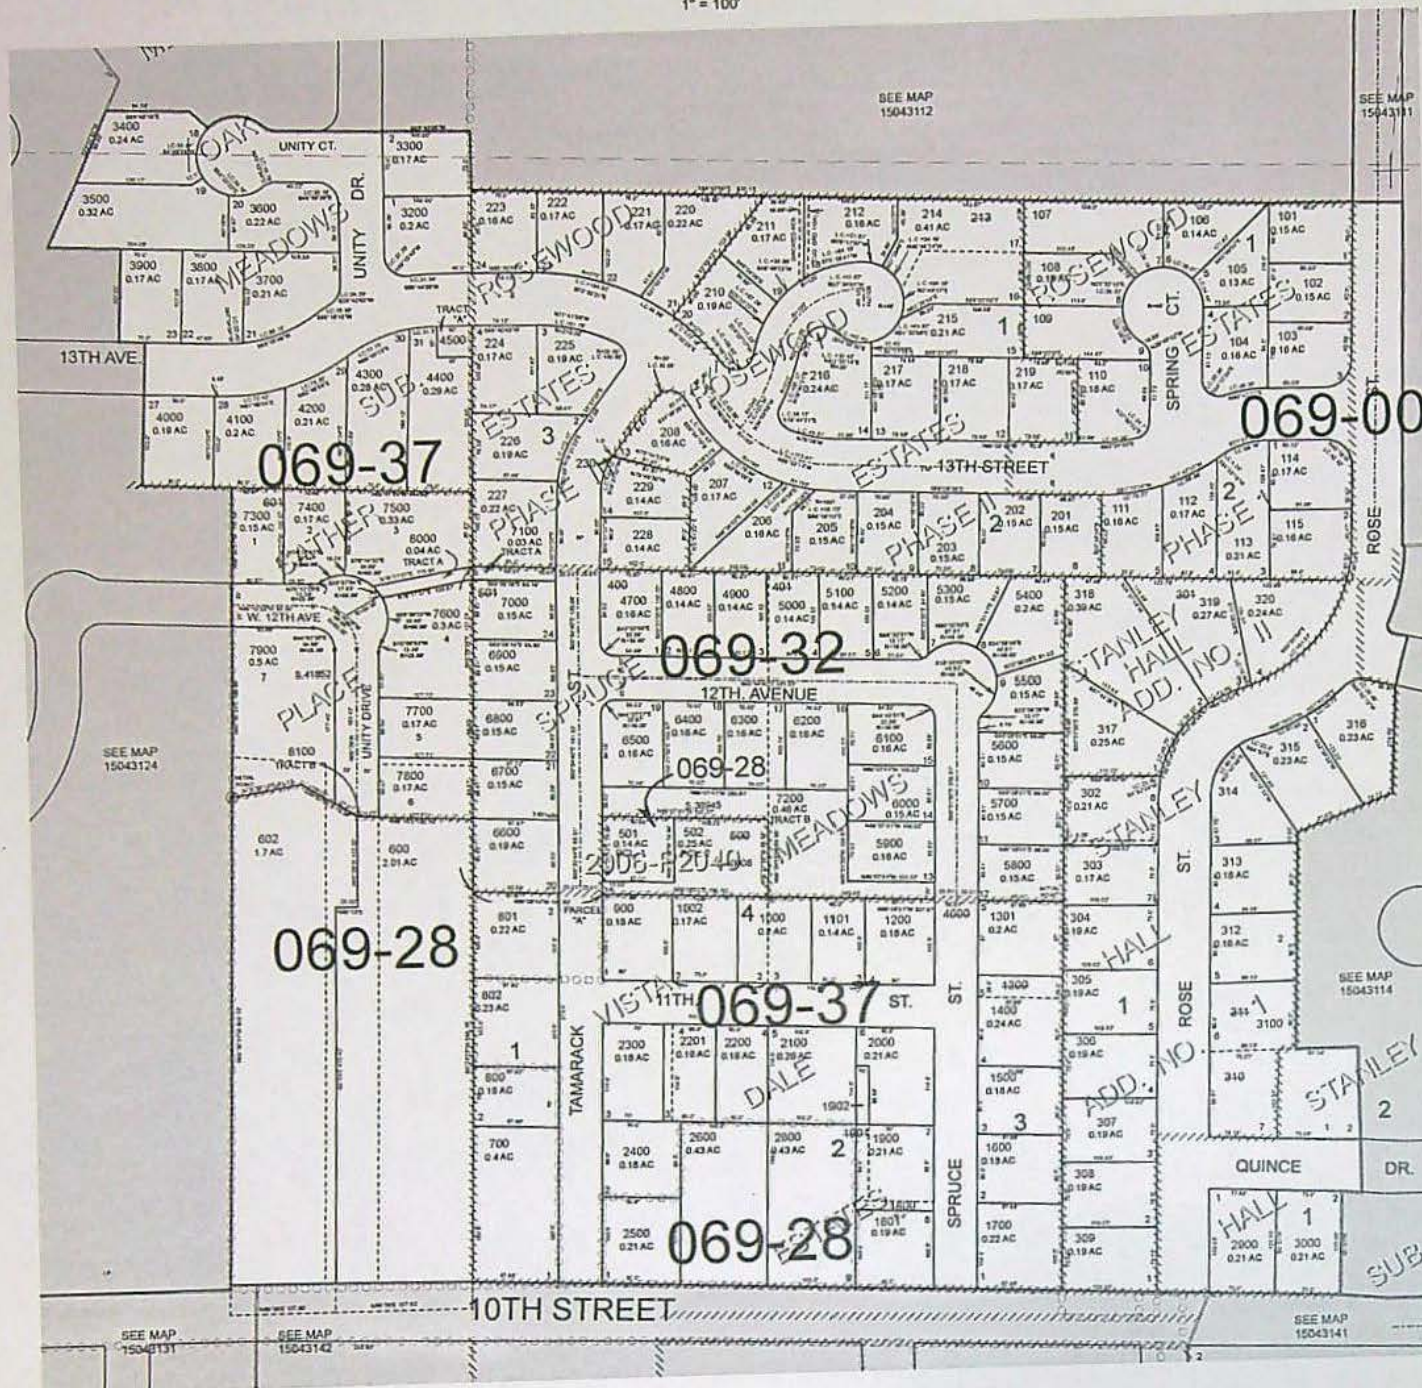


REFUGIONS
 01/11/2008 - LEAD 1101 - VINZ PESTERMAN MAP INTO TL 211 & 212
 01/11/2008 - LEAD 1102 - BENTLEYMAN TL 600 601 & 602
 01/11/2008 - LEAD 1103 - CONVENT MAP TO G13
 01/11/2008 - LEAD 1110 - CANIC TL 510 INTO PP 233-2340
 01/11/2008 - LEAD 1115 - ANDER TL 913
 01/11/2008 - LEAD 1114 - ANDER TL 912 & 905
 01/11/2008 - LEAD 1115 - ACC MISSING BLVD 6100
 01/11/2008 - LEAD 1116 - MAP CORN. FUL 101 FOR 114 & 115
 01/11/2008 - LEAD 1117 - CANIC TL 100 INTO SATHEN PLACE
 01/11/2008 - LEAD 1104 - CANIC TL 100 INTO 1400

JUNCTION CITY
15043113

SECTION 29 T.15S. R.4W. W.M.
Lane County
1" = 400'

15042900

CANCELLED
700
302
303
401
500
2400
1000
1100

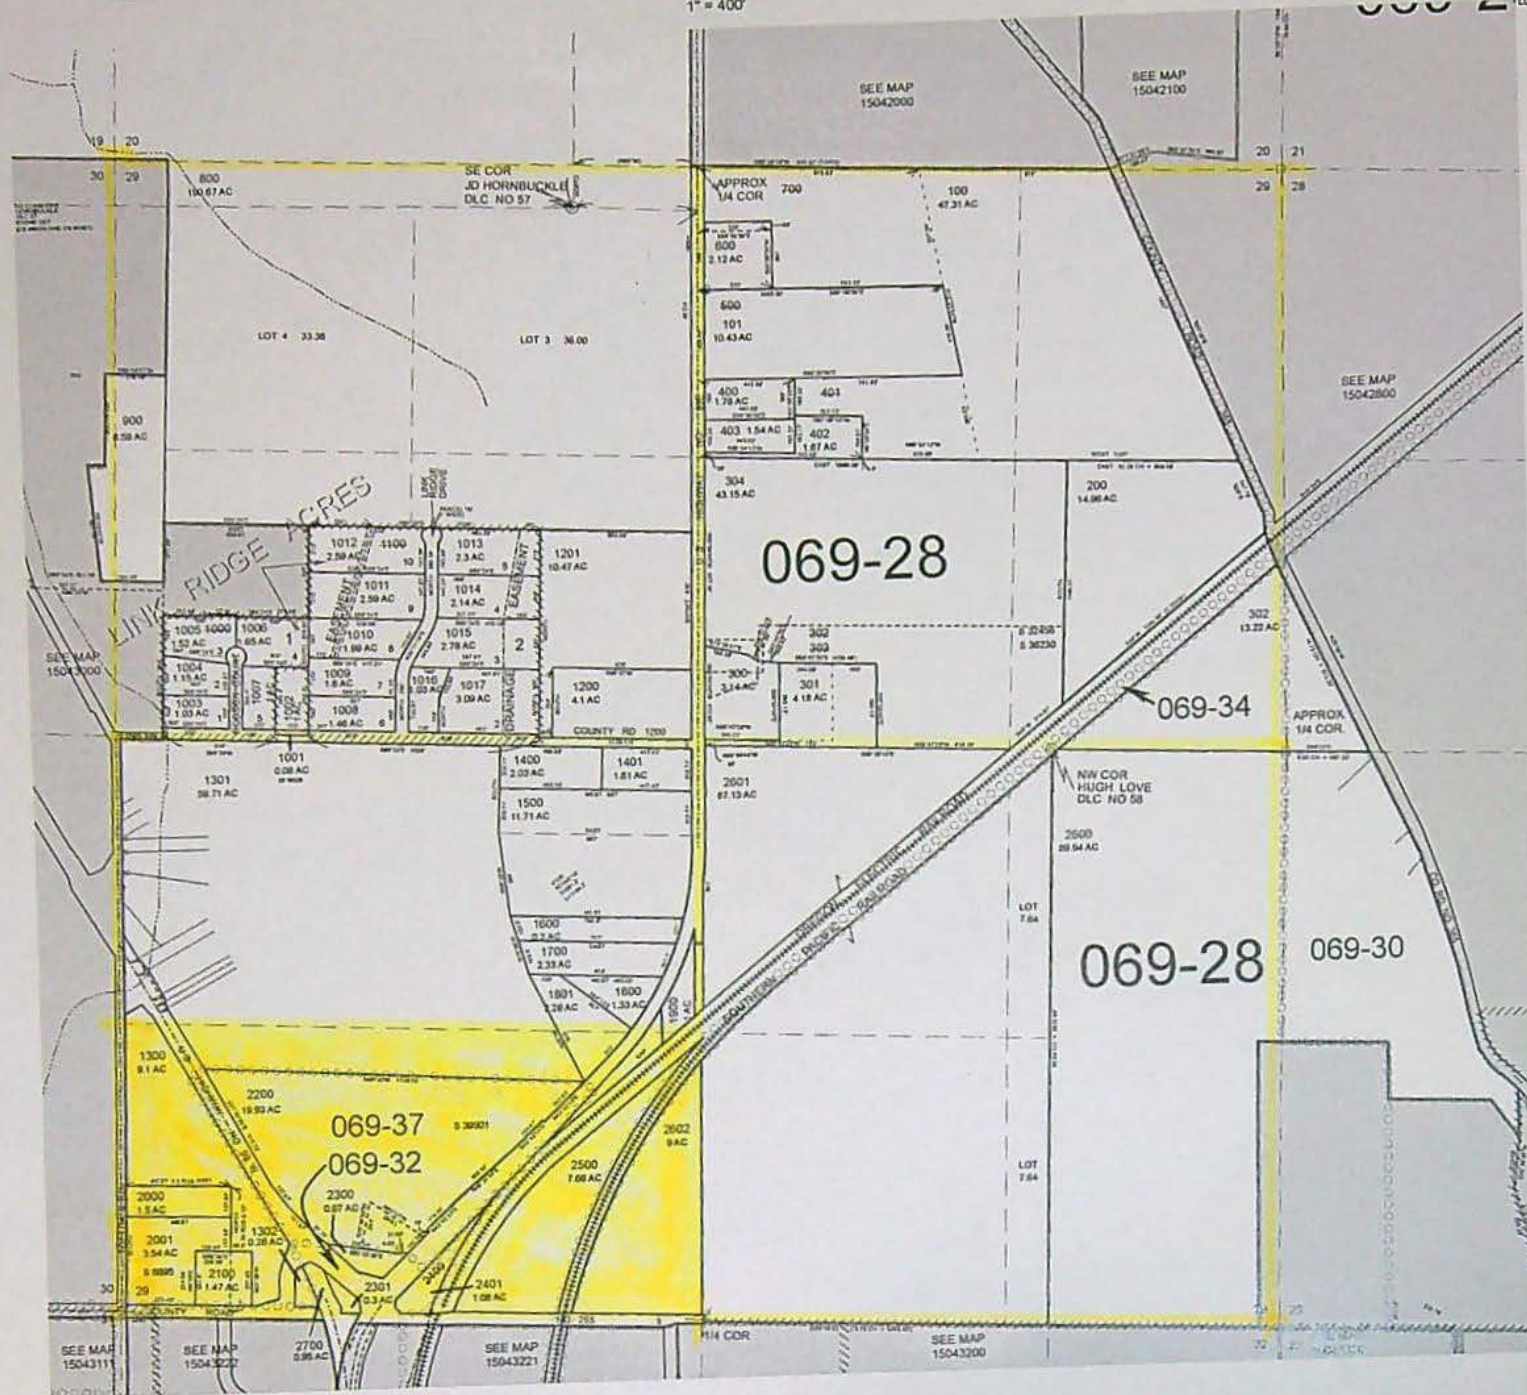

15042900



Oregon

Kate Brown, Governor

Water Resources Department

North Mall Office Building
725 Summer St NE, Suite A
Salem, OR 97301
Phone (503) 986-0900
Fax (503) 986-0904
www.wrd.state.or.us

November 22, 2016

CITY OF JUNCTION CITY
ATTN: GARY
KAPING PO BOX 250
JUNCTION CITY, OR 97448

Reference: Application T- 12523

On November 14, 2016, we received your water right Transfer application. The application was accompanied by \$2450.00. Our receipt number 121857 is enclosed.

By copy of this letter, we are asking the Watermaster for a report regarding the potential for injury to existing water rights which may be caused by the requested change. A review form will also be sent to our groundwater staff to determine whether the proposed well accesses the same source of water as the original well.

Your application will be examined to determine whether additional information is needed. We will notify you if further information or corrections to the application or map are required.

This application may require publication of a notice for two consecutive weeks in a newspaper with general circulation in the area where the water right is located. If it is determined that newspaper notice will be required, the Department will prepare the notice and notify you of the cost. You will be responsible for submitting payment to the Department prior to publication of the notice.

Except as provided under ORS 540.510(3) for municipalities, you may not use water in the new place of use or from the new point of appropriation until a final order approving the transfer application has been issued by the Department.

In order to avoid any possible forfeiture of the water right, you should continue to use the water as described by your existing water right.

If the land is sold before the application is approved, the buyer's consent to the application will be required unless a recorded deed or other legal document clearly established that the water right was not conveyed in the sale.

Refer to the following page for a chart showing the steps and expected timelines for the processing of your application.

If you have any questions, please contact the Transfer Section at (503) 986-0807.

Cc: Watermaster Dist. #2 (via email)
Steven R. Bruce, Agent

Enclosure



Transfer Applications: Regular

The holder of a water right may apply to permanently change an existing water use subject to transfer as defined in ORS 540.505(4). An application may involve any of the following changes: Point of diversion or appropriation; Additional point of diversion or appropriation; Historic POD; Place of use; Character of use; Instream; Substitution; or Exchange.

The Department seeks public comment on the recently-filed transfer applications listed below. Any person may comment on a transfer application. Comments must be received by the Department on or before December 29, 2016. Any person who provides comments within the comment period will receive a copy of the Department's preliminary determination of whether the application should be approved or rejected after the Department has completed a review of the application and will be provided an opportunity to protest the application and preliminary determination at that time.

Transfer	T 12523
Water Right	Cert:41697
County/Basin	Lane / Willamette(2)
Applicant Name	CITY OF JUNCTION CITY ATTN: GARY KAPING PO BOX 250 JUNCTION CITY, OR 97448
Proposed Change	ADDITIONAL POINT OF APPROPRIATION, PLACE OF USE
Sources/TRSQ40Q160	A WELL > WILLAMETTE RIVER / 15.00S 4.00W 32 NESW
Use/Quantity	MUNICIPAL USES / 1.830 CFS
Priority Date	09/20/1968

Regular Permanent Water Right Transfer Application Checklist

Checked by JS Date 11.17.2016

(If OK, check box to left; if not, fill in the blank)

☒ 1. Page 1 of application: Are all attachments that have been checked actually included?
If not, what is missing? _____

☒ 2. Are fees included and correct? Fee paid: _____
If not, the correct fee would be: _____, so the amount missing is: _____

Certs & acres involved:

Changes: _____

cfs involved: 1.83

Source: _____

► If a Substitution (see Page 5 of application)

Base fee for 1 well (POA)		\$725.00
Number of additional wells =	_____	x \$350.00 =
Total =		

► If a Government Action POD change (see: Page 5): NO CHARGE

► If any other type of "regular permanent" transfer:

Base fee for one water right, one change and first cfs =		\$1,000.00
# of additional water rights beyond the first (see Part 4 of application) =	_____	x \$450.00 =
Additional fee for groundwater staff review if any number of changes to well location(s), additional well(s) or change from SW diversion point to a well =		\$350.00 <u>350</u>
1 or 2 additional TYPEs of change* (see Page 5 of application) =	_____	x \$800.00 = <u>800</u>
If <u>Place of Use</u> or <u>Character of Use</u> change and transfer involves more than 1 cfs (based on primary acres x rate), # cfs or fraction above the first cfs =	_____	x \$300.00 = <u>300</u>
HINT: Total cfs on WR (÷) total # acres on WR (x) # acres involved in transfer = # cfs involved in transfer		
Sub-total =		<u>2450</u>
If a letter from ODFW endorsing this as a "fish-friendly" transfer is included, multiply sub-total by 0.50 =		
Total = sub-total minus 50% "fish-friendly" reduction, if applicable =		


*NOTE: [POD/APOD, POA/APOA, SW to GW, Gov Action] are all counted as one type
POU is counted as one type
[USE or (Supplemental to Primary)] are counted as one type

☒ 3. Page 3 of application: Have all the applicants listed at the top of the page signed?
If no, whose signature is missing? _____

☒ 4. Are all listed certificates or permits shown by WRIS as non-cancelled?
If no, which are cancelled? _____
For each cancelled certificate, if there has been a remaining right certificate issued that covers the lands in the left side of Table 2, list its number _____ and check the #4 box at left on this checklist.

N/A 5. If any certificate is in the name of a "district", is a Supplemental Form D from that district enclosed?
☐ N/A ☐ Form D needed from _____ (district)

6. If all #1-#5 boxes on this checklist are checked (with no remaining deficiencies identified), accept the application and assign it a numbered transfer folder. Put this check sheet in the transfer folder. If #1, #2, #3, #4 or #5 on this checklist is deficient, the application cannot be accepted. It should be returned and the deficiencies listed in the "staff" section at the bottom of Application Page 1, unless the applicant or agent can resolve the deficiencies within 2-3 days.



[Main](#)
[Help](#)

Search Criteria

no conflicts

Meridian: Willamette ▼

Township:

Range: 4 West ▾

Section: 29 ▼

Records per Page: 100

Search

Platcards Maps!
Learn about • View Map

Water Right	Changing Xfers	Priority	Use	Use Status	DLC	Gov/ Lot	Q(40): Q(160):	NE NE	NW NE	SW NE	SE NE	NE NW	NW NW	SW NW	SE NW	NE SW	NW SW	SW SW	SE SW	NE SE	NW SE	SW SE	SE SE	Unknown QQ
Select Cert:41537 OR *		6/13/1968	IRRIGATION														13.6	26.3	23.2	11.8				
Additional Info: NORMA FISHER App: G4304 Permit: G4065 Cert: 41537																								
Select Cert:50296 OR *		12/7/1977	SUPPLEMENTAL IRRIGATION (Suppl'mtl)														13.6	26	5.5	4.1				
Additional Info: NORMA FISHER App: G5456 Permit: G7721 Cert: 50296																								
Select Cert:41697 OR *	T12523	9/20/1968	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: G4605 Permit: G4329 Cert: 41697																								
Select Cert:46412 OR *		11/15/1971	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: G5660 Permit: G5487 Cert: 46412																								
Select App: LL 1632 *		2/22/2016	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: LL1632																								
Select Claim:GR 4123 *		12/31/1940	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4123																								
Select Claim:GR 4124 *		12/31/1942	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4124																								
Select Claim:GR 4122 *		12/31/1938	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4122																								
Select Inchoate: T 6896 CF (REG) *		7/1/1966	IRRIGATION																			(1.5)		
Additional Info: JENS REERSLEV App: G3561 Permit: G3359																								
Select Permit: G 12568 *		2/5/1993	IRRIGATION																	1			1	
Additional Info: REERSLEV FARM App: G13283 Permit: G12568																								
Select Permit: G 12568 *		2/5/1993	SUPPLEMENTAL IRRIGATION (Suppl'mtl)															4.5	13.5	14	40	31		
Additional Info: REERSLEV FARM App: G13283 Permit: G12568																								
Select Claim:GR 1284 *		12/31/1952	IRRIGATION																	3.12	13.18	38.55	9.45	
Additional Info: JENS REERSLEV Claim: GR1284																								
Select Claim:GR 1285 *		12/31/1947	IRRIGATION																				19.53	
Additional Info: JENS REERSLEV Claim: GR1285																								
Select Claim:GR 1286 *		12/31/1944	IRRIGATION																	32.54			9.97	
Additional Info: JENS REERSLEV Claim: GR1286																								
Select Claim:GR 1405 *		12/31/1944	IRRIGATION													4.25								
Additional Info: JENNIE CLARIDGE Claim: GR1405																								



Search Criteria

No conflicts

Meridian: Township: Range: Section: Records per Page: Search [Platcards Maps!](#) [Learn about](#) [View Map](#)

Water Right	Changing Xfers	Priority	Use	Use Status	DLC	Gov't Lot	ac(40): Q(160):	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	Unknown QQ
Select Cert:38112 OR *		6/9/1966	IRRIGATION				1.5	40	40														15.8	
Additional Info: OLSE PETERSON ESTATE App: G3347 Permit: G3143 Cert: 38112																								
Select Cert:57929 OR *		2/14/1977	SUPPLEMENTAL IRRIGATION (Suppl'mtl)				16	30	40														15.8	
Additional Info: JENS REERSLEV App: G7724 Permit: G7366 Cert: 57929																								
Select Cert:41697 OR *	T12523	9/20/1968	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: G4605 Permit: G4329 Cert: 41697				X-Fer																				
Select Cert:46412 OR *		11/15/1971	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: G5660 Permit: G5487 Cert: 46412																								
Select Claim:GR 4123 *		12/31/1940	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4123																								
Select Claim:GR 4124 *		12/31/1942	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4124																								
Select Claim:GR 4122 *		12/31/1938	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4122																								
Select Permit: G 15215 *		8/10/2001	SUPPLEMENTAL IRRIGATION (Suppl'mtl)													5			2	14	10	17.5	4	
Additional Info: DON FISHER App: G15584 Permit: G15215																								
Select Claim:GR 2594 *		12/31/1925	IRRIGATION				14.5																	
Additional Info: O N PETERSEN Claim: GR2594																								
Select Claim:GR 3147 *		12/31/1948	IRRIGATION														12							
Additional Info: GEORGE H BAILEY Claim: GR3147																								
Select Claim:GR 3732 *		9/15/1952	IRRIGATION																	13.4			11.6	
Additional Info: CAREY L STROME Claim: GR3732																								
Select Claim:GR 3733 *		9/30/1952	IRRIGATION																	3.12				
Additional Info: CAREY L STROME Claim: GR3733																								
Select Cert:31998 OR CN		2/15/1961	MUNICIPAL USES		CN																			
Additional Info: CITY OF JUNCTION CITY App: G1678 Permit: G1749 Cert: 31998																								
Select Cert:37215 OR *		7/16/1965	IRRIGATION				8.4			1.5														
Additional Info: METHA ROGERS App: G3166 Permit: G2979 Cert: 37215																								
Select Cert:37587 OR *		6/25/1968	INDUSTRIAL/MANUFACTURING USES																					
Additional Info:																								



Search Criteria

no conflicts

Meridian: Township: Range: Section: Records per Page: Search [Platcards Maps!](#) [Learn about](#) [View Map](#)

Water Right	Changing Xfers	Priority	Use	Use Status	DLC	Gov't Lot	QA(40) Q(160)	NE NE	NW NE	SW NE	SE NE	NE NW	NW NW	SW NW	SE NW	NE SW	NW SW	SW SW	SE SW	NE SE	NW SE	SW SE	SE SE	Unknown QQ
Select Claim:GR 1200 *		5/13/1947	IRRIGATION																					15
Additional Info: EJNER P CHRISTIANSEN Claim: GR1200																								
Select Cert:30787 OR *		3/24/1959	IRRIGATION																				11.2	14.8
Additional Info: A L SCHWARTZ App: G1422 Permit: G1324 Cert: 30787																								
Select Permit: G 12568 *		2/5/1993	IRRIGATION			23	19														9.6			11
Additional Info: REERSLEV FARM App: G13283 Permit: G12568																								
Select Cert:38117 OR *		2/9/1967	IRRIGATION																					4.4
Additional Info: DALE & AUDREY MOORE App: G3802 Permit: G3588 Cert: 38117																								
Select Cert:41697 OR *	T12523	9/20/1968	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: G4605 Permit: G4329 Cert: 41697																								
Select Cert:48412 OR *		11/15/1971	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: G5660 Permit: G5487 Cert: 48412																								
Select App: LL 1632 *		2/22/2016	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY App: LL1632																								
Select Claim:GR 4123 *		12/31/1940	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4123																								
Select Claim:GR 4124 *		12/31/1942	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4124																								
Select Claim:GR 4122 *		12/31/1938	MUNICIPAL USES																					
Additional Info: CITY OF JUNCTION CITY Claim: GR4122																								
Select Permit: G 12568 *		2/5/1993	SUPPLEMENTAL IRRIGATION (Suppl'mtl)			30	19																	
Additional Info: REERSLEV FARM App: G13283 Permit: G12568																								
Select Claim:GR 1341 *		12/31/1945	IRRIGATION					20																
Additional Info: FRED PETERSEN Claim: GR1341																								
Select Claim:GR 2754 *		7/1/1948	IRRIGATION									13												
Additional Info: OLGA M MARTENSEN Claim: GR2754																								
Select Claim:GR 2934 *		7/31/1955	IRRIGATION							18														
Additional Info: JOHN A HENTZE Claim: GR2934																								
Select		6/30/1951	IRRIGATION			20																		

Additional Info:
WALTER M PETERSON
Claim: GR3599

Acreage Legend: 12.25 Regular acreage ~~42.25~~ Acreage is on a canceled right (12.25) Acreage is part of a transfer and has not been proven up on yet (inchoate) [12.25] Acreage has been suspended * Acreage is not specified



Search Criteria

No conflicts

Meridian: Township: Range: Section: Records per Page: Search

Platcards Maps!
Learn about View Map

Water Right	Changing Xfers	Priority	Use	Use Status	DLC	Gov't Lot	qq(40): qq(160):	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	Unknown QQ
Select Claim:GR 4196 *		12/31/1953	IRRIGATION																									5
Additional Info: LANE COUNTY SCHOOL DISTRICT 69 Claim: GR4196																												
Select Cert:31998 OR CN		2/15/1961	MUNICIPAL USES	CN																								
Additional Info: CITY OF JUNCTION CITY App: G1678 Permit: G1749 Cert: 31998																												
Select Cert:41697 OR *		T12523 9/20/1968	MUNICIPAL USES																									
Additional Info: CITY OF JUNCTION CITY App: G4605 Permit: G4329 Cert: 41697																												
Select Cert:46412 OR *		11/15/1971	MUNICIPAL USES																									
Additional Info: CITY OF JUNCTION CITY App: G5660 Permit: G5487 Cert: 46412																												
Select Cert:65071 CR *		2/15/1961	MUNICIPAL USES																									
Additional Info: CITY OF JUNCTION CITY App: G1678 Permit: G1749 Cert: 65071																												
Select Claim:GR 4123 *		12/31/1940	MUNICIPAL USES																									
Additional Info: CITY OF JUNCTION CITY Claim: GR4123																												
Select Claim:GR 4124 *		12/31/1942	MUNICIPAL USES																									
Additional Info: CITY OF JUNCTION CITY Claim: GR4124																												
Select Claim:GR 4122 *		12/31/1938	MUNICIPAL USES																									
Additional Info: CITY OF JUNCTION CITY Claim: GR4122																												
Select Claim:GR 1188 *		7/31/1951	IRRIGATION																									
Additional Info: ARNOLD R TRACER Claim: GR1188																												
Select Claim:GR 1250 *		7/1/1948	IRRIGATION																									
Additional Info: LYNN R MILLER Claim: GR1250																												
Select Cert:37928 OR *		6/22/1966	IRRIGATION																									
Additional Info: STANLEY B HALL App: G3547 Permit: G3336 Cert: 37928																												
Select Cert:43462 OR *		11/18/1966	IRRIGATION			1																						
Additional Info: GARY G HANSON App: G3728 Permit: G3464 Cert: 43462																												
Select Cert:43462 OR *		11/18/1966	IRRIGATION			59																						
Additional Info: GARY G HANSON App: G3728 Permit: G3464 Cert: 43462																												
Select Cert:50293 OR *		8/27/1975				7																						

Acreage Legend:	12.25 Regular acreage	-12.25- Acreage is on a canceled right	(12.25) Acreage is part of a transfer and has not been proven up on yet (inchoate)	[12.25] Acreage has been suspended	* Acreage is not specified
-----------------	-----------------------	--	--	------------------------------------	----------------------------

Land Use Information Form



Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, Oregon 97301-1266
(503) 986-0900
www.wrd.state.or.us

Applicant(s): City of Junction City Attn: Gary Kaping

Mailing Address: P.O. Box 250

City: Junction City

State: OR

Zip Code: 97448

Daytime Phone: (541) 998-3125

A. Land and Location

Please include the following information for all tax lots where water will be diverted (taken from its source), conveyed (transported), and/or used or developed. Applicants for municipal use, or irrigation uses within irrigation districts may substitute existing and proposed service-area boundaries for the tax-lot information requested below.

Township	Range	Section	¼ ¼	Tax Lot #	Plan Designation (e.g., Rural Residential/RR-5)	Water to be:			Proposed Land Use:
<u>See</u>	_____	_____	_____	_____	_____	☐ Diverted	☐ Conveyed	☐ Used	_____
<u>Attache</u>	_____	_____	_____	_____	_____	☐ Diverted	☐ Conveyed	☐ Used	_____
<u>d</u>	_____	_____	_____	_____	_____	☐ Diverted	☐ Conveyed	☐ Used	_____
<u>List</u>	_____	_____	_____	_____	_____	☐ Diverted	☐ Conveyed	☐ Used	_____
_____	_____	_____	_____	_____	_____	☐ Diverted	☐ Conveyed	☐ Used	_____

List all counties and cities where water is proposed to be diverted, conveyed, and/or used or developed:

Lane County

RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

B. Description of Proposed Use

Type of application to be filed with the Water Resources Department:

- ☐ Permit to Use or Store Water ☒ Water Right Transfer ☐ Permit Amendment or Ground Water Registration Modification
☐ Limited Water Use License ☐ Allocation of Conserved Water ☐ Exchange of Water

Source of water: ☐ Reservoir/Pond ☒ Ground Water ☐ Surface Water (name) _____

Estimated quantity of water needed: 1.83 ☒ cubic feet per second ☐ gallons per minute ☐ acre-feet

Intended use of water: ☐ Irrigation ☐ Commercial ☐ Industrial ☐ Domestic for _____ household(s)
☒ Municipal ☐ Quasi-Municipal ☐ Instream ☐ Other _____

Briefly describe:

The City proposes to update the place of use for the municipal water right and to add the 11th & Elm Well to the right as an additional point of appropriation. The right currently authorizes use of the 8th & Front Well.

Note to applicant: If the Land Use Information Form cannot be completed while you wait, please have a local government representative sign the receipt at the bottom of the next page and include it with the application filed with the Water Resources Department.

See bottom of Page 3. →

For Local Government Use Only

The following section must be completed by a planning official from each county and city listed unless the project will be located entirely within the city limits. In that case, only the city planning agency must complete this form. This deals only with the local land-use plan. Do not include approval for activities such as building or grading permits.

Please check the appropriate box below and provide the requested information

☒ Land uses to be served by the proposed water uses (including proposed construction) are allowed outright or are not regulated by your comprehensive plan. Cite applicable ordinance section(s):

☐ Land uses to be served by the proposed water uses (including proposed construction) involve discretionary land-use approvals as listed in the table below. (Please attach documentation of applicable land-use approvals which have already been obtained. Record of Action/land-use decision and accompanying findings are sufficient.) **If approvals have been obtained but all appeal periods have not ended, check "Being pursued."**

Type of Land-Use Approval Needed (e.g., plan amendments, rezones, conditional-use permits, etc.)	Cite Most Significant, Applicable Plan Policies & Ordinance Section References	Land-Use Approval:	
		☐ Obtained ☐ Denied	☐ Being Pursued ☐ Not Being Pursued
		☐ Obtained ☐ Denied	☐ Being Pursued ☐ Not Being Pursued
		☐ Obtained ☐ Denied	☐ Being Pursued ☐ Not Being Pursued
		☐ Obtained ☐ Denied	☐ Being Pursued ☐ Not Being Pursued
		☐ Obtained ☐ Denied	☐ Being Pursued ☐ Not Being Pursued

Local governments are invited to express special land-use concerns or make recommendations to the Water Resources Department regarding this proposed use of water below, or on a separate sheet.

RECEIVED BY OWRD

NOV 14 2016

Name: Jordan Cochran Title: Planner SALEM, OR

Signature: [Signature] Phone: 541 998 2153 Date: 10-31-16

Government Entity: City of Junction City

Note to local government representative: Please complete this form or sign the receipt below and return it to the applicant. If you sign the receipt, you will have 30 days from the Water Resources Department's notice date to return the completed Land Use Information Form or WRD may presume the land use associated with the proposed use of water is compatible with local comprehensive plans.

Receipt for Request for Land Use Information

Applicant name: _____

City or County: _____ Staff contact: _____

Signature: _____ Phone: _____ Date: _____

ATTACHMENT TO:

Oregon Water Resources Department
Land Use Information Form

RECEIVED BY OWRD

NOV 14 2016

Applicant Name: City of Junction City

SALEM, OR

A. Land and Location

Please include the following information for all tax lots where water will be diverted (taken from its source), conveyed (transported), or used. Applicants for municipal use, or irrigation uses within irrigation districts may substitute existing and proposed service-area boundaries for the tax-lot information requested below.

Township	Range	Section	¼ ¼	Tax Lot #	Plan designation	Water to be:	Proposed Land Use:
15 S	5 W	36	E 1/2	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	29	SW SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	29	SE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	30	SW SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	30	SE SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	31	All QQs	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	32	W 1/2	--		☒ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	32	SW NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	32	NW SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	32	SW SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
15 S	4 W	32	SE SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	5	NW NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	5	SW NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	5	W 1/2	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	5	NW SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	6	NE NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	6	NW NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	6	SE NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	8	NE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	8	NW NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	8	SE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	8	NE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	8	SE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	17	SW NE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	17	NE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change

T 12523

Township	Range	Section	¼ ¼	Tax Lot #	Plan designation	Water to be:	Proposed Land Use:
16 S	4 W	17	SE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	17	NE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	17	SE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	17	NW SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	17	SW SE	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	20	NE 1/4	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	20	NE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	20	SE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	20	NE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	20	SE SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	20	SE 1/4	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	21	SW SW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	29	W 1/2 of NE 1/4	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	29	NE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change
16 S	4 W	29	SE NW	--		☐ Diverted ☒ Conveyed ☒ Used	No Change

RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

T 12523



State of Oregon
Water Resources Department
725 Summer Street NE, Suite A
Salem, Oregon 97301-1266
(503) 986-0900

Application for Permanent Water Right Transfer

Part 1 of 5 – Minimum Requirements Checklist

This transfer application will be returned if Parts 1 through 5 and all required attachments are not completed and included.

For questions, please call (503) 986-0900, and ask for Transfer Section. **RECEIVED BY OWRD**

Check all items included with this application. (N/A = Not Applicable)

NOV 14 2016

- ☒ Part 1 – Completed Minimum Requirements Checklist. ✓
- ☒ Part 2 – Completed Transfer Application Map Checklist. ✓ **SALEM, OR**
- ☒ Part 3 – Application Fee, payable by check to the Oregon Water Resources Department, and completed Fee Worksheet, page 3. Try the new online fee calculator at: http://apps.wrd.state.or.us/apps/misc/wrd_fee_calculator. If you have questions, call Customer Service at (503) 986-0801. ✓
- ☒ Part 4 – Completed Applicant Information and Signature. ✓
- ☒ Part 5 – Information about Water Rights to be Transferred: **How many water rights are to be transferred? 1 List them here: 41697** ✓
Please include a separate Part 5 for each water right. (See instructions on page 6) ✓

Attachments:

- ☒ Completed Transfer Application Map. ✓
- ☐ ☒ N/A Municipal Right Completed Evidence of Use Affidavit and supporting documentation.
- ☐ ☒ N/A Affidavit(s) of Consent from Landowner(s) (if the applicant does not own the land the water right is on.)
- ☐ ☒ N/A Supplemental Form D – For water rights served by or issued in the name of an irrigation district. Complete when the transfer applicant is not the irrigation district.
- ☒ ☒ N/A Land Use Information Form with approval and signature (or signed land use form receipt stub). Not required if water is to be diverted, conveyed, and/or used only on federal lands or if **all** of the following apply: a) a change in place of use only, b) no structural changes, c) the use of water is for irrigation only, and d) the use is located within an irrigation district or an exclusive farm use zone.
- ☒ ☒ N/A Water Well Report/Well Log for changes in point(s) of appropriation (well(s)) or additional point(s) of appropriation.
- ☐ ☒ N/A Geologist Report for a change from a surface water point of diversion to a ground water point of appropriation (well), if the proposed well is more than 500' from the surface water source and more than 1000' upstream or downstream from the point of diversion. See OAR 690-380-2130 for requirements and applicability.

(For Staff Use Only)

WE ARE RETURNING YOUR APPLICATION FOR THE FOLLOWING REASON(S):

- ☐ Application fee not enclosed/insufficient ☐ Map not included or incomplete
- ☐ Land Use Form not enclosed or incomplete
- ☐ Additional signature(s) required ☐ Part _____ is incomplete

Other/Explanation _____

Staff: _____ 503-986-0_____

Date: ____/____/____

Part 2 of 5 – Transfer Application Map Checklist

Your transfer application will be returned if any of the map requirements listed below are not met.

Please be sure that the transfer application map you submit includes all the required items and matches the existing water right map. Check all boxes that apply.

- ☒ ☐ N/A Certified Water Right Examiner (CWRE) Stamp and Original Signature. For a list of CWREs, see http://apps.wrd.state.or.us/apps/wr/cwre_license_view/. CWRE stamp and signature are not required for substitutions.
- ☐ ☒ N/A If **more than three** water rights are involved, separate maps are needed for each water right.
- ☒ Permanent quality printed with dark ink on good quality paper.
- ☒ The size of the map can be 8½ x 11 inches, 8½ x 14 inches, 11 x 17 inches, or up to 30 x 30 inches. For 30 x 30 inch maps, one extra copy is required.
- ☒ A north arrow, a legend, and scale.
- ☒ The scale of the map must be: 1 inch = 400 feet, 1 inch = 1,320 feet, the scale of the Final Proof/Claim of Beneficial Use Map (the map used when the permit was certificated), the scale of the county assessor map if the scale is not smaller than 1 inch = 1,320 feet, or a scale that has been pre-approved by the Department.
- ☒ Township, Range, Section, ¼ ¼, DLC, Government Lot, and other recognized public land survey lines.
- ☐ ☒ N/A Municipal Right. Tax lot boundaries (property lines) are required. Tax lot numbers are recommended.
- ☒ Major physical features including rivers and creeks showing direction of flow, lakes and reservoirs, roads, and railroads.
- ☒ See Separate Map Major water delivery system features from the point(s) of diversion/appropriation such as main pipelines, canals, and ditches.
- ☒ Existing place of use that includes separate hachuring for each water right, priority date, and use including number of acres in each quarter-quarter section, government lot, or in each quarter-quarter section as projected within government lots, donation land claims, or other recognized public land survey subdivisions. If less than the entirety of the water right is being changed, a separate hachuring is needed for lands left unchanged.
- ☒ ☐ N/A Proposed place of use that includes separate hachuring for each water right, priority date, and use including number of acres in each quarter-quarter section, government lot, or in each quarter-quarter section as projected within government lots, donation land claims, or other recognized public land survey subdivisions.
- ☒ Existing point(s) of diversion or well(s) with distance and bearing or coordinates from a recognized survey corner. This information can be found in your water right certificate or permit.
- ☒ ☐ N/A If you are proposing a change in point(s) of diversion or well(s), show the proposed location and label it clearly with distance and bearing or coordinates. If GPS coordinates are used, latitude-longitude coordinates may be expressed as either degrees-minutes-seconds with at least one digit after the decimal (example – 42°32'15.5") or degrees-decimal with five or more digits after the decimal (example – 42.53764°).

RECEIVED BY OWRB

NOV 14 2016

Revised 7/1/2013

Permanent Transfer Application Form – Page 2 of 15

T 12523

TACS

SALEM, OR

Part 3 of 5 – Fee Worksheet

RECEIVED BY OWRD
NOV 14 2016
SALEM, OR

1. For irrigation calculate cfs for each water right involved as follows:
 - a. Divide total authorized cfs by total acres in the water right (*for C12345, 1.25 cfs ÷ 100 ac*); then multiply by the number of acres to be transferred to get the transfer cfs (*x 45 ac = 0.56 cfs*).
 - b. If the water right certificate does not list total cfs, but identifies the allowable use as 1/40 or 1/80 of a cfs per acre; multiply number of acres proposed for change by either 0.025 (1/40) or 0.0125 (1/80). (*For C87654, 45.0 ac x 0.0125 cfs/ac = 0.56 cfs*)
2. Add cfs for the portions of water rights on all the land included in the transfer; however **do not count cfs for supplemental rights on acreage for which you have already calculated the cfs fee for the primary right on the same land**. The fee should be assessed only once for each “on the ground” acre included in the transfer. (*In this example, blank 5a would be only 0.56 cfs, since both rights serve the same 45.0 acres. Blank 5b would be 0 and Line 5 would then also become 0*).

Revised 7/1/2013

T 12523

3	Add entries on lines 1 through 2 above » » » » » » Fee for Substitution:	3	NA

RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

Part 4 of 5 – Applicant Information and Signature

Applicant Information

APPLICANT/BUSINESS NAME City of Junction City Attn: Gary Kaping			PHONE NO. (541) 998-3125	ADDITIONAL CONTACT NO.
ADDRESS P.O. Box 250			FAX NO.	
CITY Junction City	STATE OR	ZIP 97448	E-MAIL gkaping@ci.junction-city.or.us	
BY PROVIDING AN E-MAIL ADDRESS, CONSENT IS GIVEN TO RECEIVE ALL CORRESPONDENCE FROM THE DEPARTMENT ELECTRONICALLY. COPIES OF THE FINAL ORDER DOCUMENTS WILL ALSO BE MAILED.				

Agent Information – The agent is authorized to represent the applicant in all matters relating to this application.

AGENT/BUSINESS NAME Steven R. Bruce/Skookum Water Associates Inc.			PHONE NO. (503) 319-8926	ADDITIONAL CONTACT NO.
ADDRESS 1626 Victorian Way			FAX NO.	
CITY Eugene	STATE OR	ZIP 97401	E-MAIL steve@skookumwater.com	
BY PROVIDING AN E-MAIL ADDRESS, CONSENT IS GIVEN TO RECEIVE ALL CORRESPONDENCE FROM THE DEPARTMENT ELECTRONICALLY. COPIES OF THE FINAL ORDER DOCUMENTS WILL ALSO BE MAILED.				

Explain in your own words what you propose to accomplish with this transfer application, and why: The intent is to transfer 1.11 cfs (approximately 500 gpm) of the 1.83 cfs right from the 8th & Front Street Well (LANE 8367) to the 11th & Elm Street Well (LANE 70495) and to add places of use to this municipal right.

If you need additional space, continue on a separate piece of paper and attach to the application as "Attachment 1".

- ☐ Check this box if this project is fully or partially funded by the American Recovery and Reinvestment Act. (Federal stimulus dollars)

Check One Box

- ☐ By signing this application, I understand that, upon receipt of the draft preliminary determination and prior to Department approval of the transfer, I will be required to provide landownership information and evidence that I am authorized to pursue the transfer as identified in OAR 690-380-4010(5); **OR**
- ☒ I affirm the applicant is a municipality as defined in ORS 540.510(3)(b) and that the right is in the name of the municipality or a predecessor; **OR**
- ☐ I affirm the applicant is an entity with the authority to condemn property and is acquiring by condemnation the property to which the water right proposed for transfer is appurtenant and have supporting documentation.


NOV 14 2016

SALEM, OR

I understand that prior to Department approval of the transfer application, I may be required to submit payment to the Department for publication of a notice in a newspaper with general circulation in the area where the water right is located, once per week for two consecutive weeks. If more than one qualifying newspaper is available, I suggest publishing the notice in the following newspaper: Eugene Register Guard.

I (we) affirm that the information contained in this application is true and accurate.

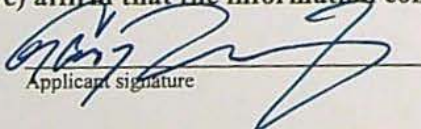


Applicant signature

Gary Kaping; Public Works Director
Print Name (and Title if applicable)

10/28/16
Date

Applicant signature

Print Name (and Title if applicable)

Date

Is the applicant the sole owner of the land on which the water right, or portion thereof, proposed for transfer is located? ☐ Yes ☒ No If NO, include signatures of all deeded landowners (and mailing and/or e-mail addresses if different than the applicant's) or attach affidavits of consent (and mailing and/or e-mail addresses) from all landowners or individuals/entities to which the water right(s) were conveyed.

Check the following boxes that apply:

- ☒ The applicant is responsible for completion of change(s). Notices and correspondence should continue to be sent to the applicant.
- ☐ The receiving landowner will be responsible for completing the proposed change(s) after the final order is issued. Copies of notices and correspondence should be sent to this landowner.
- ☐ Both the receiving landowner and applicant will be responsible for completion of change(s). Copies of notices and correspondence should be sent to this landowner and the applicant.

At this time, are the lands in this transfer application in the process of being sold? ☐ Yes ☒ No

If YES, and you know who the new landowner will be, please complete the receiving landowner information table below. If you do not know who the new landowner will be, then a request for assignment will have to be filed for at a later date.

If a property sells, the certificated water right(s) located on the land belong to the new owner, unless a sale agreement or other document states otherwise. For more information see:

<http://www.oregon.gov/owrd/docs/transfer-propertytransactions.pdf>

RECEIVING LANDOWNER NAME NA			PHONE NO.	ADDITIONAL CONTACT NO.
ADDRESS			FAX NO.	
CITY	STATE	ZIP	E-MAIL	

Describe any special ownership circumstances here: _____

- ☐ Check here if any of the water rights proposed for transfer are or will be located within or served by an irrigation or other water district. (Tip: Complete and attach Supplemental Form D.)

IRRIGATION DISTRICT NAME NA	ADDRESS	
CITY	STATE	ZIP

- ☐ Check here if water for any of the rights supplied under a water service agreement or other contract for stored water with a federal agency or other entity.

ENTITY NAME NA	ADDRESS	
CITY	STATE	ZIP

 To meet State Land Use Consistency Requirements, you must list all county, city, municipal corporation, or tribal governments within whose jurisdiction water will be diverted, conveyed or used.

ENTITY NAME City of Junction City Planning & Building Dept.	ADDRESS P.O Box 250	
CITY Junction City	STATE OR	ZIP 97448

ENTITY NAME	ADDRESS	
CITY	STATE	ZIP

RECEIVED BY OWRD

Part 5 of 5 – Water Right Information

Please use a separate Part 5 for each water right being changed. See instructions on page 6, to copy and paste additional Part 5s, or to add additional rows to tables within the form.

CERTIFICATE # 41697

Description of Water Delivery System

System capacity: 1.67 cubic feet per second (cfs) OR
_____ gallons per minute (gpm)

Describe the current water delivery system or the system that was in place at some time within the last five years. Include information on the pumps, canals, pipelines and sprinklers used to divert, convey and apply the water at the authorized place of use. The well has a 60-hp US Motor connected to a centrifugal pump Model 10HT5 (manufacturer unknown) with an 8-inch-diameter discharge. The pump is reported to produce approximately 750 gpm with an operating pressure of 80 psi. The well is connected to the municipal water supply system.

Table 1. Location of Authorized and Proposed Point(s) of Diversion (POD) or Appropriation (POA)
(Note: If the POD/POA name is not specified on the certificate, assign it a name or number here.)

POD/POA Name or Number	Is this POD/POA Authorized on the Certificate or is it Proposed?	If POA, OWRD Well Log ID# (or Well ID Tag # L-___)	Twp	Rng	Sec	¼ ¼	Tax Lot, DLC or Gov't Lot	Measured Distances (from a recognized survey corner)
8 th & Front Well	☒ Authorized ☐ Proposed	30707	15 S	4 W	32	NE SW	--	2390 ft N and 3330 ft W of SE corner of Section 32
11 th & Elm Well	☐ Authorized ☒ Proposed	76770	15 S	4 W	32	SE NW	--	3140 ft N and 2930 ft W of SE corner of Section 32

Check all type(s) of change(s) proposed below (change "CODES" are provided in parentheses):

- | | |
|--|--|
| ☒ Place of Use (POU) | ☐ Supplemental Use to Primary Use (S to P) |
| ☐ Character of Use (USE) | ☐ Point of Appropriation/Well (POA) |
| ☐ Point of Diversion (POD) | ☒ Additional Point of Appropriation (APOA) |
| ☐ Additional Point of Diversion (APOD) | ☐ Substitution (SUB) |
| ☐ Surface Water POD to Ground Water POA (SW/GW) | ☐ Government Action POD (GOV) |

Will all of the proposed changes affect the entire water right?

- ☒ Yes Complete only the Proposed ("to" or "on" lands) section of Table 2 on the next page. Use the "CODES" listed above to describe the proposed changes.
- ☐ No Complete all of Table 2 to describe the portion of the water right to be changed.

RECEIVED BY OWRD

NOV 14 2016

Please use and attach additional pages of Table 2 as needed.
See page 6 for instructions.

Do you have questions about how to fill-out the tables?
Contact the Department at 503-986-0900 and ask for Transfer Staff.

Table 2. Description of Changes to Water Right Certificate # 41697

List the change proposed for the acreage in each ¼ ¼. If more than one change is proposed, specify the acreage associated with each change.
If there is more than one POD/POA involved in the proposed changes, specify the acreage associated with each POD/POA.

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.											
Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)	Priority Date		Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date		
										POU/APOA	15	S	5	W	36	NE	NE	--	--	No Change	Both Wells	9/20/1968
										POU/APOA	15	S	5	W	36	NW	NE	--	--	"	"	9/20/1968
										POU/APOA	15	S	5	W	36	SW	NE	--	--	"	"	9/20/1968
										POU/APOA	15	S	5	W	36	SE	NE	--	--	"	"	9/20/1968
										POU/APOA	15	S	5	W	36	NE	SE	--	--	"	"	9/20/1968
										POU/APOA	15	S	5	W	36	NW	SE	--	--	"	"	9/20/1968
										POU/APOA	15	S	5	W	36	SW	SE	--	--	"	"	9/20/1968
										POU/APOA	15	S	5	W	36	SE	SE	--	--	"	"	9/20/1968
										APOA	15	S	4	W	29	SW	SW	--	--	"	"	9/20/1968
										APOA	15	S	4	W	29	SE	SW	--	--	"	"	9/20/1968

Additional remarks: To save space on Table 2, "Both Wells" refer to the 8th & Front Well and the 11th & Elm Well. The type of use for this right (municipal use) is not being changed. The ditto marks are intended to save space, given the large number of entries on the table. Government Lot and DLC numbers have been omitted on the table per Steven R. Bruce's September 20, 2016 discussion with Sarah Henderson of the Department, but are shown on the supporting transfer map. Taxlot and acres do not apply because the right is for municipal use.

T 12523

RECEIVED BY OWRD

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.													
Twp	Rng	Sec	¼	¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)		Priority Date	Twp	Rng	Sec	¼	¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date		
											POU/APOA	15	S	4	W	29	NW	SE	--	--	--	No Change	Both Wells	9/20/1968
											POU/APOA	15	S	4	W	29	SW	SE	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	30	SE	SW	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	30	SW	SE	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	30	SE	SE	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	31	NE	NE	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	31	NW	NE	--	--	--	"	"	9/20/1968
											APOA	15	S	4	W	31	SW	NE	--	--	--	"	"	9/20/1968
											APOA	15	S	4	W	31	SE	NE	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	31	NE	NW	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	31	NW	NW	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	31	SW	NW	--	--	--	"	"	9/20/1968
											POU/APOA	15	S	4	W	31	SE	NW	--	--	--	"	"	9/20/1968

RECEIVED BY OWRD

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.												
Twsp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)	Priority Date		Twsp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date			
										POU/APOA	15	S	4	W	31	NE	SW	--	--	--	No Change	Both Wells	9/20/1968
										POU/APOA	15	S	4	W	31	NW	SW	--	--	--	"	"	9/20/1968
										POU/APOA	15	S	4	W	31	SW	SW	--	--	--	"	"	9/20/1968
										POU/APOA	15	S	4	W	31	SE	SW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	31	NE	SE	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	31	NW	SE	--	--	--	"	"	9/20/1968
										POU/APOA	15	S	4	W	31	SW	SE	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	31	SE	SE	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SW	NE	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	NE	NW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	NW	NW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SW	NW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SE	NW	--	--	--	"	"	9/20/1968

RECEIVED BY OWRD

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.												
Twsp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)	Priority Date		Twsp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date			
										APOA	15	S	4	W	32	NE	SW	--	--	--	No Change	Both Wells	9/20/1968
										APOA	15	S	4	W	32	NW	SW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SW	SW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SE	SW	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	NW	SE	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SW	SE	--	--	--	"	"	9/20/1968
										APOA	15	S	4	W	32	SE	SE	--	--	--	"	"	9/20/1968
										APOA	16	S	4	W	5	NW	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	5	SW	NE	--	--	--	"	"	9/20/1968
										APOA	16	S	4	W	5	NE	NW	--	--	--	"	"	9/20/1968
										APOA	16	S	4	W	5	NW	NW	--	--	--	"	"	9/20/1968
										APOA	16	S	4	W	5	SW	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	5	SE	NW	--	--	--	"	"	9/20/1968

RECEIVED BY OWRD

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.												
Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)	Priority Date		Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date			
										POU/APOA	16	S	4	W	5	NE	SW	--	--	--	No Change	Both Wells	9/20/1968
										POU/APOA	16	S	4	W	5	NW	SW	--	--	--	"	"	9/20/1968
										/POUAPOA	16	S	4	W	5	SW	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	5	SE	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	5	NW	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	6	NE	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	6	NW	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	6	SE	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	8	NE	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	8	NW	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	8	SE	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	8	NE	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	8	SE	SW	--	--	--	"	"	9/20/1968

RECEIVED BY OWRD

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.												
Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)	Priority Date		Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date			
										POU/APOA	16	S	4	W	17	SW	NE	--	--	--	No Change	Both Wells	9/20/1968
										POU/APOA	16	S	4	W	17	NE	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	17	SE	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	17	NE	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	17	SE	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	17	NW	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	17	SW	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	NE	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	NW	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	SW	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	SE	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	NE	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	SE	NW	--	--	--	"	"	9/20/1968

AUTHORIZED (the "from" or "off" lands) The listing that appears on the certificate BEFORE PROPOSED CHANGES List only that part or portion of the water right that will be changed.										Proposed Changes (see "CODES" from previous page)	PROPOSED (the "to" or "on" lands) The listing as it would appear AFTER PROPOSED CHANGES are made.												
Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	Type of USE listed on Certificate	POD(s) or POA(s) (name or number from Table 1)	Priority Date		Twp	Rng	Sec	¼ ¼	Tax Lot	Gvt Lot or DLC	Acres	New Type of USE	POD(s)/ POA(s) to be used (from Table 1)	Priority Date			
										POU/APOA	16	S	4	W	20	NE	SW	--	--	--	No Change	Both Wells	9/20/1968
										POU/APOA	16	S	4	W	20	SE	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	NE	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	NW	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	SW	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	20	SE	SE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	21	SW	SW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	29	NW	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	29	SW	NE	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	29	NE	NW	--	--	--	"	"	9/20/1968
										POU/APOA	16	S	4	W	29	SE	NW	--	--	--	"	"	9/20/1968

1 12523

RECEIVED BY OWRD

For Place of Use or Character of Use Changes

Are there other water right certificates, water use permits or ground water registrations associated with the "from" or the "to" lands? ☒ Yes ☐ No

If YES, list the certificate, water use permit, or ground water registration numbers: Certificates 464122 and 65071; Permits G-12057, G-12121 and G-12123; and GR-4122, GR-4123, GR-4124 & GR-4125

Pursuant to ORS 540.510, any "layered" water use such as an irrigation right that is supplemental to a primary right proposed for transfer must be included in the transfer or be cancelled. Any change to a ground water registration must be filed separately in a ground water registration modification application.

For Substitution (ground water supplemental irrigation will be substituted for surface water primary irrigation)

Ground water supplemental Permit or Certificate # NA:

Surface water primary Certificate # NA.

RECEIVED BY OWRD

For a change from Supplemental Irrigation Use to Primary Irrigation Use

NOV 14 2016

Identify the primary certificate to be cancelled. Certificate # NA

SALEM, OR

For a change in point(s) of appropriation (well(s)) or additional point(s) of appropriation:

- ☒ Well log(s) are attached for each authorized and proposed well(s) that are clearly labeled and associated with the corresponding well(s) in Table 1 above and on the accompanying application map.

Tip: You may search for well logs on the Department's web page at:

http://apps.wrd.state.or.us/apps/gw/well_log/Default.aspx

AND/OR

- ☐ Describe the construction of the authorized and proposed well(s) in Table 3 for any wells that do not have a well log. For *proposed wells not yet constructed or built*, provide "a best estimate" for each requested information element in the table. The Department recommends you consult a licensed well driller, geologist, or certified water right examiner to assist with assembling the information necessary to complete Table 3.

Table 3. Construction of Point(s) of Appropriation

Any well(s) in this listing must be clearly tied to corresponding well(s) described in Table 1 and shown on the accompanying application map. Failure to provide the information will delay the processing of your transfer application until it is received. The information is necessary for the department to assess whether the proposed well(s) will access the same source aquifer as the authorized point(s) of appropriation (POA). The Department is prohibited by law from approving POA changes that do not access the same source aquifer.

Proposed or Authorized POA Name or Number	Is well already built? (Yes or No)	If an existing well: OWRD Well ID Tag No. L-	Total well depth	Casing Diameter	Casing Intervals (feet)	Seal depth(s) (intervals)	Perforated or screened intervals (in feet)	Static water level of completed well (in feet)	Source aquifer (sand, gravel, basalt, etc.)	Well -specific rate (cfs or gpm). If less than full rate of water right
8 th & Front	Yes	30707	135 ft	12 in	0 to 88	0 to 30	85 - 111	14	Alluvial Aquifer	0.72
11 th & Elm	Yes	76770	270 ft	16 in & 10 in	+2 to 142	0 to 76 ft	135 to 183 and 224.5 to 263.5	15	Alluvial Aquifer	1.11

T 12523

NOTICE TO WATER WELL CONTRACTOR

The original and first copy
of this report are to be
filed with

STATE ENGINEER, SALEM, OREGON
within 30 days from the date
of well completion

LANE 8367

WATER WELL REPORT

STATE OF OREGON

(Please type or print)
(Do not write above this line)

STATE ENGINEER
SALEM, OREGON

STATE ENGINEER
SALEM, OREGON

LANE

8367

State Well No.

16/4w-36

State Permit No.

(1) OWNER:

Name City of Junction
Address Junction City, Oregon

(2) TYPE OF WORK (check):

New Well ☒ Deepening ☐ Reconditioning ☐ Abandon ☐

If abandonment, describe material and procedure in Item 12.

(3) TYPE OF WELL:

Rotary ☐ Driven ☐
Cable ☒ Jetted ☐
Dug ☐ Bored ☐

(4) PROPOSED USE (check):

Domestic ☐ Industrial ☐ Municipal ☒
Irrigation ☐ Test Well ☐ Other ☐

(5) CASING INSTALLED:

12" Diam. from GL ft. to 88 ft. Gage 330
" Diam. from _____ ft. to _____ ft. Gage _____
" Diam. from _____ ft. to _____ ft. Gage _____

(6) PERFORATIONS:

Perforated? ☐ Yes ☒ No.

Type of perforator used _____

Size of perforations in. by in.
_____ perforations from _____ ft. to _____ ft.
_____ perforations from _____ ft. to _____ ft.
_____ perforations from _____ ft. to _____ ft.
_____ perforations from _____ ft. to _____ ft.
_____ perforations from _____ ft. to _____ ft.

(7) SCREENS:

Well screen installed? ☒ Yes ☐ No

Manufacturer's Name Johnson
Type Stainless Steel Model No. _____
Diam. 1 1/2 Slot size 35 Set from 85 ft. to 90 ft.
Diam. 1 1/2 Slot size 45 Set from 90 ft. to 96 ft.
1 1/2 20 96 111

(8) WATER LEVEL: Completed well 30-111-125

Static level 17 14 ft. below land surface Date _____

Artesian pressure _____ lbs. per square inch Date 8/23/68

(9) WELL TESTS:

Drawdown is amount water level is
lowered below static level

Was a pump test made? ☒ Yes ☐ No If yes, by whom? WW Drilling

750 gal./min. with 14 ft. drawdown after 1 hrs.
940 " " 30 " 2 "
" 940 " 38 " 8 "

Ball test gal./min. with ft. drawdown after hrs.

Artesian flow g.p.m. Date

Temperature of water Was a chemical analysis made? ☐ Yes ☒ No

(10) CONSTRUCTION:

Well seal—Material used Cement

Depth of seal 30 ft.

Diameter of well bore to bottom of seal 16 in.

Were any loose strata cemented off? ☐ Yes ☒ No Depth _____

Was a drive shoe used? ☒ Yes ☐ No

Did any strata contain unusable water? ☐ Yes ☒ No

Type of water? _____ depth of strata _____

Method of sealing strata off _____

Was well gravel packed? ☐ Yes ☒ No Size of gravel: _____

Gravel placed from _____ ft. to _____ ft.

(11) LOCATION OF WELL:

County Lane Driller's well number _____
1/4 1/4 Section 36 T. 16S R. 4W

Bearing and distance from section or subdivision corner _____

(12) WELL LOG:

Diameter of well below casing 12

Depth drilled 135 ft. Depth of completed well 135 ft.

Formation: Describe color, texture, grain size and structure of materials; and show thickness and nature of each stratum and aquifer penetrated, with at least one entry for each change of formation. Report each change in position of Static Water Level as drilling proceeds. Note drilling rates.

MATERIAL	From	To	SWL
Brown clay	0	11	
Loose sand & clay	11	14	
Sand & small gravel	14	21	
Tight sand & gravel	21	24	
Sand & small gravel	24	30	
Cemented sand & gravel	30	36	
Light brown sandy clay some gravel	36	42	
Brown sandy clay	42	53	
Brown sand	53	55	
Brown sandy clay	55	60	
Blue clay	60	70	
Blue sand	70	78	
Blue sand & wood	78	94	
Blue sand & pea gravel	94	98	
Blue sand some gravel & clay	98	108	
Blue sand	108	114	
Small gravel, blue sand & wood	114	125	
Blue sandy clay	125	135	

Work started 8/5/68 19 Completed 8/23/68 19

Date well drilling machine moved off of well 8/23/68 19

Drilling Machine Operator's Certification:

This well was constructed under my direct supervision. Materials used and information reported above are true to my best knowledge and belief.

[Signed] W. W. Drilling Date 8/23, 1968
(Drilling Machine Operator)

Drilling Machine Operator's License No. 24

Water Well Contractor's Certification:

This well was drilled under my jurisdiction and this report is true to the best of my knowledge and belief.

NAME W. W. Drilling & Pump Service
(Person, firm or corporation) (Type or print)

Address 2320 Main, Springfield, Oregon

[Signed] Walt Wilson
(Water Well Contractor)

Contractor's License No. 268 Date 9/4/68, 19

(USE ADDITIONAL SHEETS IF NECESSARY)

T 12523

MAY 27 2010

STATE OF OREGON
WATER SUPPLY WELL REPORT
(as required by ORS 537.765)

WATER RESOURCES DEPT
SALEM, OREGON

WELL I.D. # L 76770
START CARD # W 205112

Instructions for completing this report are on the last page of this form.

(1) LAND OWNER
Name City of Junction City Well Number _____
Address P.O. Box 250
City Junction City State OR Zip 97448

(2) TYPE OF WORK
☒ New Well ☐ Deepening ☐ Alteration (repair/recondition) ☐ Abandonment

(3) DRILL METHOD:
☐ Rotary Air ☐ Rotary Mud ☒ Cable ☐ Auger
☐ Other _____

(4) PROPOSED USE:
☐ Domestic ☒ Community ☐ Industrial ☐ Irrigation
☐ Thermal ☐ Injection ☐ Livestock ☐ Other _____

(5) BORE HOLE CONSTRUCTION:
Special Construction approval ☐ Yes ☒ No Depth of Completed Well 267.5' ft.
Explosives used ☐ Yes ☒ No Type _____ Amount _____

HOLE			SEAL				
Diameter	From	To	Material	From	To	Sacks or pounds	
20"	0	77	Cement	0	70	76 - 94 lb sbs	
Formation Seal			Quick Grout	70	76	6 - 50 lb sbs	

How was seal placed: Method ☐ A ☐ B ☐ C ☐ D ☐ E
☒ Other Pressure grouted thru trimmie pipe

Backfill placed from _____ ft. to _____ ft. Material _____
Gravel placed from _____ ft. to _____ ft. Size of gravel _____

(6) CASING/LINER:

Diameter	From	To	Gauge	Steel	Plastic	Welded	Threaded
Casing: 16"	+2	142.5		☒	☐	☒	☐
				☐	☐	☐	☐
				☐	☐	☐	☐
10"	132.5	135		☒	☐	☒	☐
Liner: 10"	183	224.5		☒	☐	☒	☐
10"	263.5	267.5		☒	☐	☒	☐

Drive Shoe used ☐ Inside ☐ Outside ☐ None
Final location of shoe(s) _____

(7) PERFORATIONS/SCREENS:
☐ Perforations Method _____
☒ Screens Type Alloy Material Stainless Steel

From	To	Slot size	Number	Diameter	Tele/pipe size	Casing	Liner
135	183	35		10"		☐	☐
224.5	263.5	35		10"		☐	☐

(8) WELL TESTS: Minimum testing time is 1 hour

Yield gal/min	Drawdown	Drill stem at	Flowing Time
1102	94'3"		48 Hrs.

Temperature of water 55.2° Depth Artesian Flow Found _____
Was a water analysis done? ☒ Yes By whom Owner
Did any strata contain water not suitable for irrigation? ☐ Too little
☐ Salty ☐ Muddy ☐ Odor ☐ Colored ☐ Other _____
Depth of strata: _____

(9) LOCATION OF WELL by legal description:
County Lane Latitude _____ Longitude _____
Township 15 S N or S Range 4 W E or W. WM.
Section 32 SE 1/4 NW 1/4
Tax Lot R.O.W. Lot _____ Block _____ Subdivision _____
Street Address of Well (or nearest address) 11th & Elm St.
Junction City, OR

(10) STATIC WATER LEVEL:
15 ft. below land surface. Date 5-18-10
Artesian pressure _____ lb. per square inch Date _____

(11) WATER BEARING ZONES:

From	To	Estimated Flow Rate	SWL
18	35		
36	40		
80	102		15
138	158		15
170	185		

(12) WELL LOG: Continued on page # 2
Ground Elevation _____

Material	From	To	SWL
Fill	0	3	
Brown clay gravel	3	5	
Brown clay	5	14	
Brown gravel clay	14	18	
Brown gravel sand, water	18	35	
Brown sandstone	35	36	
Brown red gravel sandstone,			
clay, less water	36	40	
Blue clay	40	53	
Gray clay sandy seams	53	80	
Gray sandy clay, some water	80	102	
Gray clay sand little gravel	102	113	
Gray blue sandy clay	113	121	
Gray sandy clay wood	121	128	
Gray sandy clay	128	138	
Gray sand, silt, clay, water	138	152	
Gray sand silt clay wood,			
water	152	168	
Gray sandy clay	168	170	

Date started 2-9-10 Completed 5-20-10

(unbonded) Water Well Constructor Certification:
I certify that the work I performed on the construction, alteration, or abandonment of this well is in compliance with Oregon water supply well construction standards. Materials used and information reported above are true to the best of my knowledge and belief. Terry Johnson
Signed Terry Johnson WWC Number 1321 Date 5-24-10

(bonded) Water Well Constructor Certification:
I accept responsibility for the construction, alteration, or abandonment work performed on this well during the construction dates reported above. All work performed during this time is in compliance with Oregon water supply well construction standards. This report is true to the best of my knowledge and belief.
Signed Ron Aspaas WWC Number 1445 Date 5-24-10

WELL I.D. # L 76770
START CARD # W 205112

City of Junction City
Well # L 76770

LANE 70495

Lane
70495

Cement Surface Seal

70'

TO SURFACE

16" Casing 2' Above Ground

35'
TOP OF PARTIAL BENTONITE SEAL

70' Bentonite Followed Drive Shoe Down

77'
BOTTOM OF SEAL CASING

132'6"

TOP OF SCREEN BLANK
AND 8-12 CSS CONTINUOUS FILTER PACK

135'

TOP OF UPPER SCREEN

142'6"

BOTTOM OF CASING

CONTINUOUS FILTER PACK 8-12 CSS
227 50 Lb. Sks.
10-INCH DIAMETER 3/8 SLOT WELL SCREEN

183'

BOTTOM OF UPPER SCREEN

BLANK SCREEN CASING

224'6"

TOP OF LOWER SCREEN

10-INCH DIAMETER 3/8 SLOT WELL SCREEN

10-INCH DIAMETER 3/8 SLOT WELL SCREEN

Casing Cut @ 263 Ft.

6' Shoe Remnant

Backfill

Colorado Sand

263'6"

BOTTOM OF LOWER SCREEN

267'6"

BOTTOM OF TAIL PIPE

268'6" Bottom of Drilled Hole

Shoe @ 269' Drove Clay Plug into Bottom of Shoe

RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

RECEIVED

JUL 12 2010

WATER RESOURCES DEPT
SALEM OREGON

RECEIVED

MAY 27 2010

WATER RESOURCES DEPT
SALEM, OREGON

T 12523



OREGON WATER RESOURCES DEPARTMENT
TRANSFER REIMBURSEMENT AUTHORITY
ESTIMATE APPLICATION



ORS 536.055 authorizes the Oregon Water Resources Department to expedite or enhance regulatory processes voluntarily requested under the agreement.

The purpose of this application is to obtain estimates of the cost and time required to process a Transfer Application Request. There is a non-refundable application fee of \$125.00 per request.

<u>TYPE</u>	<u>FILE NUMBER</u>
Transfer Application	Transfer Number

	<u>Applicant Information</u>	<u>Applicant's Representative/Contact</u>
Name:	City of Junction City Attn: Gary Kaping	Steven R. Bruce/ Skookum Water
Address:	P. O. Box 250	Associates Inc. 1626 Victorian Way
	Junction City, OR 97448	Eugene OR 97401
Phone:	(541) 998-3125	(503) 319-8926
Fax:		
E-Mail Address:	gkaping@ci.junction-city.or.us	steve@skookumwater.com

I understand the following:

- There is a non-refundable application fee of \$ 125.00 per request.
- That upon receipt of my non-refundable application fee of \$ 125.00, OWRD will assign my request to the next contractor in the pool of contractors performing expedited services.
- That this fee covers the copying, the mailing cost, as well as the cost for the contractor to evaluate and provide the estimate for processing of the request.
- That OWRD will provide all pertinent information to the assigned contractor within one (1) business day.
- That OWRD will, within fourteen (14) days, notify me in writing of the estimates of costs and time frame for the expedited service.
- That upon receiving the estimate I may agree or decline to enter into a formal contract to pay the estimated cost in advance to initiate the expedited service.
- An incomplete or inaccurate application may delay the process and increase the cost to process my request.
- Expedited processing does not guarantee a favorable review of my request.
- Send completed Application and payment to:

Oregon Water Resources Department
Transfer Reimbursement Authority Program
725 Summer St. NE, Suite A
Salem, OR 97301-1271

I certify that I am the (check one):

☒ Applicant ☐ Applicant's Representative ☐ Other (Please specify) _____

RECEIVED BY OWRD

Name: Gary Kaping; City of Junction City Public Works Director

NOV 14 2016

Signature: _____

SALEM, OR

OWRD USE ONLY: Reimbursement Authority Number: R11153 17

Water Resources Department
Contract Summary Sheet

Contractor Info: City of Junction City
Gary Kaping
PO Box 250
Junction City, OR 97448

Contract #: R11 153 17
Amendment #: -

Amount of this Action: \$ 1,200
Cumulative Amount of Contract: \$ 1,200
Funding: Other Funds

Type: RA
Category: -
Agency Contact: Dwight French WRSD - Transfer

Begin Date: 12/8/16
End Date: 6/30/17

Purpose

Agreement to expedite the processing of transfer application T- 12523

Procurement Information


Reimbursement Authority Program

Approvals

Initials indicate
approval to
proceed

Division Administrator

Admin Services Division




Date 12-8-16

Date 12/8/16

Distribution

Dwight French - WRSD - Transfer
ASD

Accounting

PCA: 47124
Agency Object: 4701
D23 Fund: -
Tax ID:
Grant Number: R 11 153 17

Fiscal Instructions

Record Create Date

12/8/16



Oregon
Kate Brown, Governor

Water Resources Department
725 Summer St NE, Suite A
Salem, OR 97301
(503) 986-0900
Fax (503) 986-0904

November 30, 2016

City of Junction City
Attn: Gary Kaping
PO Box 250
Junction City, OR 97448

RE: Transfer Application T-12523

Dear Applicant

Enclosed is the Reimbursement Authority Applicant Agreement for Transfer T-12523. In order to commence work, the Agreement must be signed and accompanied with the full payment of the estimated maximum cost.

Please read the Agreement thoroughly and follow the instructions to proceed with the expedited transfer process. To complete the requested service, please mail the signed contract and check to:

Oregon Water Resources Department
Attention: Kate Fitzgerald
725 Summer Street NE, Suite A
Salem, Oregon 97301-1266

If you have any questions, please contact me at (503) 986-0898 or kate.m.fitzgerald@oregon.gov.

Sincerely,

Kate Fitzgerald
Natural Resource Specialist
Transfer and Conservation Section

cc: Steven Bruce, Skookum Water Associates Inc., (via email)

enclosure

REIMBURSEMENT AUTHORITY APPLICANT'S AGREEMENT



This Agreement is between the **Oregon Water Resources Department**, hereafter OWRD, and City of Junction City, hereafter Applicant, hereafter known together as the parties.

OWRD Information	Applicant's Information	Applicant's Representative
Contact: Kelly Starnes Title: Transfer Advisor Address: 725 Summer Street, NE, Suite A Salem, OR 97301-1266 Phone: 503 986-0886 Fax: 503 986-0901 Email: Patrick.K.Starnes@oregon.gov	Name: City of Junction City Contact: Gary Kaping Address: PO Box 250 Junction City, OR 97448 Phone: 541-998-3125 Fax: Email: gkaping@ci.junction-city.or.us	Name: Skookum Water Associates Inc Contact: Steve R. Bruce Address: 1626 Victorian Way Eugene, OR 97401 Phone: 503-319-8926 Fax: Email: steve@skookumwater.com

Purpose The purpose of this Agreement is to expedite the processing of the **Transfer Application**. (Application Number: T-12523)

- Authority** The OWRD has been authorized pursuant to ORS 536.055 to enter into a voluntary agreement with any applicant, permittee or regulated entity (collectively Applicant) for expediting or enhancing a regulatory process. In making this agreement, OWRD shall require the applicant to pay the full cost of expedited process.
- Restrictions.** Applicant and OWRD agree that this Agreement shall not be construed to restrict in any way the decisions and actions by OWRD. OWRD shall be free to exercise independent judgment consistent with existing laws and regulations.
- Effective Date and Duration.** Unless otherwise terminated by non-deposit of funds by the Applicant, this Agreement shall become effective on the date on which both parties have signed the Agreement and the full deposit of the estimated cost of the proposed service.
- Statement of Work.** The Statement of Work is contained in Exhibit A attached hereto and incorporated by reference into this Agreement. OWRD agrees to perform this work in accordance with the terms and conditions of this Agreement.
- Consideration.**
 - Applicant** shall pay OWRD in advance for actual costs incurred by OWRD as specified in the Statement of work attached and incorporated as Exhibit A. The estimated maximum reimbursement payable to OWRD under this Agreement is **\$1200.00**. Applicant agrees to pay the full amount of **\$1200.00** to OWRD prior to commencement of any work stated in this Agreement. This payment will be placed in an account administered by OWRD and drawn upon as costs are actually incurred. If the actual cost of performing the work is less than payments received, OWRD will refund the unspent balance. If the actual cost of processing exceeds the estimate, the Applicant can either elect to terminate this Agreement or amend the Agreement to reflect the increase in cost.
 - The costs stated in this Agreement do not include the statutory application processing and filing fees.
- Subcontracts.** OWRD intends to undertake the work described in this Agreement by assigning the work to a contractor from its established pre-qualified contractor pool.
- Contract Documents.** This Agreement consists of the following documents which are listed in descending order of precedence: this Agreement and the attached Exhibit A. All attached Exhibits are incorporated into this Agreement by reference.

8. **Confidentiality.** Applicant agrees that any information provided to or acquired by OWRD under this Agreement will be subject to the Oregon Public Records Law and shall be considered public records.
9. **Indemnity.** Applicant shall defend, save, hold harmless, and indemnify the State of Oregon, OWRD, and their officers, employees, and agents from and against all claims, suits, actions, losses, damages, liabilities, costs and expenses of any nature resulting from or arising out of, or relating to the activities of Applicant or its representatives, officers, employees, contractors, or agents under this Agreement or with respect to the expedited service. The Applicant acknowledges that the Oregon Water Resources Department cannot and does not guarantee a favorable review under the subject regulatory process.
10. **Termination.** Applicant may request to terminate this agreement only in writing at anytime during the process. The Applicant agrees to pay for the work done by the Contractor up until the time of the written termination request. OWRD, upon receiving such written termination request from the Applicant and appropriately notifying the Contractor, will refund any unspent balance after paying the contractor for the work done.
11. **Funds Authorized and Available.** By its execution of this Agreement, Applicants certify that sufficient funds are authorized and available to cover the expenditures contemplated by this Agreement.
12. **Duration of Estimate.** The Estimate of Time to complete the work in Exhibit A (Statement of Work) becomes null and void after thirty- (30) days from the date the Applicant's Agreement is mailed. If the Applicant's Agreement is not received by the Department within thirty (30) days of mailing the Agreement, the Applicant must re-apply for a new estimate.
13. **Completion Date.** OWRD, by the execution of this Agreement does not guarantee the completion date indicated in this Agreement. Completion date is only an estimate and may be affected by the Department's workload, issues arising from the processing of the requested services and Applicant's timely response to requests for additional information.
14. **Captions.** The captions or headings in this Agreement are for the convenience only and in no way define limit or describe the scope or intent of any provision of this Agreement.
15. **Amendment and Merger.** The terms of this Agreement shall not be waived, altered, modified, supplemented or amended in any manner whatsoever, except by written instrument signed by both parties. Such waiver, consent, modification or change, if made, shall be effective only in the specific instance and for the specific purpose given. There are no understandings, agreements or representations, oral or written, not specified herein regarding this Agreement.
16. **Signatures.** All parties, by the authorized representative's signature below, hereby acknowledge that they have read this Agreement, understand it and agree to be bound by its terms and conditions.

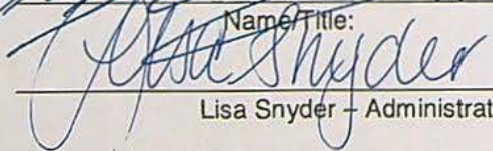For Applicant:  11-30-16
Name/Title: _____ Date
For OWRD:  12/8/16
Lisa Snyder - Administrator Date

Mail signed Agreement to:

Salem Opeifa
Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, OR 97301-1266

Exhibit A

Statement of Work

Application Number: T - 12523

Name of Applicant: City of Junction City

Reimbursement Authority Process Itemized Estimate Sheet For Transfer Application

	Item	Time
1	Review of application for completeness.	1.0
2	Review of "From" lands to confirm consistency with existing right(s) and ownership.	1.0
3	Review of "To" lands for conflicts and preparation of draft deficiency letter (if necessary).	1.0
4	Preparation of draft preliminary determination and DPD cover letter.	4.0
5	Preparation of PD public notice, PD cover letter (and remaining right certificate(s) if necessary), and processing documentation.	3.0
Total Estimated Time:		10.0

Total estimated cost is 10.0 hours at \$120.00 per hour = \$1200.00

Completion of Draft Preliminary Determination: January 13, 2016

**Dates are contingent on the Applicant's expeditious resolution of any deficiency and may be affected by Department's work load.*

WORK ORDER

Work Order #: **R11 153 17**

Water Right Contract Work

This Work Order hereby incorporates by reference all of the terms and conditions contained in the Price Agreement between the State of Oregon acting by and through Oregon Water Resources Department and Sarah Henderson.

Contractor Data	Water Resource Data
Project Contact: <u>Sarah Henderson</u> Company: Oregon Water Resources Dept. Address: 725 Summer Street NE, Suite A Salem, OR 97301 Phone: (503) 986- Fax: (503) 986-0901 E-Mail: <u>Sarah.A.Henderson@oregon.gov</u>	Project Officer: Kelly Starnes, Transfer Advisor Address: Oregon Water Resources Dept. 725 Summer Street NE, Suite A Salem, OR 97301 Phone: (503) 986-0886 Fax: (503) 986-0901 E-Mail: <u>Patrick.K.Starnes@oregon.gov</u>

Work Order Effective Date: **December 09, 2016**

Part I. General Information. This Work Order is in effect between the contractor and the Department for the processing of water right applications as described in the Master Agreement

Part II. Work; Acceptance Criteria; Deliverables and Delivery Schedule: – See Exhibit A (Statement of Work for delivery schedule).

Part III. Special Considerations. There is no Special Consideration related to this Work Order.

Part IV. Payment Provisions. Unless otherwise specified, payments related to this Work Order shall be made only upon receipt and approval of the final product - The Product includes all deliverables - the Final Check List, Electronic and Paper Reports.

Payment for this work shall be processed upon receiving related invoice and the completed Deliverable Cover Sheet.

Part V. Travel and Other Expenses.

Agency shall not reimburse Contractor for any travel expense under this Contract.

Part VI. Contract Amendments.

The Agency reserves the right to amend the Contract for the Anticipated Amendments, listed below, in accordance with the rules of OAR 125-246-0560.

ANTICIPATED AMENDMENTS

None. Unless specified by the Agency.

Exhibit A
Reimbursement Authority Process
Itemized Estimate Sheet
For
Transfer Application

Application Number: T-12523

Name of Applicant: City of Junction City

	Item	Time
1	Review of application for completeness.	1.0
2	Review of "From" lands to confirm consistency with existing right(s) and ownership.	1.0
3	Review of "To" lands for conflicts and preparation of draft deficiency letter (if necessary).	1.0
4	Preparation of draft preliminary determination and DPD cover letter.	4.0
5	Preparation of PD public notice, PD cover letter (and remaining right certificate(s) if necessary), and processing documentation.	3.0
Total Estimated Time:		10.0

Total estimated cost is 10.0 hours at \$90.00 per hour = \$900.00

Estimated date of completion of the Draft Preliminary Determination: January 6, 2016

Contractor shall notify OWRD in advance if more than 10.0 is needed to complete the work described in the Statement of Work above.

Invoices for this Work Order shall be sent to:

Salem Opeifa
Oregon Water Resources Department
Loan Servicing Specialist
725 Summer Street NE, Suite A
Salem, OR 97301-1271

WORK ORDER

Work Order #: **R11 153 17**

Water Right Contract Work

This Work Order hereby incorporates by reference all of the terms and conditions contained in the Price Agreement between the State of Oregon acting by and through Oregon Water Resources Department and Sarah Henderson.

Contractor Data	Water Resource Data
Project Contact: <u>Sarah Henderson</u> Company: Oregon Water Resources Dept. Address: 725 Summer Street NE, Suite A Salem, OR 97301 Phone: (503) 986- Fax: (503) 986-0901 E-Mail: <u>Sarah.A.Henderson@oregon.gov</u>	Project Officer: Kelly Starnes, Transfer Advisor Address: Oregon Water Resources Dept. 725 Summer Street NE, Suite A Salem, OR 97301 Phone: (503) 986-0886 Fax: (503) 986-0901 E-Mail: <u>Patrick.K.Starnes@oregon.gov</u>

Work Order Effective Date: **December 09, 2016**

Part I. General Information. This Work Order is in effect between the contractor and the Department for the processing of water right applications as described in the Master Agreement

Part II. Work; Acceptance Criteria; Deliverables and Delivery Schedule: – See Exhibit A (Statement of Work for delivery schedule).

Part III. Special Considerations. There is no Special Consideration related to this Work Order.

Part IV. Payment Provisions. Unless otherwise specified, payments related to this Work Order shall be made only upon receipt and approval of the final product - The Product includes all deliverables - the Final Check List, Electronic and Paper Reports.

Payment for this work shall be processed upon receiving related invoice and the completed Deliverable Cover Sheet.

Part V. Travel and Other Expenses.

Agency shall not reimburse Contractor for any travel expense under this Contract.

Part VI. Contract Amendments.

The Agency reserves the right to amend the Contract for the Anticipated Amendments, listed below, in accordance with the rules of OAR 125-246-0560.

ANTICIPATED AMENDMENTS

None. Unless specified by the Agency.

CONTRACTOR, YOU WILL NOT BE PAID FOR SERVICES RENDERED PRIOR TO NECESSARY APPROVALS.

Agency may terminate this Work Order:

- a. Immediately upon written notice if the Department fails to receive funding from the Applicant.
- b. Upon receiving a written Termination Notice from the Applicant.

Contractor will be paid for all work performed up to the time of the written Termination Notice but not to exceed the total amount of this Work Order.

ACCEPTANCE OF TERMS BY CONTRACTOR:

Sarah Henderson
Name
Sarah Henderson 12/9/16
Signature Date

APPROVED BY AGENCY:

Lisa Snyder 12/13/16
Date
Lisa Snyder
Administrator
Administrative Services
Oregon Water Resources Department

Reviewed as to Legal Sufficiency by Assistant Attorney General Date
(All work orders more than \$75,000 must be approved by the AG's Office)

**Reimbursement Authority Process
Itemized Estimate Sheet
for
Water Rights Transfer**

Application Number: T-12523

Name of Applicant: City of Junction City

Proposed Timeline

January 6, 2016	Completion of draft preliminary determination--1 week after contracts signed and removal of deficiencies, but not before the end of the Public Notice comment period and receipt of all agency reviews (Watermaster, groundwater and ODFW as applicable).
Completion of contract work: Submittal of processing notes, Review checklist, PD cover letter, PD public notice (and remaining rights certificates or ownership review if applicable)—generally within 5 business days after comments received from applicant that the draft is satisfactory, or after the end of the period for applicant to comment on draft PD and remedy deficiencies.	

For purposes of water right transfers, all deliverables must be in Microsoft Word except remaining right certificates for which electronic copies of the existing certificates are currently available in WordPerfect.

Estimate

	Item	Time
1	Review of application for completeness.	1.0
2	Review of "From" lands to confirm consistency with existing right(s) and ownership.	1.0
3	Review of "To" lands for conflicts and preparation of draft deficiency letter (if necessary).	1.0
4	Preparation of draft preliminary determination and DPD cover letter.	4.0
5	Preparation of PD public notice, PD cover letter (and remaining right certificate(s) if necessary), and processing documentation.	3.0
Total Estimated Time:		10.0

(Indicate the estimated amount of time, in ½ hour increments, needed to complete each item listed.)

Prior to preparing an estimate, contact Department staff if work could not be performed consistent with the proposed timeline. In developing the estimate, review the transfer application, transfer map, existing certificate, and final proof map. Pay particular attention to the clarity of the existing rights and the complexity of the request.

Name of Consultant:


Authorized Representative: Sarah Henderson
Revised 1/11/10

Date: 11/30/16



City of Junction City, Oregon
City Engineer: [Name]
City Manager: [Name]

- LEGEND**
- AIR RELIEF
 - BLOW OFF
 - BUILDINGS
 - BUTTERFLY VALVE
 - CAP
 - CITY LIMITS
 - URBAN GROWTH BOUNDARY
 - FIRE HYDRANT
 - GATE VALVE
 - LINE NOT CONNECTED
 - RAILROAD
 - WELL
 - DESIGNATES NO. OF PORTS
 - 8" W/ - CAST IRON WATER PIPE W/SIZE
 - 8" W/ - GALVANIZED IRON WATER PIPE W/SIZE
 - 8" W/ - WROUGHT IRON WATER PIPE W/SIZE
 - 8" W/ - POLYETHYLENE GLASS REINFORCED WATER PIPE W/SIZE
 - 8" W/ - STEEL WATER PIPE W/SIZE
 - 8" W/ - TRANSITE WATER PIPE W/SIZE
 - FIRE HYDRANT NUMBER
 - NUMBER OF PORTS



RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

0 150 300 600
Feet
1"=300'

VERIFY GRAPHIC SCALE. MAPS MAY NOT BE PLOTTED TO SCALE SHOWN.


City of Junction City

FINISH WATER SYSTEM MAP

Last Updated 9/22/15

City of Junction City, Oregon
City Manager: Mike Jans (Phone: 541-325-1234)

- LEGEND**
- | | | | |
|-------------------------|-----------------------|--|-----------------------|
| □ AIR RELIEF | ⊗ FIRE HYDRANT | ⊗ WELL | ⊗ FIRE HYDRANT NUMBER |
| ● BLOW OFF | ⊗ GATE VALVE | ⊗ DESIGNATES NO. OF TURNS TO OPEN VALVE | ⊗ NUMBER OF PORTS |
| ⊗ BUILDINGS | ⊗ LINES NOT CONNECTED | ⊗ 8" - WROUGHT IRON WATER PIPE W/SIZE | |
| ⊗ BUTTERFLY VALVE | ⊗ RAILROAD | ⊗ 8" - POLYETHYLENE GLASS REINFORCED WATER PIPE W/SIZE | |
| ⊗ CAP | | ⊗ 8" - CAST IRON WATER PIPE W/SIZE | |
| ⊗ CITY LIMITS | | ⊗ 8" - GALVANIZED IRON WATER PIPE W/SIZE | |
| ⊗ URBAN GROWTH BOUNDARY | | ⊗ 8" - STEEL WATER PIPE W/SIZE | |
| | | ⊗ 8" - TRANSITE WATER PIPE W/SIZE | |



0 150 300 600
feet
1"=300'

VERIFY GRAPHIC SCALE. MAPS MAY NOT BE PLOTTED TO SCALE SHOWN.

City of Junction City

FINISH WATER SYSTEM MAP

Last Updated 9/22/15


RECEIVED BY OWRD

NOV 14 2016

SALEM, OR

T 12523

TRANSFER APPLICATION MAP
 Certificate 41697
 Sections 29, 30, 31 & 32, T15S, R5W, W.M., and
 Section 36, T15S, R5W, W.M., and
 Sections 5, 6, 8, 17, 20, 21 & 29, T16S, R4W, W.M., Lane County
 City of Junction City

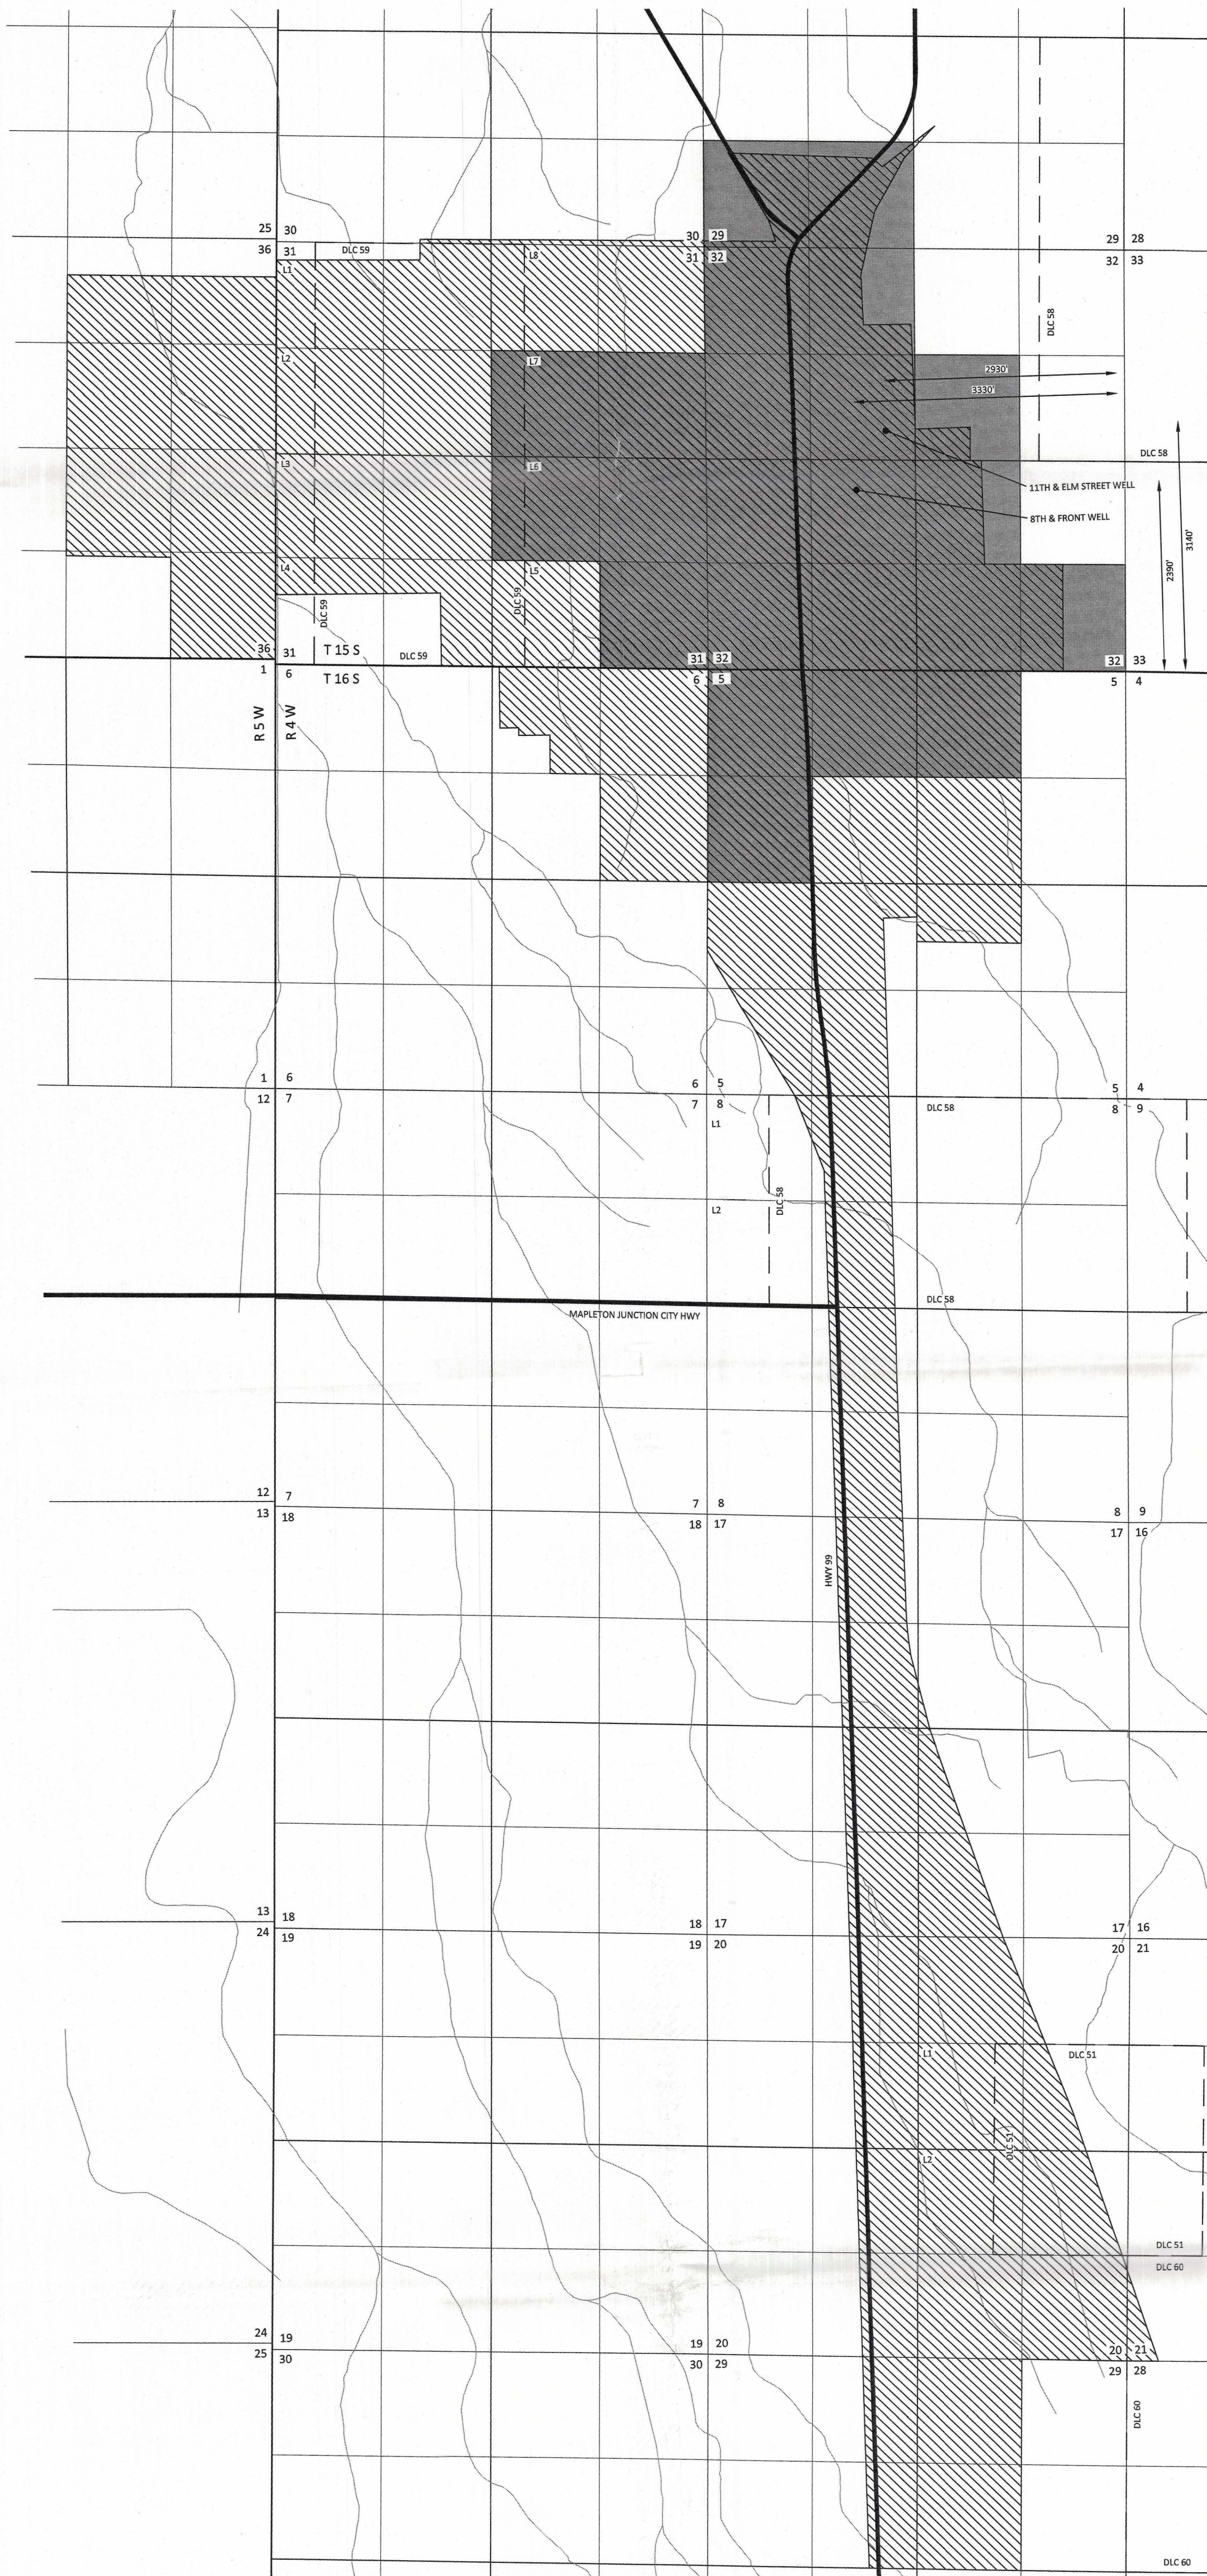


EXPLANATION

AUTHORIZED LANDS	PROPOSED LANDS
 CERTIFICATE 41697 MUNICIPAL RIGHTS PRIORITY: 9/20/1968	 CERTIFICATE 41697 MUNICIPAL RIGHTS PRIORITY: 9/20/1968

- POINT OF DIVERSION (POD)
- NOTES:
 1. The Authorized Lands are based on the quarters and quarter-quarters listed in Certificate 41697 and may include lands outside the City service area boundary.
 2. The water system piping is shown on a separate map.



RECEIVED BY OWRD
 NOV 14 2016
 SALEM, OR

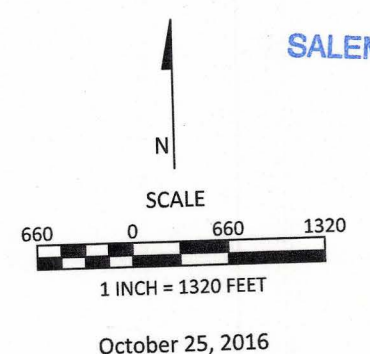


October 25, 2016
 This map is not intended to provide legal dimensions or locations of property ownership lines

FIGURE 1

Sections 29, 30, 31 & 32, T15S, R5W, W.M., and
Section 36, T15S, R5W, W.M., and
Sections 5, 6, 8, 17, 20, 21 & 29, T16S, R4W, W.M., Lane County

Transfer T-12523
CLAIM OF BENEFICIAL USE MAP
City of Junction City

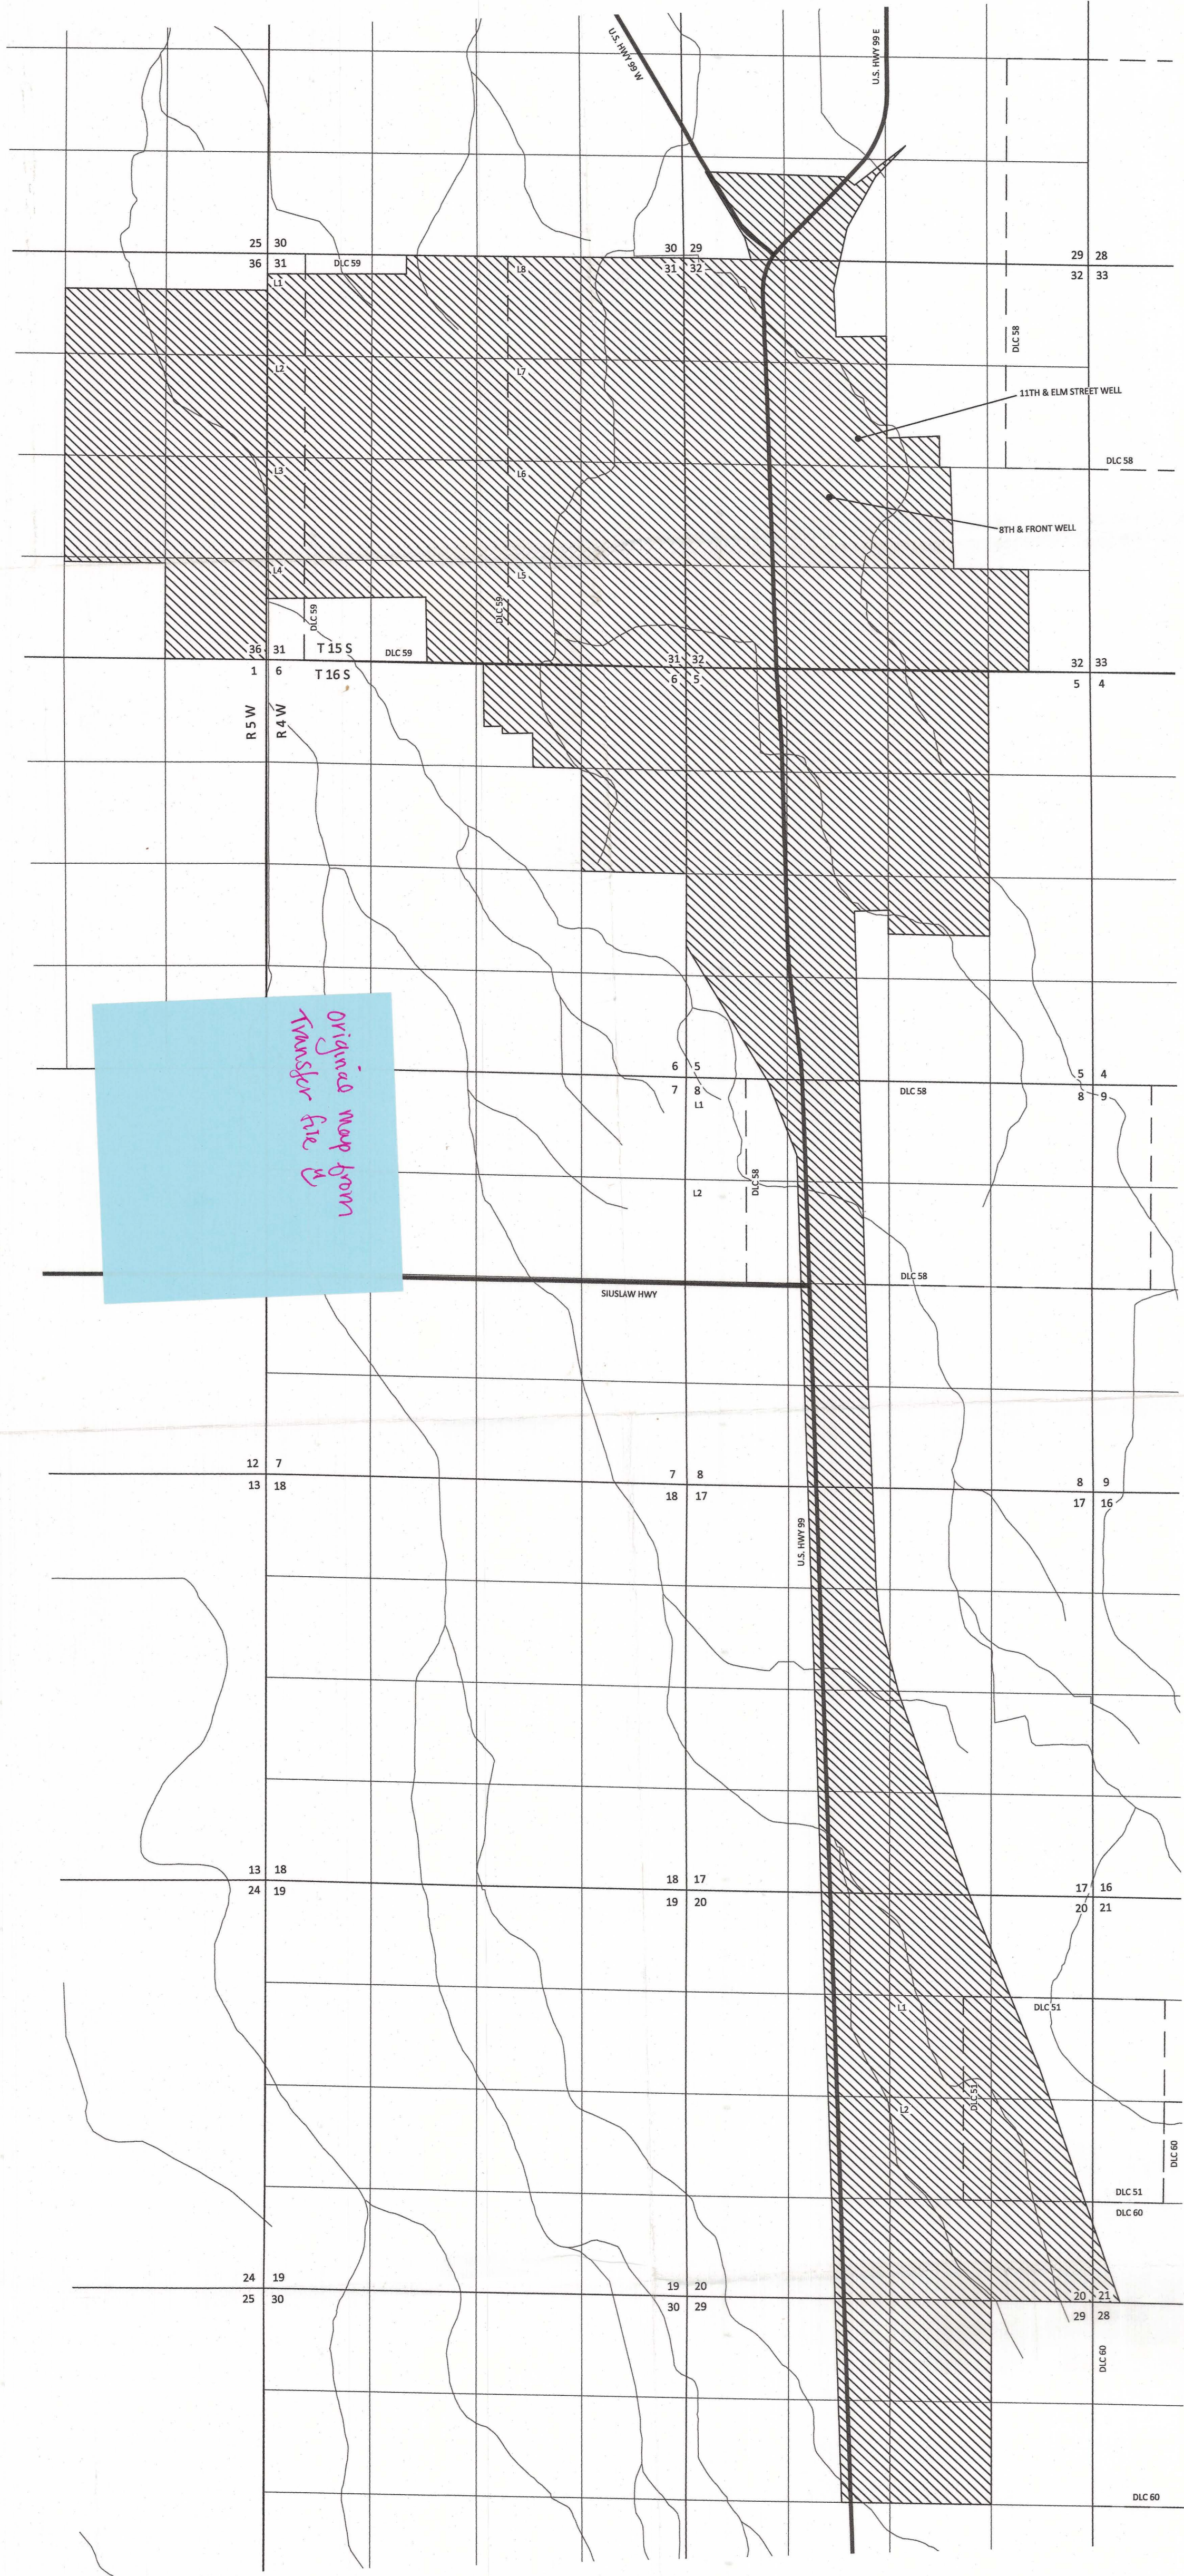

11TH & ELM STREET WELL LOCATION: 3140 FT N AND 2930 FT W FROM SE CORNER OF SECTION 32, T15S, R4W, W.M.
8TH & FRONT STREET WELL LOCATION: 2390 FT N AND 3330 FT W FROM SE CORNER OF SECTION 32, T15S, R4W, W.M.

EXPLANATION
T-12523 PLACE OF USE
MUNICIPAL USE
PRIORITY: 1/17/1992
POINT OF DIVERSION (POD)

Site Inspection Conducted
12/21/2022
N
SCALE
660 0 660 1320
1 INCH = 1320 FEET
January 3, 2023