

**CLAIM OF
BENEFICIAL USE
for Reservoir Permits by
CWRE's (not self-certified)**



Oregon Water Resources Department
725 Summer Street NE, Suite A
Salem, Oregon 97301-1266
(503) 986-0900
www.oregon.gov/OWRD

**A fee of \$345 must accompany this form for permits
with priority dates of July 9, 1987, or later.**

Enter the date the priority date of the permit:

August 26, 1996

A separate form shall be completed for each permit.

In cases where a permit has been amended through the permit amendment process, a separate claim for the permit amendment is not required. Incorporate the permit amendment into the claim for the permit.

This form is subject to revision. **Begin each new claim** by checking for a new version of this form at:
<https://www.oregon.gov/OWRD/Forms/Pages/default.aspx>

The completion of this form is required by OAR 690-014-0100(1) and 690-014-0110(4).

Please type or print in dark ink. If this form is found to contain errors or omissions, it may be returned to you. **Every item must have a response.** If any requested information does not apply to the claim, insert "NA." **Do not delete or alter any section of this form unless directed by the form.** The Department may require the submittal of additional information from any water user or authorized agent.

"Section 8" of this form is intended to aid in the completion of this form and should not be submitted.

If you have questions regarding the completion of this form, please call 503-986-0900.

The Department has a program that allows it to enter into a voluntary agreement with an applicant for expedited services. Under such an agreement, the applicant pays the cost to hire additional staff that would not otherwise be available. This program means a certificate may be issued in about a month. For more information on this program see:
<https://www.oregon.gov/OWRD/programs/WaterRights/RA/Pages/default.aspx>

SECTION 1

GENERAL INFORMATION

Received
FEB 20 2026
OWRD

1. File Information

APPLICATION # R-81465	PERMIT # (IF APPLICABLE) R-14054	PERMIT AMENDMENT # (IF APPLICABLE) N/A
---------------------------------	--	--

2. Property Owner (current owner information)

APPLICANT/BUSINESS NAME BLAINE LIMITED PARTNERSHIP		PHONE NO. 541-806-4551	ADDITIONAL CONTACT NO.
ADDRESS PO BOX 450			
CITY PARKDALE	STATE OR	ZIP 97041	E-MAIL rickblaine2010@yahoo.com , avalonorchards@gmail.com

If the current property owner is not the permit holder of record, it is recommended that an assignment be filed with the Department. ***Each permit holder of record must sign this form.***

3. Permit holder of record (this may, or may not, be the current property owner)

PERMIT HOLDER OF RECORD BLAINE LIMITED PARTNERSHIP/RICHARD BLAINE			
ADDRESS PO BOX 450			
CITY PARKDALE	STATE OR	ZIP 97041	

ADDITIONAL PERMIT HOLDER OF RECORD N/A			
ADDRESS N/A			
CITY N/A	STATE N/A	ZIP N/A	

4. Date of Site Inspection:

04/24/2025

5. Person(s) interviewed and description of their association with the project:

NAME	DATE	ASSOCIATION WITH THE PROJECT
Rick Blaine	04/25/2025	Owner

6. County

WASCO

7. If any property described in the place of use of the permit final order is excluded from this report, identify the owner of record for that property (ORS 537.230(5)):

OWNER OF RECORD N/A			
ADDRESS N/A			
CITY N/A	STATE N/A	ZIP N/A	


Add additional tables for owners of record as needed

Received
FEB 20 2026
OWRD

**SECTION 2
SIGNATURES**

CWRE Statement, Seal and Signature

The facts contained in this Claim of Beneficial Use are true and correct to the best of my knowledge.

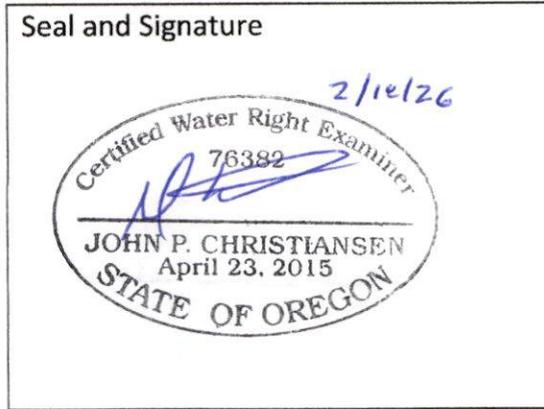

CWRE NAME JOHN CHRISTIANSEN, PE, CWRE		PHONE NO. 503-563-6151	ADDITIONAL CONTACT NO. N/A
ADDRESS AKS ENGINEERING & FORESTRY, 12965 SW HERMAN RD, SUITE 100			
CITY TUALATIN	STATE OR	ZIP 97062	E-MAIL JOHNC@AKS-ENG.COM

Permit Holder(s) of Record Signature or Acknowledgement

Each permit or transfer holder of record must sign this form in the space provided below.

The facts contained in this Claim of Beneficial Use are true and correct to the best of my knowledge. I request that the Department issue a water right certificate.

SIGNATURE	PRINT OR TYPE NAME	TITLE	DATE
	RICHARD T. BLAINE	Pres	1/22/26
APPLICATION # R-81465	PERMIT # (IF APPLICABLE) R-14054		

Received

FEB 20 2026

OWRD

SECTION 3
CLAIM DESCRIPTION

1. Reservoir source and, if from surface water, the tributary:

RESERVOIR NAME OR NUMBER	SOURCE	TRIBUTARY
RESERVOIR #2	UNNAMED STREAM	ROCK CREEK

2. Developed use(s), period of use, and acre foot (af) for each use:

RESERVOIR NAME OR NUMBER	USES	SEASON OR MONTHS WHEN WATER WAS APPROPRIATED FOR STORAGE	VOLUME STORED (AF)
RESERVOIR #2	IRRIGATION	10/1 – 4/15	258
Total Quantity of Water Stored			258

3. Provide a general narrative description of the distribution works. This description must trace the water system from each point of diversion to the reservoir:

Reservoir #2 is located in Wasco County, stores 258 acre-feet of water used for irrigation under this permit. An additional 80 acre-feet may be stored under permit R-14868. Maximum capacity for this reservoir is 283 acre-feet. 150 acres of surface run off water is collected along a gravity flow unnamed tributary. The water flows to an impoundment dam with a max height of 27'. The impoundment dam has an open channel overflow ditch and water is also able to be released/bypassed with a 12" diameter outlet pipe at the NE corner of the reservoir.

Reminder: The map associated with this claim must identify the location of the point(s) of diversion, Donation Land Claims (DLC), Government Lots (GLot), and Quarter-Quarters (QQ).

4. Variations:

Was the use developed differently from what was authorized by the permit, permit amendment final order, or extension final order? If yes, describe below. YES NO
 (e.g. "The permit allowed the development of three reservoirs. The permit holder only developed one of the reservoirs."
 or "The permit allowed for the storage of 9 acre feet of water. The reservoir was developed to hold 5.2 acre feet.")

N/A

5. Claim Summary:

RESERVOIR NAME OR #	MAXIMUM STORAGE AUTHORIZED BY PERMIT (AF)	MAXIMUM STORAGE DEVELOPED (AF)
RESERVOIR #2	258	283 (additional 80 AF allowed under permit R-14868)

Received
FEB 20 2026
OWRD

SECTION 4 SYSTEM DESCRIPTION

Are there multiple reservoirs? YES NO

If "YES" you will need to copy and complete Sections A through E for each reservoir.

Reservoir Name or Number this section describes (only needed if there is more than one):

N/A

A. Reservoir Location

1. Is the reservoir on-channel? YES NO

2. Provide dam outlet location and/or point of diversion(s).

TWP	RNG	MER	SEC	QQ	GLOT	DLC	MEASURED DISTANCES
04S	12E	W.M.	32	NE NE			310 FEET SOUTH, 10 FEET WEST

Reminder: The map associated with this claim must identify Donation Land Claims (DLC), Government Lots (GLOT), and Quarter-Quarters (QQ).

B. Diversion and Delivery System Information

Provide the following information concerning the diversion and delivery system. Information provided must describe the equipment used to transport the water from the point(s) of diversion to the reservoir.

1. Is a pump used? YES NO

If "NO" items 2 through item 5 may be deleted.

2. Pump Information

MANUFACTURER	MODEL	SERIAL NUMBER	TYPE (CENTRIFUGAL, TURBINE OR SUBMERSIBLE)
N/A	N/A	N/A	N/A

3. Theoretical Pump Capacity

HORSEPOWER	OPERATING PSI	LIFT FROM SOURCE TO PUMP *IF A WELL, THE WATER LEVEL DURING PUMPING	LIFT FROM PUMP TO PLACE OF USE	TOTAL PUMP OUTPUT (IN CFS)
N/A	N/A	N/A	N/A	N/A

4. Provide pump calculations:

N/A

5. Measured Pump Capacity (using meter if meter was present and system was operating)

INITIAL METER READING	ENDING METER READING	DURATION OF TIME OBSERVED	TOTAL PUMP OUTPUT (IN CFS)
N/A	N/A	N/A	N/A

Reminder: For pump calculations use the reference information at the end of this document.

6. Additional notes or comments related to the system:

N/A

C. Gravity Flow Pipe

(THE DEPARTMENT TYPICALLY USES THE HAZEN-WILLIAM'S FORMULA FOR A GRAVITY FLOW PIPE SYSTEM)

1. Does the system involve a gravity flow pipe?

YES NO

If "NO", items 2 through 4 relating to this section may be deleted.

2. Complete the table:

PIPE SIZE	PIPE TYPE	"C" FACTOR	AMOUNT OF FALL	LENGTH OF PIPE	SLOPE	COMPUTED RATE OF WATER FLOW (IN CFS)
N/A	N/A	N/A	N/A	N/A	N/A	N/A

3. Provide calculations:

N/A

4. If an actual measurement was taken, provide the following:

DATE OF MEASUREMENT	WHO MADE THE MEASUREMENT	MEASUREMENT METHOD	MEASURED QUANTITY OF WATER (IN CFS)
N/A	N/A	N/A	N/A

Attach measurement notes.

D. Gravity Flow Canal or Ditch

(THE DEPARTMENT TYPICALLY USES MANNING'S FORMULA FOR CANALS AND DITCHES)

1. Is a gravity flow canal or ditch used to convey the water as part of the distribution system?

YES NO

If "NO", items 2 through 4 relating to this section may be deleted.

Received
FEB 20 2026
OWRD

WR

2. Complete the table:

CANAL OR DITCH TYPE (MATERIAL)	TOP WIDTH OF CANAL OR DITCH	BOTTOM WIDTH OF CANAL OR DITCH	DEPTH	"N" FACTOR	AMOUNT OF FALL	LENGTH OF CANAL / DITCH	SLOPE	COMPUTED RATE (IN CFS)
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

3. Provide calculations:

N/A

4. If an actual measurement was taken, provide the following:

DATE OF MEASUREMENT	WHO MADE THE MEASUREMENT	MEASUREMENT METHOD	MEASURED QUANTITY OF WATER (IN CFS)
N/A	N/A	N/A	N/A

Attach measurement notes.

E. Reservoir

1. Does the reservoir require the submittal of as-built plans and specifications? **YES** NO

If "YES", answer item 2; items 3 through 8 relating to this section may be deleted.

If "NO", skip items 2; answer items 3 through 8.

2. Complete the table:

HAVE THE DOCUMENTS BEEN SUBMITTED? YES OR NO	WHEN WERE THE DOCUMENTS SUBMITTED?	HAVE THEY BEEN APPROVED BY THE DEPARTMENT?	NUMBER OF ACRE FEET STORED
N/A	N/A	N/A	N/A

3. If the reservoir stores less than 9.2 acre-feet of water or if the dam is less than 10 feet in height, and as-built plans and specifications are not required, complete the table and items 4 through 8.

MAXIMUM DEPTH	AVERAGE DEPTH	SURFACE AREA (IN ACRES)	VOLUME (IN ACRE FEET)
N/A	N/A	N/A	N/A

4. Provide reservoir volume calculations:


See exhibit B attached to this application for Volume Calculations per surface water elevation.

Received
FEB 20 2026
OWRD

5. Provide the following information concerning the physical characteristics of the dam:

CREST WIDTH (W)	DAM HEIGHT AT CENTERLINE (H)	DISTANCE FROM DOWNSTREAM TOP OF DAM TO DOWNSTREAM TOE (L)	DISTANCE FROM UPSTREAM TOP OF DAM TO UPSTREAM TOE (U)	WATER LEVEL AT INSPECTION	DOWN-STREAM SLOPE	UP-STREAM SLOPE
12 FEET	27 FEET	68 FEET	81 FEET		0.40	0.33

Example Dam Profile This box may be deleted from the form

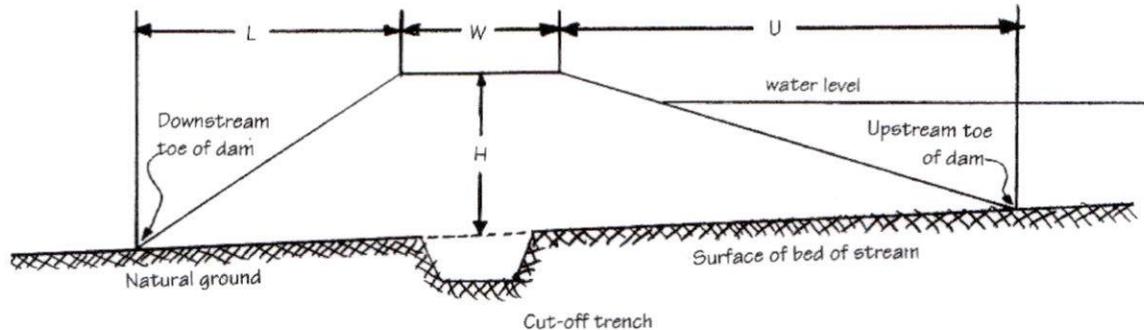

6. Provide a drawing showing the cross section of the dam at the maximum section indicating details and dimensions. The drawing should be drawn at a standard even scale.


See exhibit B attached to this application for the dam Profile and Spillway Cross Section.

7. Describe the outlet works (size and type of the outlet conduit and location):

Reservoir #2 outlet consist of a single 12" diameter ductile iron pipe and gate valve with a fish valve. Outlet is located in the NE section of the dam and daylights to existing drainage ditch.

8. Describe the emergency spillway (dimensions and location):

BOTTOM WIDTH (W)	TOP WIDTH (L)	SPILLWAY DEPTH (H)
8 FEET	VARIES	VARIES (2.5 FEET MINIMUM)

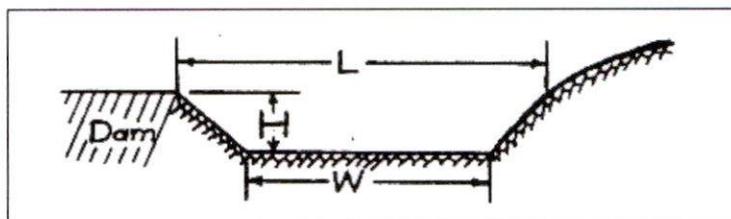

Received
FEB 20 2026

OWRD

WR

SECTION 5 CONDITIONS

All conditions contained in the permit, permit amendment, or any extension final order shall be addressed. Reports that do not address all performance related conditions will be returned.

1. Time Limits:

Permits and any extension final orders contain any or all of the following dates; the date when the actual construction work was to begin, the date when the construction was to be completed, and the date when the complete application of water to the proposed was to be completed. These dates may be referred to as ABC dates. Describe how the water user has complied with each of the development timelines established in the permit or extension final order:

	DATE FROM PERMIT	DATE ACCOMPLISHED*	DESCRIPTION OF ACTIONS TAKEN BY WATER USER TO COMPLY WITH THE TIME LIMITS
ISSUANCE DATE	9/16/2004		
BEGIN CONSTRUCTION (A)	9/16/2005	N/A	Reservoir was constructed in 1996
COMPLETE CONSTRUCTION (B)	N/A	N/A	
COMPLETE APPLICATION OF WATER (C)	10/1/2008	10/2004	Following issuance of the permit, the water user installed the measuring device and conduit/gate assembly and stored the water

* must be within period between permit or any extension final order issuance and the date to completely apply water

2. Is there an extension final order(s)? YES NO

3. Measurement Conditions:

a. Does the permit, permit amendment, or any extension final order require the installation of a meter or approved measuring device? YES NO

If "NO", items b through f relating to this section may be deleted.

Reminder: If a meter or approved measuring device was required, the COBU map must indicate the location of the device in relation to the point of diversion or appropriation.

b. Has a meter been installed? YES NO

c. Meter Information

POD/POA NAME OR #	MANUFACTURER	SERIAL #	CONDITION (WORKING OR NOT)	CURRENT METER READING	DATE INSTALLED
N/A	N/A	N/A	N/A	N/A	N/A

If a meter has been installed, items d through f relating to this section may be deleted.

d. If a meter has not been installed, has a suitable measuring device been installed and approved by the Department? YES NO

e. If "YES", provide a copy of the letter approving the device, if available. If the letter is not available provide the name and title of the Water Resources Department employee approving the measuring device, and the approximate date of the approval:

NAME	TITLE	APPROXIMATE DATE
Unknown	Unknown	Unknown

f. Measurement Device Description

DEVICE DESCRIPTION	CONDITION (WORKING OR NOT)	DATE INSTALLED
Staff Gauge	Working	Unknown; approx. 2015
Additional Explanation: Water used in reservoir is measured via a staff gauge and submitted to the Department annually. Applicant has stated that Watermaster Robert Wood has visited the site in the past and has not had concerns with this approach.		

4. Recording and reporting conditions

a. Is the water user required to report the water use to the Department? YES NO

If "NO", item b relating to this section may be deleted.

b. Have the reports been submitted? YES NO

If the reports have not been submitted, attach a copy of the reports if available.

5. Outlet Pipe

a. Is the water user required to install a minimum 8" outlet pipe/conduit? YES NO

If "NO", items b through c relating to this section may be deleted.

b. Has the outlet pipe been installed? YES NO

If "YES", items c relating to this section may be deleted.

c. Does the water user have other means to evacuate the reservoir? YES NO

DESCRIBE HOW THE WATER USER PLANS TO EVACUATE THE RESERVOIR	HAS THIS PLAN BEEN APPROVED BY THE DEPARTMENT?	BY WHOM?
N/A	<u>YES</u> NO	N/A

6. Fish Screening

a. Are any points of diversion required to be screened to prevent fish from entering the point of diversion? YES NO

If "NO", items b through e relating to this section may be deleted.

Reminder: If fish screening devices were required, the COBU map must indicate their location in relation to the point of diversion.

b. Has the fish screening been installed? YES NO

c. When was the fish screening installed?

DATE	By WHOM
8/12/1996	Permit Holder

Received
FEB 20 2025
OWRD

Reminder: If the permit or transfer final order was issued on or after February 1, 2011, the fish screen is required to be approved by the Oregon Department of Fish and Wildlife regardless of the rate of diversion.

d. If the diversion **involves a pump and the total** diversion rate of all rights at the point of diversion is less than 225 gpm (0.5 cfs):

Has the self-certification form previously been submitted to the Department? **NA YES NO**

- If not, go to <https://www.oregon.gov/OWRD/Forms/Pages/default.aspx> (search for ODFW Small Pump Screen Self Certification), complete and attach a copy of the self-certification form to this claim, and send a copy of it to the Oregon Department of Fish and Wildlife (ODFW).

Reminder: Failure to submit evidence of a timely installed fish screen may result in an unfavorable determination. The ODFW self certification form needs to have been previously submitted or be attached to this form.

e. If the diversion does **not involve a pump or the total** diversion rate of all rights at the point of diversion is 225 gpm (0.5 cfs) or greater:

• Has the ODFW approval been previously submitted? **NA YES NO**

- If not, contact and work with ODFW to ensure compliance. To demonstrate compliance, provide signed documentation from ODFW. A form is available at <https://www.oregon.gov/OWRD/Forms/Pages/default.aspx>

Reminder: Failure to submit evidence of a timely installed fish screen may result in an unfavorable determination. In order to receive a favorable approval, the ODFW/WRD "Fish Screen Inspection" form needs to have been previously submitted or be attached to this form.

7. By-pass Devices

a. Are any points of diversion required to have a by-pass device to prevent fish from entering the point of diversion? **YES NO**

If "NO", items b and c relating to this section may be deleted.

Reminder: If by-pass devices were required, the COBU map must indicate their location in relation to the point of diversion.

b. Have by-pass device been installed? **YES NO**

c. Describe the diversion works as related to whether a by-pass device is installed or unnecessary:

(Provide a letter from ODFW indicating the device is approved or is unnecessary. If there is no letter from ODFW, explain whether or not a by-pass device is necessary.)

DESCRIPTION (E.G. "ODFW HAS APPROVED THE BY-PASS DEVICE" OR "NO BY-PASS DEVICE IS NECESSARY BECAUSE THERE IS A DIRECT DIVERSION FROM THE STREAM VIA A PUMP ON RIVER LEFT STREAM BANK WITH FOOT VALVE DESCENDING DIRECTLY INTO NATURAL POOL.") IN ADDITION, YOU MAY ATTACH PHOTOS TO THIS CLAIM.	IF INSTALLED (DATE)	IF INSTALLED, BY WHOM
N/A	N/A	N/A

Received
FEB 20 2025
OWRD

8. Other conditions required by permit, permit amendment final order, or extension final order

- a. Was the water user required to restore the riparian area if it was disturbed? **YES** **NO**
- b. Was a fishway required? **YES** **NO**
- c. Was submittal of a letter from an engineer required prior to storage of water? **YES** **NO**
- d. Was submittal of a water management and conservation plan required? **YES** **NO**
- e. Other conditions? **YES** **NO**

If "YES" to any of the above, identify the condition and describe the water user's actions to comply with the condition(s):

b. AKS reached out to ODFW to confirm fishway is not needed and is awaiting a response. Applicant is working on satisfying this requirement.
c. It is unknown if the OWRD received written certification from the engineer prior to storage of water. The reservoir was confirmed built in accordance with the approved plans via as-built drawings (attached to this application as Exhibit B).

**SECTION 6
ATTACHMENTS**

Provide a list of any additional documents you are attaching to this report:

ATTACHMENT NAME	DESCRIPTION
EXHIBIT A	11"x17" Claim of Beneficial Use Map with POA
EXHIBIT B	ASBUILT OF IMPOUNDMENT DAM (Reservoir #2)
EXHIBIT C	Permit R-14054 and Map

Received
FEB 20 2025

OWRD WR

STATE OF OREGON

COUNTY OF WASCO

PERMIT TO STORE THE PUBLIC WATERS

THIS PERMIT IS HEREBY ISSUED TO

BLAINE LIMITED PARTNERSHIP
4676 HUTSON DRIVE
PARKDALE, OREGON 97042

The specific limits and conditions of the use are listed below.

APPLICATION FILE NUMBER: R-81465

SOURCE OF WATER: AN UNNAMED STREAM, A TRIBUTARY OF ROCK CREEK

STORAGE FACILITY: ONE UNNAMED RESERVOIR

PURPOSE OR USE OF THE STORED WATER: TO BE APPROPRIATED UNDER APPLICATION S-84335 FOR IRRIGATION

MAXIMUM VOLUME: 258.0 ACRE-FEET EACH YEAR

WATER MAY BE APPROPRIATED FOR STORAGE DURING THE PERIOD: OCTOBER 1 THROUGH APRIL 14 OF EACH YEAR

DATE OF PRIORITY: AUGUST 26, 1996

The area submerged by the reservoir, when full, will be 22.23 acres and the maximum depth of water will be 19.0 feet. The maximum height of the dam shall not exceed 27.0 feet.

DAM LOCATION: NE 1/4 NE 1/4, SECTION 32, T4S, R12E, W.M.; 310 FEET SOUTH AND 10 FEET WEST FROM NE CORNER, SECTION 32

THE AREA TO BE SUBMERGED BY THE RESERVOIR IS LOCATED AS FOLLOWS:

NE 1/4 NE 1/4
SE 1/4 NE 1/4 .
SECTION 32

TOWNSHIP 4 SOUTH, RANGE 12 EAST, W.M.

Measurement, recording and reporting conditions:

- A. Before water use may begin under this permit, the permittee shall install a meter or other suitable measuring device as approved by the Director. The permittee shall maintain the meter or measuring device in good working order, shall keep a complete record of the amount of water used each month and shall submit a report which includes the recorded water use

Application R-81465 Water Resources Department

PERMIT R-14054

Received

FEB 20 2026

OWRD

measurements to the Department annually or more frequently as may be required by the Director. Further, the Director may require the permittee to report general water use information, including the place and nature of use of water under the permit.

- B. The permittee shall allow the watermaster access to the meter or measuring device; provided however, where the meter or measuring device is located within a private structure, the watermaster shall request access upon reasonable notice.

The permittee shall install, maintain, and operate fish screening to prevent fish from entering the proposed diversion. The permittee shall also install a fishway at the obstruction that will provide adequate upstream and downstream passage for fish. The permittee may submit evidence that the Oregon Department of Fish and Wildlife has determined screens and/or fishways are not necessary. The required screens and fishways are to be in place, functional, and approved by Oregon Department of Fish and Wildlife before diversion of any water.

A certificate shall not be issued for this right until a permit has been issued for application S-84335 or a suitable replacement.

DAM CONDITIONS

The outlet gate shall be cycled at least once each year and shall be fully operational at all times. The embankment and spillway shall be kept clear of brush, debris, and burrowing animals.

Routine maintenance of the dam, spillway and appurtenant structures shall be performed as necessary to remove trees, brush and debris, and to repair slumps, areas of erosion, or defective equipment.

The earthen dam, concrete spillway and resultant reservoir shall be constructed and maintained according to the approved plans and specifications dated October 4, 1996, on file with Oregon Water Resources Dam Safety program. Any changes in the approved design prior to construction shall be documented in a letter to Dam Safety.

All construction shall be performed under the supervision of a professional engineer licensed in Oregon. No fill shall be placed until excavation of the foundation has been completed and examined in its entirety by the engineer of record, or by the Water Resources Dam Safety Engineer.

No water shall be stored until the Water Resources Department receives written certification from the engineer of record that construction has been completed in accordance with the approved plans and specifications.

Application R-81465 Water Resources Department PERMIT R-14054

Received

FEB 20 2026

OWRD

If construction deviates from the approved design, a set of asbuilt drawings must accompany the engineer's written certification of completion.

The completed structure shall not be enlarged, modified, altered or otherwise changed without the prior written approval of the Director of the Water Resources Department or the Director's authorized representative. Except for routine repair and maintenance, plans and specifications prepared by an Oregon licensed engineer are required for any modification to the dam, spillway or appurtenant structures.

STANDARD CONDITIONS

The storage of water allowed herein is subject to the installation and maintenance of a fully functional conduit/gate assembly having a minimum diameter of 8 inches.

Failure to comply with any of the provisions of this permit may result in action including, but not limited to, restrictions on the use, civil penalties, or cancellation of the permit.


This permit is for the beneficial use of water without waste. The water user is advised that new regulations may require the use of best practical technologies or conservation practices to achieve this end.

By law, the land use associated with this water use must be in compliance with statewide land-use goals and any local acknowledged land-use plan.

The use of water allowed herein may be made only at times when sufficient water is available to satisfy all prior rights, including prior rights for maintaining instream flows.

Actual construction work shall begin within one year from permit issuance. The reservoir shall be filled and complete application of the stored water to the use shall be made on or before October 1, 2008.

Issued September 16, 2004

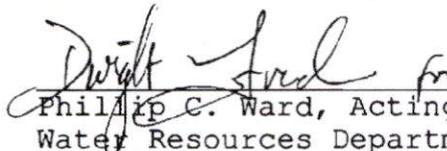
Phillip C. Ward, Acting Director
Water Resources Department

Application R-81465 Water Resources Department
Basin 05 Volume 3 Rock Creek & Misc.
jwg

PERMIT R-14054
District 03

Received

FEB 20 2026

OWRD

ASSIGNMENT OF PERMIT: Pursuant to ORS 537.220, this permit may be assigned to a party other than the permittee named hereon, if the land the permit is associated with changes ownership, or if the permittee is an organization whose name changes as a result of sale or merger. Request for Assignment forms are available from the Oregon Water Resources Department web site at <http://www.wrd.state.or.us/>, or may be requested from the Department at 503-986-0801 or Water Right Application Section, Oregon Water Resources Department, 725 Summer St NE Ste A, Salem OR 97301-1271.

MAILING ADDRESS CHANGES: If the mailing address of the permittee named hereon changes, it is important that the Oregon Water Resources Department be informed of the change. Address changes must be submitted in writing with the permittee's signature to Water Right Application Section, Oregon Water Resources Department, 725 Summer St NE Ste A, Salem OR 97301-1271.

REAL ESTATE TRANSACTIONS: Pursuant to ORS 537.330, in any transaction for the conveyance of real estate that includes any portion of the lands described in this permit, the seller of the real estate shall, upon accepting an offer to purchase that real estate, also inform the purchaser in writing whether any permit, transfer approval order, or certificate evidencing the water right is available and that the seller will deliver any permit, transfer approval order or certificate to the purchaser at closing, if the permit, transfer approval order or certificate is available.

CULTURAL RESOURCES PROTECTION LAWS: Permittees involved in ground-disturbing activities should be aware of federal and state cultural resources protection laws. ORS 358.920 prohibits the excavation, injury, destruction or alteration of an archeological site or object, or removal of archeological objects from public and private lands without an archeological permit issued by the State Historic Preservation Office. 16 USC 470, Section 106, National Historic Preservation Act of 1966 requires a federal agency, prior to any undertaking to take into account the effect of the undertaking that is included on or eligible for inclusion in the National Register. For further information, contact the State Historic Preservation Office at 503-378-4168, extension 232.

Application R-81465 Water Resources Department
Basin 05 Volume 3 Rock Creek & Misc.
jwg

PERMIT R-14054
District 03







Received

FEB 20 2026

OWRD



SCALE: 1" = 100'

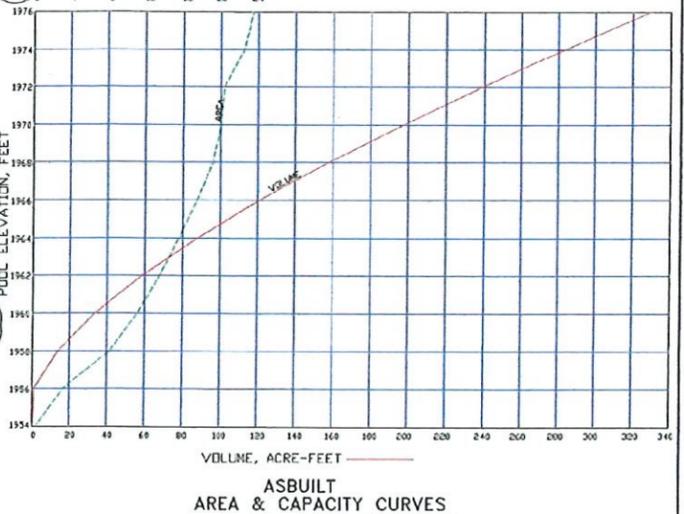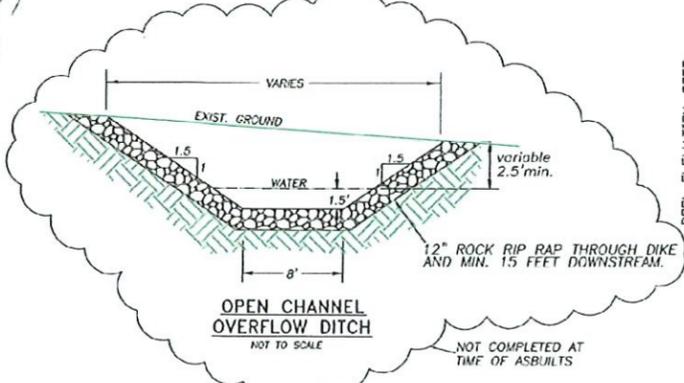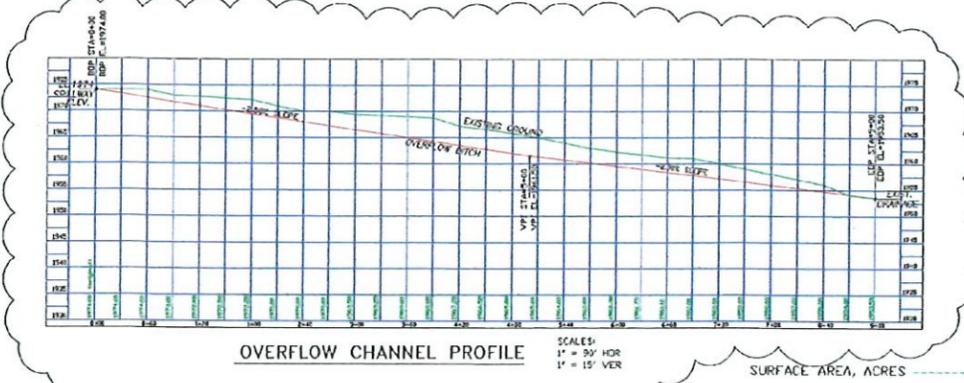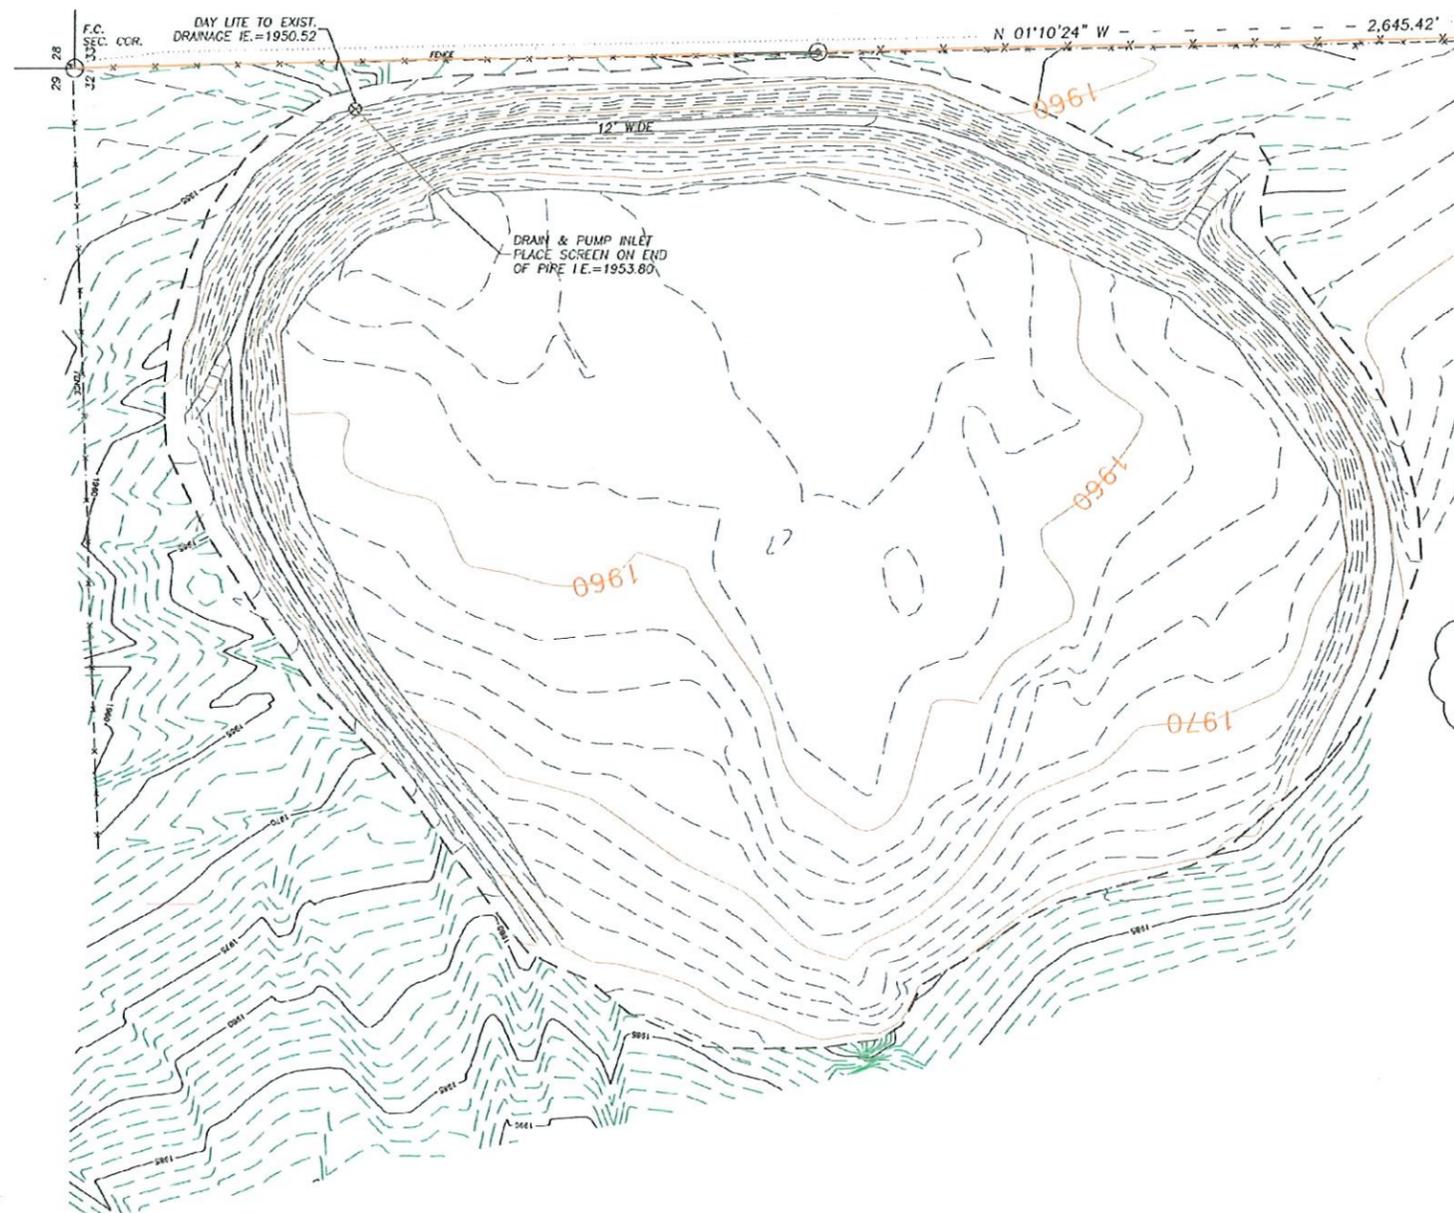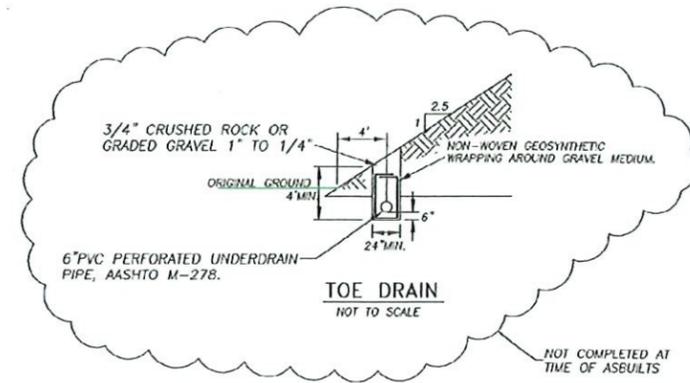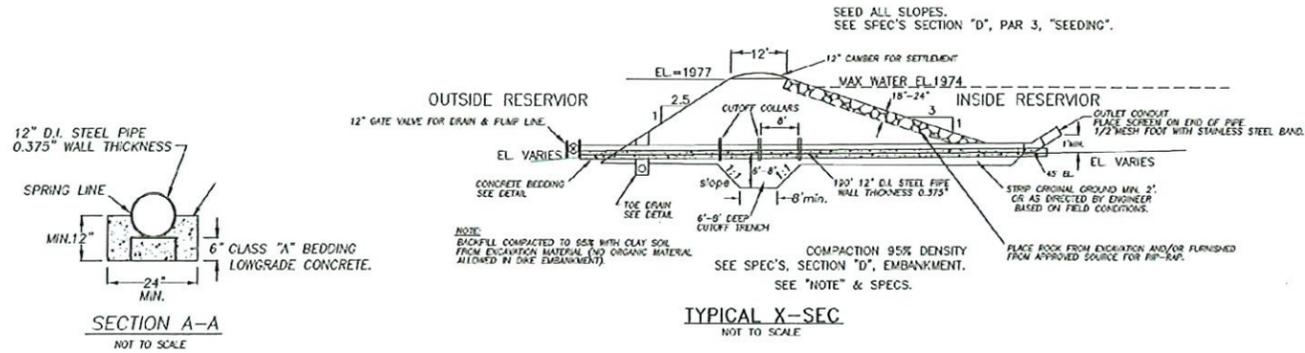

CALCULATED RUNOFF FROM 150 AC OF GRASS LAND.

A=150 Ac. C=0.25 GRASS RAINFALL 1.1 IN/hr. 100 Yr. EVENT

AVG. SLOPE = 2%

Q= AC I=1.1

Q=(150)(0.25)(1.1)

Q=41.3 cfs.

MANNING'S n= 0.035, "Earth Channel, covered with small growth."

PVC PIPE 0.009

CAPACITY: 0+00 TO 5+00, 113 cfs, 2.50% slope.


5+00 TO 9+00, 101 cfs, 2.00% slope.

NOTE: STRIP AND REMOVE ALL SOD, RUBBISH, BOULDERS UNDER ALL EMBANKMENT AREAS, AS PER SPECS.

ASBULT WATER CAPACITY (MAX. ELEV. 1974.0 FT.): 283 AC.FT.



Received FEB 20 2026 OWRD

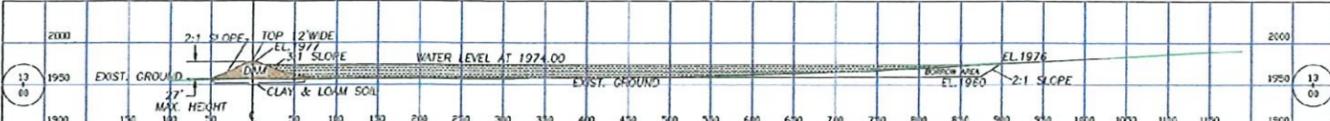

Date	No.	Revisions	By	App.

ASBULT OF IMPOUNDMENT DAM FOR RICHARD BLAINE T.S. R.12 E., SEC. 32 WASCO COUNTY, OREGON

TENNESON ENGINEERING CORP.
CONSULTING ENGINEERS
408 LINCOLN STREET
THE DALLES, OREGON 97058
541-290-9177 FAX 541-596-6657

Survey	Design	Checked	Date	Scale
T.E.C.			8/12/96	1"=100'
Drawn	Eng. No.	Approved	Work Order No.	Sheet
E.H.	S8677gs		8677	2 of 2

